

COOLING CAPACITY: 24,000 - 55,500 BTU/H

HEATING CAPACITY: 23,400 - 56,000 BTU/H



Contents

Nomenclature 2
 Product Specifications 3
 Expanded Cooling Data 4
 Evaporator Airflow Data 20
 Expanded Heating Data 22
 Auxiliary Heating Data 24
 Heat Kit Electrical Specs 26
 Dipswitch Settings 27
 Dimensions 28
 Wiring Diagrams 29
 Accessories 31

Standard Features

- Energy-efficient compressor with internal relief valve
- Two-stage heating & cooling on 4-, and 5-ton units
- Fully charged R-410A system
- ECM blower motor
- Liquid-line filter drier
- Convertible airflow: horizontal or downflow
- Copper tube/aluminum fin coils
- Totally enclosed, permanently lubricated condenser fan motor
- Electric heat kit available as a field-installed option

Cabinet Features

- Heavy-gauge galvanized-steel cabinet with attractive two-tone Architectural Gray powder-paint finish
- Fully insulated air-handling compartment with convenient access panels
- Louvered condenser coil protection
- One footprint; two heights



* Complete warranty details available from your local dealer or at www.amana-hac.com. To receive the Lifetime Compressor Limited Warranty (good for as long as you own your home) and 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Québec.

NOMENCLATURE

	A	P	H	15	36	M	4	1	A	*	
	1	2	3	4,5	6,7	8	9	10	11	12	
Brand	A Amana® Brand										Engineering Minor Revision
Product Category	P Packaged Unit										Engineering Major Revision
Type	C Air Conditioner		H Heat Pump								Voltage Designator 1 208-230/1/60 3 208-230/3/60 4 460/3/60
Efficiency	13 13 SEER		15 15 SEER								Refrigerant 2 R-22 4 R-410A
Nominal Capacity	24 2 Tons	48 4 Tons	36 3 Tons		60 5 Tons						Configuration H Horizontal M Multi-position



SPECIFICATIONS

	APH15 24M41C*	APH15 30M41C*	APH15 36M41C*	APH15 43M41C*	APH15 49M41C*	APH15 60M41C*
COOLING CAPACITY						
Total BTU/h	24,000	29,000	35,400	40,000	46,000	55,500
Sensible BTU/h	18,000	22,200	26,700	28,000	31,000	39,300
SEER / EER	15.0/ 12.0	14.5/ 11.5	14.5/ 12	15.0/ 12.0	15.0/ 11.7	14.0/ 10.2
Decibels	76	76	76	78	78	78
AHRI #s	6710589	6710590	6710591	6710592	6710593	6710594
HEATING CAPACITY						
BTU/h (47°F)	23,400	27,400	35,400	39,000	45,500	56,000
C.O.P (47°F)	3.6	3.5	3.4	3.7	3.6	3.4
BUT/h (17°F)	12,400	15,200	18,600	22,000	25,000	31,400
C.O.P (17°F)	2.0	2.2	2.4	2.3	2.2	2.2
HSPF	8.0	8.0	8.0	8.0	8.0	8.0
EVAPORATOR MOTOR						
Type	ECM	ECM	ECM	ECM	ECM	ECM
Wheel (D x W)	10 x 9	10 x 9	10 x 9	10 x 9	10 x 9	10 x 9
Nominal Cooling CFM	860	1,000	1,200	1,300	1,600	1,950
FLA	4.3	4.3	4.3	2.9	2.9	7
No. of Speeds	5	5	5	5	5	5
Horsepower - RPM	½ -1,050	½ -1,050	½ -1,050	¾ - 1,050	¾ - 1,050	1-1,050
EVAPORATOR COIL						
Face Area (ft ²)	4.5	4.5	4.5	6.2	6.2	6.2
Rows Deep/ Fin per Inch	4/ 14	4/ 14	4/ 14	4/ 14	4/ 14	4/ 14
Expansion Device	TXV	TXV	TXV	TXV	TXV	TXV
Drain Size (NPT)	¾"	¾"	¾"	¾"	¾"	¾"
R-410A Refrigerant Charge (oz.)	120	128	175	213	195	195
CONDENSER FAN / COIL						
Horsepower - RPM	¼ - 850	¼ - 850	¼ - 850	¼ - 1,075	¼ - 1,075	⅓ - 1,075
FLA/LRA	1.5/ 3.0	1.5/ 3.0	1.5/ 3.0	1.4 / 2.9	1.4 / 2.9	2.4/ 5.2
Fan Diameter / # Fan Blades	22 / 3	22 / 3	22 / 3	22 / 3	22 / 3	22 / 3
Face Area (ft ²)	17.2	17.2	17.2	15	15	15
Rows Deep/ Fin per Inch	1 / 22	1 / 22	2 / 16	2 / 16	2 / 16	2 / 18
COMPRESSOR						
Quantity	1	1	1	1	1	1
Type	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll
Stage	Single	Single	Single	Single	Two	Two
ELECTRICAL DATA						
Voltage/ Phase (60 Hz)	208-230/ 1	208-230/ 1	208-230/ 1	208-230/ 1	208-230/ 1	208-230/ 1
Compressor RLA/ LRA	12.8 / 58.3	14.1 / 73	16.7 / 79	17.9 / 112	21.2 / 104	27.1 / 152.9
Indoor Blower FLA	4.3	4.3	4.3	2.9	2.9	7
Total Unit Amps	18.6	19.9	22.5	22.2	25.5	36.6
Min. Circuit Ampacity ¹	21.8	23.4	26.6	26.7	30.8	43.4
Max. Overcurrent Protection ²	30	35	40	40	50	70
SHIPPING WEIGHT (LBS)	366	375	428	472	470	483

¹ Wire size should be determined in accordance with National Electrical Codes. Extensive wire runs will require larger wire sizes.

² May use fuses or HACR-type circuit breakers of the same size as noted.

Note: Always check the S&R plate for electrical data on the unit being installed.

EXPANDED COOLING DATA — APH1524M41**

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	23.5	24.4	26.7	-	23.0	23.8	26.1	-	22.4	23.2	25.5	-	21.9	22.7	24.8	-	20.8	21.5	23.6	-	19.3	20.0	21.9	-
	S/T	0.77	0.64	0.45	-	0.80	0.67	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.88	0.73	0.51	-	0.88	0.74	0.51	-
	ΔT	17	15	11	-	17	15	11	-	17	15	11	-	18	15	12	-	17	15	11	-	16	14	11	-
	kW	1.60	1.63	1.68	-	1.72	1.76	1.81	-	1.82	1.86	1.92	-	1.91	1.96	2.02	-	1.99	2.04	2.10	-	2.06	2.10	2.17	-
	Amps	7.5	7.7	7.9	-	8.0	8.2	8.4	-	8.5	8.7	8.9	-	9.0	9.2	9.4	-	9.5	9.7	9.9	-	9.9	10.1	10.4	-
970	Hi PR	216	232	245	-	242	261	275	-	275	296	313	-	314	337	356	-	353	380	401	-	390	419	443	-
	Lo PR	106	113	124	-	112	120	131	-	117	124	136	-	123	131	143	-	129	137	149	-	133	142	155	-
	MBh	22.8	23.7	25.9	-	22.3	23.1	25.3	-	21.8	22.6	24.7	-	21.2	22.0	24.1	-	20.2	20.9	22.9	-	18.7	19.4	21.2	-
	S/T	0.73	0.61	0.43	-	0.76	0.64	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.84	0.70	0.48	-	0.84	0.70	0.49	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-
860	kW	1.59	1.62	1.67	-	1.71	1.74	1.80	-	1.81	1.85	1.90	-	1.90	1.94	2.00	-	1.98	2.02	2.08	-	2.04	2.09	2.15	-
	Amps	7.5	7.6	7.8	-	8.0	8.1	8.3	-	8.5	8.6	8.9	-	8.9	9.1	9.4	-	9.4	9.6	9.8	-	9.8	10.0	10.3	-
	Hi PR	214	230	243	-	240	258	272	-	273	293	310	-	310	334	353	-	349	376	397	-	386	415	439	-
	Lo PR	105	112	122	-	111	118	129	-	116	123	134	-	122	129	141	-	127	135	148	-	132	140	153	-
	MBh	21.1	21.8	23.9	-	20.6	21.3	23.4	-	20.1	20.8	22.8	-	19.6	20.3	22.3	-	18.6	19.3	21.1	-	17.3	17.9	19.6	-
750	S/T	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.81	0.68	0.47	-
	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
	kW	1.55	1.59	1.63	-	1.67	1.70	1.75	-	1.77	1.80	1.86	-	1.85	1.89	1.95	-	1.93	1.97	2.03	-	1.99	2.04	2.10	-
	Amps	7.3	7.5	7.7	-	7.8	7.9	8.1	-	8.3	8.5	8.7	-	8.7	8.9	9.1	-	9.2	9.4	9.6	-	9.6	9.8	10.1	-
	Hi PR	207	223	235	-	232	250	264	-	264	285	300	-	301	324	342	-	339	365	385	-	374	403	425	-
Lo PR	102	109	119	-	108	115	125	-	112	119	130	-	118	125	137	-	124	131	143	-	128	136	148	-	

970	MBh	23.9	24.6	26.7	28.6	23.4	24.1	26.0	27.9	22.8	23.5	25.4	27.3	22.2	22.9	24.8	26.6	21.1	21.8	23.6	25.3	19.6	20.2	21.8	23.4
	S/T	0.88	0.78	0.59	0.38	0.91	0.81	0.61	0.40	0.93	0.83	0.63	0.41	0.96	0.86	0.65	0.42	1.00	0.89	0.67	0.43	1.00	0.90	0.68	0.44
	ΔT	20	18	15	10	20	19	15	10	20	19	15	10	20	19	15	11	20	18	15	10	19	17	14	10
	kW	1.62	1.65	1.70	1.75	1.73	1.77	1.82	1.88	1.84	1.88	1.94	2.00	1.93	1.97	2.03	2.10	2.01	2.05	2.12	2.19	2.08	2.12	2.19	2.26
	Amps	7.6	7.7	7.9	8.2	8.1	8.2	8.4	8.7	8.6	8.8	9.0	9.3	9.1	9.3	9.5	9.8	9.5	9.7	10.0	10.3	10.0	10.2	10.5	10.8
860	Hi PR	218	235	248	258	245	263	278	290	278	299	316	330	317	341	360	375	356	383	405	422	394	424	447	467
	Lo PR	107	114	125	133	114	121	132	140	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166
	MBh	23.2	23.9	25.9	27.8	22.7	23.4	25.3	27.1	22.1	22.8	24.7	26.5	21.6	22.2	24.1	25.8	20.5	21.1	22.9	24.5	19.0	19.6	21.2	22.7
	S/T	0.84	0.75	0.57	0.36	0.87	0.77	0.59	0.38	0.89	0.79	0.60	0.39	0.92	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.96	0.86	0.65	0.42
	ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	15	10
750	kW	1.60	1.64	1.68	1.74	1.72	1.76	1.81	1.87	1.82	1.86	1.92	1.98	1.92	1.96	2.02	2.08	1.99	2.04	2.10	2.17	2.06	2.10	2.17	2.24
	Amps	7.5	7.7	7.9	8.1	8.0	8.2	8.4	8.6	8.5	8.7	8.9	9.2	9.0	9.2	9.4	9.7	9.5	9.7	9.9	10.2	9.9	10.1	10.4	10.7
	Hi PR	216	232	245	256	242	261	275	287	275	296	313	326	314	338	356	372	353	380	401	418	390	420	443	462
	Lo PR	106	113	124	132	112	120	131	139	117	124	136	145	123	131	143	152	129	137	149	159	133	142	155	165
	MBh	21.4	22.1	23.9	25.6	20.9	21.6	23.3	25.0	20.4	21.0	22.8	24.4	19.9	20.5	22.2	23.8	18.9	19.5	21.1	22.7	17.5	18.1	19.6	21.0
75	S/T	0.81	0.72	0.55	0.35	0.83	0.75	0.56	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.92	0.82	0.62	0.40	0.92	0.83	0.63	0.40
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	22	20	16	11	21	20	16	11	20	18	15	10
	kW	1.57	1.60	1.65	1.70	1.68	1.71	1.77	1.82	1.78	1.82	1.87	1.93	1.87	1.91	1.97	2.03	1.94	1.99	2.05	2.12	2.01	2.05	2.12	2.19
	Amps	7.4	7.5	7.7	7.9	7.8	8.0	8.2	8.4	8.4	8.5	8.7	9.0	8.8	9.0	9.2	9.5	9.3	9.4	9.7	10.0	9.7	9.9	10.2	10.5
	Hi PR	209	225	238	248	235	253	267	278	267	287	304	317	304	327	346	361	342	368	389	406	378	407	430	448
Lo PR	103	110	120	128	109	116	127	135	113	121	132	140	119	127	138	147	125	133	145	154	129	137	150	160	

IDB: Entering Indoor Dry Bulb Temperature
 High & low pressures are measured at the liquid & suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+ evaporator + compressor fan)

EXPANDED COOLING DATA — APH1524M41** (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	24.3	24.9	26.6	28.4	23.8	24.3	26.0	27.7	23.2	23.7	25.3	27.1	22.6	23.1	24.7	26.4	21.5	22.0	23.5	25.1	19.9	20.4	21.8	23.3
	S/T	0.96	0.90	0.73	0.55	1.00	0.93	0.76	0.57	1.00	0.96	0.78	0.58	1.00	1.00	0.80	0.60	1.00	1.00	0.83	0.62	1.00	1.00	0.84	0.63
	ΔT	22	21	18	15	23	21	19	15	22	22	19	15	21	22	19	15	20	21	19	15	19	19	17	14
	kW	1.63	1.66	1.71	1.76	1.75	1.78	1.84	1.90	1.85	1.89	1.95	2.01	1.95	1.99	2.05	2.12	2.03	2.07	2.13	2.20	2.09	2.14	2.21	2.28
	Amps	7.7	7.8	8.0	8.2	8.1	8.3	8.5	8.7	8.7	8.8	9.1	9.3	9.1	9.3	9.6	9.9	9.6	9.8	10.1	10.4	10.1	10.3	10.6	10.9
	Hi PR	220	237	250	261	247	266	281	293	281	302	319	333	320	344	364	379	360	387	409	427	398	428	452	471
	Lo PR	109	116	126	134	115	122	133	142	119	127	138	147	125	133	145	155	131	140	152	162	136	144	158	168
	MBh	23.6	24.1	25.8	27.6	23.1	23.6	25.2	26.9	22.5	23.0	24.6	26.3	22.0	22.5	24.0	25.7	20.9	21.3	22.8	24.4	19.3	19.8	21.1	22.6
	S/T	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.97	0.91	0.74	0.56	1.00	0.94	0.77	0.57	1.00	0.98	0.80	0.60	1.00	0.99	0.80	0.60
	ΔT	23	22	19	15	23	22	20	16	23	22	20	16	24	23	20	16	22	22	19	16	21	21	18	14
kW	1.62	1.65	1.70	1.75	1.73	1.77	1.82	1.88	1.84	1.88	1.94	2.00	1.93	1.97	2.03	2.10	2.01	2.05	2.12	2.19	2.08	2.12	2.19	2.26	
Amps	7.6	7.7	7.9	8.2	8.1	8.2	8.4	8.7	8.6	8.8	9.0	9.3	9.1	9.3	9.5	9.8	9.5	9.7	10.0	10.3	10.0	10.2	10.5	10.8	
Hi PR	218	235	248	258	245	263	278	290	278	299	316	330	317	341	360	375	356	384	405	422	394	424	447	467	
Lo PR	107	114	125	133	114	121	132	140	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166	
MBh	21.8	22.3	23.8	25.5	21.3	21.8	23.3	24.9	20.8	21.3	22.7	24.3	20.3	20.7	22.2	23.7	19.3	19.7	21.0	22.5	17.9	18.2	19.5	20.8	
S/T	0.88	0.83	0.67	0.50	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.55	1.01	0.94	0.77	0.57	1.01	0.95	0.77	0.58	
ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	18	15	
kW	1.58	1.61	1.66	1.71	1.69	1.73	1.78	1.84	1.79	1.83	1.89	1.95	1.88	1.92	1.98	2.05	1.96	2.00	2.07	2.13	2.03	2.07	2.14	2.21	
Amps	7.4	7.6	7.8	8.0	7.9	8.0	8.2	8.5	8.4	8.6	8.8	9.1	8.9	9.0	9.3	9.6	9.3	9.5	9.8	10.1	9.8	10.0	10.2	10.6	
Hi PR	211	228	240	251	237	255	270	281	270	290	307	320	307	331	349	364	346	372	393	410	382	411	434	453	
Lo PR	104	111	121	129	110	117	128	136	114	122	133	142	120	128	140	149	126	134	146	156	130	139	151	161	

85	MBh	24.8	25.2	26.4	28.2	24.2	24.7	25.8	27.6	23.6	24.1	25.2	26.9	23.0	23.5	24.6	26.2	21.9	22.3	23.4	24.9	20.3	20.7	21.6	23.1
	S/T	1.00	0.97	0.88	0.71	1.00	0.96	0.87	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78
	ΔT	23	23	22	19	23	23	22	19	22	23	22	19	22	22	22	19	21	21	22	19	19	20	21	18
	kW	1.64	1.67	1.72	1.78	1.76	1.80	1.85	1.91	1.87	1.91	1.97	2.03	1.96	2.00	2.07	2.13	2.04	2.09	2.15	2.22	2.11	2.16	2.23	2.30
	Amps	7.7	7.8	8.0	8.3	8.2	8.3	8.5	8.8	8.7	8.9	9.1	9.4	9.2	9.4	9.6	9.9	9.7	9.9	10.1	10.5	10.2	10.4	10.6	11.0
	Hi PR	222	239	253	264	249	268	284	296	284	305	322	336	323	348	367	383	364	391	413	431	402	432	456	476
	Lo PR	110	117	127	136	116	123	135	143	120	128	140	149	126	135	147	156	133	141	154	164	137	146	159	170
	MBh	24.0	24.5	25.7	27.4	23.5	23.9	25.1	26.8	22.9	23.4	24.5	26.1	22.4	22.8	23.9	25.5	21.2	21.7	22.7	24.2	19.7	20.1	21.0	22.4
	S/T	0.96	0.93	0.84	0.68	1.00	0.96	0.87	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78
	ΔT	25	24	23	20	25	25	23	20	25	25	23	20	24	24	23	20	23	23	23	20	21	21	22	19
kW	1.63	1.66	1.71	1.76	1.75	1.78	1.84	1.90	1.85	1.89	1.95	2.01	1.95	1.99	2.05	2.12	2.03	2.07	2.13	2.20	2.09	2.14	2.21	2.28	
Amps	7.7	7.8	8.0	8.2	8.1	8.3	8.5	8.7	8.7	8.8	9.1	9.3	9.1	9.3	9.6	9.9	9.6	9.8	10.1	10.4	10.1	10.3	10.6	10.9	
Hi PR	220	237	250	261	247	266	281	293	281	302	319	333	320	344	364	379	360	387	409	427	398	428	452	471	
Lo PR	109	116	126	134	115	122	133	142	119	127	138	147	125	133	145	155	131	140	152	162	136	144	158	168	
MBh	22.2	22.6	23.7	25.3	21.7	22.1	23.1	24.7	21.2	21.6	22.6	24.1	20.6	21.0	22.0	23.5	19.6	20.0	20.9	22.3	18.2	18.5	19.4	20.7	
S/T	0.93	0.89	0.81	0.65	0.96	0.93	0.84	0.68	0.98	0.95	0.86	0.70	1.00	0.98	0.88	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.93	0.75	
ΔT	25	25	23	20	26	25	24	21	26	25	24	21	25	25	24	21	24	25	24	20	22	23	22	19	
kW	1.59	1.62	1.67	1.72	1.71	1.74	1.79	1.85	1.81	1.85	1.90	1.96	1.90	1.94	2.00	2.07	1.98	2.02	2.08	2.15	2.04	2.09	2.15	2.22	
Amps	7.5	7.6	7.8	8.0	8.0	8.1	8.3	8.5	8.5	8.6	8.9	9.1	8.9	9.1	9.4	9.6	9.4	9.6	9.8	10.1	9.8	10.0	10.3	10.6	
Hi PR	214	230	243	253	240	258	272	284	273	293	310	323	310	334	353	368	349	376	397	414	386	415	438	457	
Lo PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163	

IDB: Entering Indoor Dry Bulb Temperature
 High & low pressures are measured at the liquid & suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 Amps = outdoor unit amps (comp. + evaporator + compressor fan)
 kW = Total system power

EXPANDED COOLING DATA — APH1530M41**

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																	
		65°F				75°F				85°F				95°F				105°F				115°F									
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71						
70	1125	MBh	28.4	29.5	32.3	-	27.1	28.1	30.8	-	26.4	27.4	30.0	-	25.1	26.0	28.5	-	23.3	24.1	26.4	-	25.1	26.0	28.5	-	23.3	24.1	26.4	-	
		S/T	0.77	0.64	0.45	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.88	0.73	0.51	-	0.88	0.74	0.51	-	0.88	0.73	0.51	-	0.88	0.74	0.51	-	
		Δ T	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-	18	16	12	-	17	15	11	-	
	1000	KW	1.88	1.92	1.99	-	2.03	2.07	2.14	-	2.16	2.21	2.28	-	2.27	2.32	2.40	-	2.37	2.42	2.50	-	2.37	2.42	2.50	-	2.45	2.51	2.59	-	
		Amps	8.1	8.2	8.5	-	8.6	8.8	9.1	-	9.3	9.5	9.8	-	9.9	10.1	10.4	-	10.5	10.7	11.0	-	10.5	10.7	11.0	-	11.0	11.3	11.6	-	
		HI PR	229	246	260	-	257	276	292	-	292	314	332	-	333	358	378	-	374	403	425	-	374	403	425	-	414	445	470	-	
	875	LO PR	109	116	127	-	116	123	134	-	120	128	139	-	126	134	146	-	132	141	154	-	132	141	154	-	137	145	159	-	
		MBh	27.6	28.6	31.3	-	26.9	27.9	30.6	-	26.3	27.3	29.9	-	25.7	26.6	29.1	-	24.4	25.3	27.7	-	24.4	25.3	27.7	-	22.6	23.4	25.6	-	
		S/T	0.73	0.61	0.43	-	0.76	0.64	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.84	0.70	0.48	-	0.84	0.70	0.48	-	0.84	0.70	0.49	-	
	75	1125	Δ T	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	18	15	12	-
			KW	1.90	1.94	2.00	2.07	2.05	2.09	2.16	2.23	2.18	2.22	2.30	2.37	2.29	2.34	2.42	2.50	2.39	2.44	2.52	2.61	2.39	2.44	2.52	2.61	2.47	2.53	2.61	2.70
			Amps	8.1	8.3	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.6	9.9	10.2	10.0	10.2	10.5	10.9	10.6	10.8	11.1	11.5	10.6	10.8	11.1	11.5	11.1	11.4	11.7	12.2
1000		HI PR	231	249	263	274	259	279	295	308	295	318	335	350	336	362	382	398	378	407	430	448	378	407	430	448	418	450	475	495	
		LO PR	110	118	128	137	117	124	136	144	121	129	141	150	127	136	148	158	134	142	155	165	134	142	155	165	138	147	160	171	
		MBh	28.1	28.9	31.3	33.6	27.4	28.2	30.5	32.8	26.8	27.5	29.8	32.0	26.1	26.9	29.1	31.2	24.8	25.5	27.6	29.7	24.8	25.5	27.6	29.7	23.0	23.6	25.6	27.5	
875		S/T	0.84	0.75	0.57	0.36	0.87	0.77	0.59	0.38	0.89	0.79	0.60	0.39	0.92	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.95	0.85	0.64	0.41	0.96	0.86	0.65	0.42	
		Δ T	22	20	16	11	22	20	16	11	22	20	16	11	22	20	17	11	22	20	16	11	22	20	16	11	20	19	15	11	
		KW	1.88	1.92	1.99	2.05	2.03	2.07	2.14	2.21	2.16	2.21	2.28	2.35	2.27	2.32	2.40	2.48	2.37	2.42	2.50	2.59	2.37	2.42	2.50	2.59	2.45	2.51	2.59	2.68	
75		Amps	8.1	8.2	8.5	8.7	8.6	8.8	9.1	9.4	9.3	9.5	9.8	10.1	9.9	10.1	10.4	10.8	10.5	10.7	11.0	11.4	10.5	10.7	11.0	11.4	11.0	11.3	11.6	12.0	
		HI PR	229	246	260	271	257	276	292	305	292	314	332	346	333	358	378	394	374	403	425	444	374	403	425	444	414	445	470	490	
		LO PR	109	116	127	135	116	123	134	143	120	128	139	149	126	134	147	156	132	141	154	164	132	141	154	164	137	145	159	169	
75	MBh	25.9	26.7	28.9	31.0	25.3	26.0	28.2	30.3	24.7	25.4	27.5	29.5	24.1	24.8	26.8	28.8	22.9	23.6	25.5	27.4	22.9	23.6	25.5	27.4	21.2	21.8	23.6	25.4		
	S/T	0.81	0.72	0.55	0.35	0.83	0.75	0.56	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.92	0.82	0.62	0.40	0.92	0.82	0.62	0.40	0.92	0.83	0.63	0.40		
	Δ T	22	20	17	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	11	22	20	17	11	21	19	16	11		
75	KW	1.84	1.88	1.94	2.00	1.98	2.02	2.09	2.16	2.11	2.15	2.22	2.30	2.22	2.26	2.34	2.42	2.31	2.36	2.44	2.52	2.31	2.36	2.44	2.52	2.39	2.44	2.53	2.61		
	Amps	7.9	8.0	8.3	8.5	8.4	8.6	8.9	9.2	9.1	9.3	9.5	9.9	9.6	9.8	10.1	10.5	10.2	10.4	10.7	11.1	10.2	10.4	10.7	11.1	10.8	11.0	11.3	11.7		
	HI PR	222	239	252	263	249	268	283	295	283	305	322	336	323	347	367	383	363	391	413	430	363	391	413	430	401	432	456	476		
75	LO PR	106	113	123	131	112	119	130	139	116	124	135	144	122	130	142	151	128	136	149	159	128	136	149	159	133	141	154	164		

IDB: Entering Indoor Dry Bulb Temperature
 High & low pressures are measured at the liquid & suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp. + evaporator + compressor fan)

EXPANDED COOLING DATA — APH1530M41** (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																	
		65°F					75°F					85°F					95°F					105°F					115°F																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																								
		59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																				
80	1125	MBh	29.4	30.1	32.1	34.3	28.7	29.4	31.4	33.5	28.0	28.7	30.6	32.7	27.4	28.0	29.9	31.9	26.0	26.6	28.4	30.3	24.1	24.6	26.3	28.1	S/T	0.96	0.90	0.73	0.55	1.00	0.93	0.76	0.57	1.00	0.96	0.78	0.58	1.00	1.00	0.80	0.60	1.00	1.00	0.83	0.62	1.00	1.00	0.84	0.63	Δ T	23	22	19	15	23	22	19	16	22	21	18	16	22	21	18	15	20	20	19	15	20	20	18	14	KW	1.91	1.96	2.02	2.08	2.06	2.11	2.18	2.25	2.19	2.24	2.32	2.39	2.31	2.36	2.44	2.52	2.41	2.46	2.55	2.63	2.49	2.55	2.64	2.73	Amps	8.2	8.4	8.6	8.9	8.8	9.0	9.2	9.5	9.5	9.7	10.0	10.3	10.0	10.3	10.6	11.0	10.6	10.9	11.2	11.6	11.2	11.5	11.8	12.3	HI PR	234	251	265	277	262	282	298	311	298	321	339	353	340	365	386	402	382	411	434	453	422	454	480	500	LO PR	112	119	130	138	118	125	137	146	123	130	142	152	129	137	149	159	135	143	157	167	140	148	162	173	MBh	28.6	29.2	31.2	33.3	27.9	28.5	30.5	32.6	27.2	27.8	29.7	31.8	26.6	27.1	29.0	31.0	25.2	25.8	27.6	29.5	23.4	23.9	25.5	27.3	S/T	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.97	0.91	0.74	0.56	1.00	0.94	0.77	0.57	1.00	0.98	0.80	0.60	1.00	1.00	0.99	0.80	0.60	Δ T	24	23	20	16	24	23	20	16	24	23	20	16	24	24	20	16	23	23	20	16	21	21	22	19	15	KW	1.90	1.94	2.00	2.07	2.05	2.09	2.16	2.23	2.18	2.22	2.30	2.37	2.29	2.34	2.42	2.50	2.39	2.44	2.52	2.61	2.47	2.53	2.61	2.70	Amps	8.1	8.3	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.6	9.9	10.2	10.0	10.2	10.5	10.9	10.6	10.8	11.1	11.5	11.1	11.4	11.7	12.2	HI PR	231	249	263	274	260	279	295	308	295	318	335	350	336	362	382	398	378	407	430	448	418	450	475	495	LO PR	110	118	128	137	117	124	136	144	121	129	141	150	127	136	148	158	134	142	155	165	138	147	160	171	MBh	26.4	26.9	28.8	30.8	25.7	26.3	28.1	30.0	25.1	25.7	27.4	29.3	24.5	25.1	26.8	28.6	23.3	23.8	25.4	27.2	21.6	22.0	23.6	25.2	S/T	0.88	0.83	0.67	0.50	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.55	1.01	0.94	0.77	0.57	1.01	1.01	0.95	0.77	0.58	Δ T	24	23	20	16	25	24	21	16	25	24	21	17	25	24	21	17	25	24	21	16	23	22	19	15	15	KW	1.85	1.89	1.95	2.02	2.00	2.04	2.11	2.17	2.12	2.17	2.24	2.31	2.23	2.28	2.36	2.44	2.33	2.38	2.46	2.54	2.41	2.46	2.55	2.63	Amps	7.9	8.1	8.3	8.6	8.5	8.7	8.9	9.2	9.1	9.3	9.6	10.0	9.7	9.9	10.2	10.6	10.3	10.5	10.8	11.2	10.8	11.1	11.4	11.8	HI PR	224	241	255	266	252	271	286	298	286	308	325	339	326	351	371	386	367	395	417	435	405	436	461	480	LO PR	107	114	124	133	113	120	132	140	118	125	137	146	124	132	144	153	130	138	150	160	134	143	156	166	
	85	1125	MBh	29.9	30.5	31.9	34.1	29.2	29.8	31.2	33.3	28.5	29.1	30.5	32.5	27.8	28.4	29.7	31.7	26.4	27.0	28.2	30.1	24.5	25.0	26.2	27.9	S/T	1.00	0.97	0.88	0.71	1.00	0.96	0.87	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78	0.82	Δ T	24	24	24	20	24	24	23	20	23	24	23	20	22	23	23	20	22	22	23	20	20	20	20	21	19	KW	1.93	1.97	2.03	2.10	2.08	2.13	2.19	2.27	2.21	2.26	2.34	2.41	2.33	2.38	2.46	2.54	2.43	2.48	2.57	2.65	2.52	2.57	2.66	2.75	Amps	8.2	8.4	8.7	9.0	8.8	9.0	9.3	9.6	9.5	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.7	11.0	11.3	11.7	11.3	11.6	11.9	12.4	HI PR	236	254	268	280	265	285	301	314	301	324	342	357	343	369	390	406	386	415	438	457	426	459	484	505	LO PR	113	120	131	139	119	127	138	147	124	132	144	153	130	138	151	161	136	145	158	169	141	150	164	174	MBh	29.1	29.6	31.0	33.1	28.4	28.9	30.3	32.3	27.7	28.2	29.6	31.6	27.0	27.6	28.9	30.8	25.7	26.2	27.4	29.2	23.8	24.2	25.4	27.1	S/T	0.96	0.93	0.84	0.68	1.00	0.96	0.87	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78	Δ T	26	25	24	21	26	26	24	21	25	26	24	21	25	25	24	21	24	24	24	21	22	22	22	19	19	KW	1.91	1.96	2.02	2.08	2.06	2.11	2.18	2.25	2.19	2.24	2.32	2.39	2.31	2.36	2.44	2.52	2.41	2.46	2.55	2.63	2.49	2.55	2.64	2.73	Amps	8.2	8.4	8.6	8.9	8.8	9.0	9.2	9.5	9.5	9.7	10.0	10.3	10.0	10.3	10.6	11.0	10.6	10.9	11.2	11.6	11.2	11.5	11.8	12.3	HI PR	234	251	265	277	262	282	298	311	298	321	339	353	340	365	386	402	382	411	434	453	422	454	480	500	LO PR	112	119	130	138	118	125	137	146	123	130	142	152	129	137	149	159	135	143	157	167	140	148	162	173	MBh	26.8	27.3	28.6	30.5	26.2	26.7	28.0	29.8	25.6	26.1	27.3	29.1	24.9	25.4	26.6	28.4	23.7	24.2	25.3	27.0	22.0	22.4	23.4	25.0	S/T	0.93	0.89	0.81	0.65	0.96	0.93	0.84	0.68	0.98	0.95	0.86	0.70	1.00	0.98	0.88	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.93	0.75	Δ T	26	26	24	21	26	26	25	21	26	26	25	21	26	26	25	21	25	25	24	21	23	24	23	20	20	KW	1.87	1.91	1.97	2.03	2.01	2.06	2.12	2.19	2.14	2.19	2.26	2.33	2.25	2.30	2.38	2.46	2.35	2.40	2.48	2.56	2.43	2.49	2.57	2.66	Amps	8.0	8.2	8.4	8.7	8.6	8.7	9.0	9.3	9.2	9.4	9.7	10.0	9.8	10.0	10.3	10.7	10.4	10.6	10.9	11.3	10.9	11.2	11.5	11.9	HI PR	227	244	257	269	254	274	289	301	289	311	329	343	329	354	374	390	371	399	421	439	409	441	465	485	LO PR	108	115	126	134	114	122	133	141	119	126	138	147	125	133	145	154	131	139	152	162	135	144	157	167

IDB: Entering Indoor Dry Bulb Temperature
 High & low pressures are measured at the liquid & suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 Amps = outdoor unit amps (comp.+ evaporator + compressor fan)
 kW = Total system power

EXPANDED COOLING DATA — APH1536M41**

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																								
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	1350	MBh	34.6	35.9	39.3	-	33.8	35.1	38.4	-	33.0	34.2	37.5	-	32.2	33.4	36.6	-	30.6	31.7	34.8	-	28.4	29.4	32.2	-
		S/T	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.81	0.68	0.47	-	0.84	0.70	0.48	-	0.87	0.73	0.50	-	0.88	0.73	0.51	-
		ΔT	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-
		kW	2.26	2.31	2.38	-	2.44	2.49	2.57	-	2.59	2.65	2.73	-	2.72	2.78	2.88	-	2.84	2.90	3.00	-	2.94	3.00	3.10	-
		Amps	10.8	11.0	11.3	-	11.5	11.7	12.0	-	12.3	12.5	12.9	-	13.0	13.2	13.6	-	13.7	13.9	14.3	-	14.3	14.6	15.0	-
	Hi PR	228	245	259	-	256	275	290	-	291	313	330	-	331	356	376	-	372	401	423	-	411	443	468	-	
	Lo PR	107	114	125	-	114	121	132	-	118	126	137	-	124	132	144	-	130	138	151	-	134	143	156	-	
	MBh	33.6	34.9	38.2	-	32.9	34.1	37.3	-	32.1	33.2	36.4	-	31.3	32.4	35.5	-	29.7	30.8	33.8	-	27.5	28.5	31.3	-	
	S/T	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.84	0.70	0.48	-	
	ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	17	13	-	19	16	12	-	18	15	12	-	
1050	kW	2.25	2.29	2.36	-	2.42	2.47	2.55	-	2.57	2.62	2.71	-	2.70	2.76	2.85	-	2.82	2.88	2.97	-	2.91	2.98	3.08	-	
	Amps	10.7	10.9	11.2	-	11.4	11.6	11.9	-	12.2	12.4	12.8	-	12.9	13.1	13.5	-	13.5	13.8	14.2	-	14.2	14.5	14.9	-	
	Hi PR	225	243	256	-	253	272	287	-	288	310	327	-	328	353	372	-	369	397	419	-	407	438	463	-	
	Lo PR	106	113	124	-	112	120	131	-	117	124	136	-	123	131	142	-	129	137	149	-	133	141	154	-	
	MBh	31.1	32.2	35.3	-	30.3	31.4	34.4	-	29.6	30.7	33.6	-	28.9	29.9	32.8	-	27.4	28.4	31.2	-	25.4	26.3	28.9	-	
S/T	0.70	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.62	0.43	-	0.77	0.64	0.45	-	0.80	0.67	0.46	-	0.81	0.67	0.47	-		
ΔT	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	16	12	-		

75	1350	MBh	35.2	36.3	39.3	42.1	34.4	35.4	38.4	41.2	33.6	34.6	37.4	40.2	32.8	33.7	36.5	39.2	31.1	32.1	34.7	37.2	28.8	29.7	32.1	34.5	
		S/T	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.92	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.99	0.88	0.67	0.43	1.00	0.89	0.67	0.43	
		ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	20	16	11	21	21	19	16	11	20	18	15	10
		kW	2.28	2.33	2.40	2.48	2.46	2.51	2.59	2.67	2.61	2.67	2.75	2.85	2.75	2.81	2.90	3.00	2.86	2.93	3.02	3.13	2.96	3.03	3.13	3.24	
		Amps	10.9	11.1	11.4	11.7	11.6	11.8	12.1	12.5	12.4	12.6	13.0	13.4	13.1	13.3	13.7	14.1	13.8	14.0	14.4	14.9	14.4	14.7	15.2	15.6	
	Hi PR	230	248	261	273	258	278	293	306	294	316	334	348	334	360	380	396	376	405	427	446	416	447	472	493		
	Lo PR	109	115	126	134	115	122	133	142	119	127	138	147	125	133	145	155	131	140	152	162	136	144	158	168		
	MBh	34.2	35.2	38.1	40.9	33.4	34.4	37.2	40.0	32.6	33.6	36.4	39.0	31.8	32.8	35.5	38.1	30.2	31.1	33.7	36.2	28.0	28.8	31.2	33.5		
	S/T	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.91	0.81	0.61	0.40	0.94	0.84	0.64	0.41	0.95	0.85	0.64	0.41		
	ΔT	22	20	16	11	22	20	17	11	22	20	17	11	22	20	17	12	22	22	20	16	11	20	19	15	11	
1050	kW	2.26	2.31	2.38	2.46	2.44	2.49	2.57	2.65	2.59	2.65	2.73	2.82	2.72	2.78	2.88	2.97	2.84	2.90	3.00	3.10	2.94	3.00	3.10	3.21		
	Amps	10.8	11.0	11.3	11.6	11.5	11.7	12.0	12.4	12.3	12.5	12.9	13.3	13.0	13.2	13.6	14.0	13.7	13.9	14.3	14.8	14.3	14.6	15.0	15.5		
	Hi PR	228	245	259	270	256	275	290	303	291	313	330	345	331	356	376	392	372	401	423	441	412	443	468	488		
	Lo PR	107	114	125	133	114	121	132	140	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166		
	MBh	31.6	32.5	35.2	37.8	30.8	31.8	34.4	36.9	30.1	31.0	33.6	36.0	29.4	30.2	32.7	35.1	27.9	28.7	31.1	33.4	25.8	26.6	28.8	30.9		
S/T	0.80	0.71	0.54	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.91	0.81	0.62	0.40	0.92	0.82	0.62	0.40			
ΔT	22	20	17	11	22	21	17	12	22	21	17	12	23	21	17	12	22	22	20	17	12	21	19	16	11		
1050	kW	2.21	2.26	2.33	2.40	2.38	2.43	2.51	2.59	2.53	2.58	2.66	2.75	2.66	2.72	2.80	2.90	2.77	2.83	2.92	3.02	2.86	2.93	3.02	3.13		
	Amps	10.6	10.8	11.1	11.4	11.2	11.5	11.8	12.1	12.0	12.2	12.6	13.0	12.7	12.9	13.3	13.7	13.3	13.6	14.0	14.4	14.0	14.3	14.7	15.2		
	Hi PR	221	238	251	262	248	267	282	294	282	303	320	334	321	346	365	381	361	389	411	428	399	430	454	473		
	Lo PR	104	111	121	129	110	117	128	136	114	122	133	142	120	128	140	149	126	134	146	156	130	139	151	161		
	MBh	31.1	32.2	35.3	38.1	30.3	31.4	34.4	37.2	32.6	33.6	36.4	39.0	31.8	32.8	35.5	38.1	30.2	31.1	33.7	36.2	28.0	28.8	31.2	33.5		

IDB: Entering Indoor Dry Bulb Temperature
 High & low pressures are measured at the liquid & suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp. + evaporator + compressor fan)

EXPANDED COOLING DATA — APH1549M41** — LOW STAGE

IDB	OUTDOOR AMBIENT TEMPERATURE																																																												
	65°F										75°F										85°F										95°F										105°F										115°F										
	ENTERING INDOOR WET BULB TEMPERATURE										ENTERING INDOOR WET BULB TEMPERATURE										ENTERING INDOOR WET BULB TEMPERATURE										ENTERING INDOOR WET BULB TEMPERATURE										ENTERING INDOOR WET BULB TEMPERATURE										ENTERING INDOOR WET BULB TEMPERATURE										
	59	63	67	71	75	79	83	87	91	59	63	67	71	75	79	83	87	91	59	63	67	71	75	79	83	87	91	59	63	67	71	75	79	83	87	91	59	63	67	71	75	79	83	87	91	59	63	67	71	75	79	83	87	91							
1350	MBh	33.4	34.6	37.9	-	32.6	33.8	37.0	-	31.8	33.0	36.1	-	31.0	32.2	35.2	-	29.5	30.6	33.5	-	27.3	28.3	31.0	-	29.5	30.6	33.5	-	27.3	28.3	31.0	-	29.5	30.6	33.5	-	27.3	28.3	31.0	-	29.5	30.6	33.5	-	27.3	28.3	31.0	-	29.5	30.6	33.5	-	27.3	28.3	31.0	-				
	S/T	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.81	0.68	0.47	-	0.84	0.70	0.48	-	0.87	0.73	0.50	-	0.88	0.73	0.51	-	0.87	0.73	0.50	-	0.88	0.73	0.51	-	0.87	0.73	0.50	-	0.88	0.73	0.51	-	0.87	0.73	0.50	-	0.88	0.73	0.51	-	0.87	0.73	0.50	-	0.88	0.73	0.51	-				
	ΔT	17	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	17	15	11	-	16	14	11	-	17	15	11	-	16	14	11	-	17	15	11	-	16	14	11	-	17	15	11	-	16	14	11	-	17	15	11	-	16	14	11	-
	kW	2.16	2.21	2.27	-	2.32	2.37	2.44	-	2.32	2.37	2.44	-	2.46	2.51	2.59	-	2.58	2.64	2.72	-	2.69	2.74	2.83	-	2.78	2.84	2.93	-	2.69	2.74	2.83	-	2.78	2.84	2.93	-	2.69	2.74	2.83	-	2.78	2.84	2.93	-	2.69	2.74	2.83	-	2.78	2.84	2.93	-								
1200	MBh	32.4	33.6	36.8	-	31.6	32.8	35.9	-	30.9	32.0	35.1	-	30.1	31.2	34.2	-	28.6	29.7	32.5	-	26.5	27.5	30.1	-	28.6	29.7	32.5	-	26.5	27.5	30.1	-	28.6	29.7	32.5	-	26.5	27.5	30.1	-	28.6	29.7	32.5	-	26.5	27.5	30.1	-												
	S/T	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.84	0.70	0.48	-	0.83	0.69	0.48	-	0.84	0.70	0.48	-	0.83	0.69	0.48	-	0.84	0.70	0.48	-	0.83	0.69	0.48	-	0.84	0.70	0.48	-												
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-	18	16	12	-	17	15	11	-	18	16	12	-	17	15	11	-	18	16	12	-	17	15	11	-								
	kW	2.15	2.19	2.26	-	2.30	2.35	2.42	-	2.44	2.49	2.57	-	2.56	2.62	2.70	-	2.56	2.62	2.70	-	2.67	2.72	2.81	-	2.75	2.81	2.90	-	2.67	2.72	2.81	-	2.75	2.81	2.90	-	2.67	2.72	2.81	-	2.75	2.81	2.90	-																
1050	MBh	29.9	31.0	34.0	-	29.2	30.3	33.2	-	28.5	29.5	32.4	-	27.8	28.8	31.6	-	26.4	27.4	30.0	-	24.5	25.4	27.8	-	26.4	27.4	30.0	-	24.5	25.4	27.8	-	26.4	27.4	30.0	-	24.5	25.4	27.8	-	26.4	27.4	30.0	-	24.5	25.4	27.8	-												
	S/T	0.70	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.62	0.43	-	0.77	0.64	0.45	-	0.80	0.67	0.46	-	0.81	0.67	0.47	-	0.80	0.67	0.46	-	0.81	0.67	0.47	-	0.80	0.67	0.46	-	0.81	0.67	0.47	-																				
	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-	18	16	12	-	17	15	11	-	18	16	12	-	17	15	11	-																
	kW	2.10	2.14	2.20	-	2.25	2.30	2.37	-	2.38	2.43	2.51	-	2.50	2.55	2.63	-	2.50	2.55	2.63	-	2.60	2.66	2.74	-	2.69	2.74	2.83	-	2.60	2.66	2.74	-	2.69	2.74	2.83	-																								

IDB: Entering Indoor Dry Bulb Temperature
 High & low pressures are measured at the liquid & suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 Amps = outdoor unit amps (comp.+ evaporator + compressor fan)
 kW = Total system power

EXPANDED COOLING DATA — APH1560M41** - HIGH STAGE (CONT.)

Table with columns for IDB, Airflow, Outdoor Ambient Temperature (65°F to 115°F), and Entering Indoor Wet Bulb Temperature (75°F to 95°F). Rows are categorized by tonnage (70, 1575, 2025) and indoor dry bulb temperature (75, 1800). Includes performance metrics like MBh, S/T, ΔT, kW, Amps, and Hi/Lo PR.

IDB: Entering Indoor Dry Bulb Temperature. High & low pressures are measured at the liquid & suction service valves. Shaded area reflects AHRI (TVA) conditions. Amps = outdoor unit amps (comp. + evaporator + compressor fan). kW = Total system power.

AIRFLOW DATA

APH1524M41

COOLING SPEED	ADJUST TAP	CFM*	HEATING SPEED	ADJUST TAP	CFM*
D	Minus	630	D	Minus	630
	Normal	700	D	Normal	700
	Plus	770	D	Plus	770
C	Minus	743	C	Minus	743
	Normal	825	C	Normal	825
	Plus	908	C	Plus	908
B	Minus	855	B	Minus	855
	Normal	950	B	Normal	950
	Plus	1,045	B	Plus	1,045
A	Minus	945	A	Minus	945
	Normal	1,050	A	Normal	1,050
	Plus	1,155	A	Plus	1,155

* @ 0.1 - 0.5 ESP

APH1536M41

COOLING SPEED	ADJUST TAP	CFM*	HEATING SPEED	ADJUST TAP	CFM*
D	Minus	720	D	Minus	720
	Normal	800	D	Normal	800
	Plus	880	D	Plus	880
C	Minus	900	C	Minus	900
	Normal	1,000	C	Normal	1,000
	Plus	1,100	C	Plus	1,100
B	Minus	990	B	Minus	990
	Normal	1,100	B	Normal	1,100
	Plus	1,210	B	Plus	1,210
A	Minus	1,125	A	Minus	1,125
	Normal	1,250	A	Normal	1,250
	Plus	1,375	A	Plus	1,375

* @ 0.1 - 0.5 ESP

APH1530M41

COOLING SPEED	ADJUST TAP	CFM*	HEATING SPEED	ADJUST TAP	CFM*
D	Minus	720	D	Minus	720
	Normal	800	D	Normal	800
	Plus	880	D	Plus	880
C	Minus	900	C	Minus	900
	Normal	1,000	C	Normal	1,000
	Plus	1,100	C	Plus	1,100
B	Minus	990	B	Minus	990
	Normal	1,100	B	Normal	1,100
	Plus	1,210	B	Plus	1,210
A	Minus	1,125	A	Minus	1,125
	Normal	1,250	A	Normal	1,250
	Plus	1,375	A	Plus	1,375

* @ 0.1 - 0.5 ESP

AIRFLOW DATA (CONT.)

APH1543M41

COOLING SPEED	ADJUST TAP	CFM*	HEATING SPEED	ADJUST TAP	CFM*
D	Minus	1,103	D	Minus	1,103
	Normal	1,225	D	Normal	1,225
	Plus	1,348	D	Plus	1,348
C	Minus	1,260	C	Minus**	1,260
	Normal	1,400	C	Normal	1,400
	Plus	1,540	C	Plus	1,540
B	Minus	1,530	B	Minus	1,530
	Normal	1,700	B	Normal	1,700
	Plus	1,870	B	Plus	1,870
A	Minus	1,620	A	Minus	1,620
	Normal	1,800	A	Normal	1,800
	Plus	1,980	A	Plus***	1,980

* @ 0.1 - 0.5 ESP

** Denotes factory setting for APH1543M41

APH1549M41

COOLING SPEED	ADJUST TAP	CFM*	HEATING SPEED	ADJUST TAP	CFM*
D	Minus	1,103	D	Minus	1,103
	Normal	1,225	D	Normal	1,225
	Plus	1,348	D	Plus	1,348
C	Minus	1,260	C	Minus	1,260
	Normal	1,400	C	Normal	1,400
	Plus	1,540	C	Plus	1,540
B	Minus	1,530	B	Minus	1,530
	Normal	1,700	B	Normal	1,700
	Plus	1,870	B	Plus	1,870
A	Minus***	1,620	A	Minus***	1,620
	Normal	1,800	A	Normal	1,800
	Plus	1,980	A	Plus	1,980

* @ 0.1 - 0.5 ESP

*** Denotes factory setting for APH1549M41

APH1560M41

COOLING SPEED	ADJUST TAP	CFM*	HEATING SPEED	ADJUST TAP	CFM*
D	Minus	1,260	D	Minus	1,260
	Normal	1,400	D	Normal	1,400
	Plus	1,540	D	Plus	1,540
C	Minus	1,440	C	Minus	1,440
	Normal	1,600	C	Normal	1,600
	Plus	1,760	C	Plus	1,760
B	Minus	1,620	B	Minus	1,620
	Normal	1,800	B	Normal	1,800
	Plus**	1,980	B	Plus**	1,980
A	Minus	1,800	A	Minus	1,800
	Normal	2,000	A	Normal	2,000
	Plus	2,200	A	Plus	2,200

* @ 0.1 - 0.5 ESP

** Denotes factory setting for APH1560M41

EXPANDED HEATING DATA

APH1524M41*

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	29.4	27.8	26.2	24.5	23.4	22.7	21.1	19.4	15.6	14.4	13.2	12.5	12.0	10.8	9.6	8.4	7.1	5.8
ΔT	31.7	30.0	28.2	26.4	25.2	24.4	22.7	20.9	16.8	15.5	14.3	13.5	13.0	11.6	10.3	9.0	7.7	6.3
kW	2.08	2.04	2.00	1.96	1.94	1.92	1.88	1.84	1.81	1.77	1.73	1.71	1.69	1.65	1.61	1.57	1.53	1.49
Amps	10.8	10.2	9.6	9.2	8.9	8.8	8.4	8.0	7.8	7.5	7.2	7.1	7.0	6.8	6.4	6.2	5.8	5.4
COP	4.14	4.00	3.84	3.66	3.54	3.46	3.28	3.09	2.52	2.38	2.24	2.15	2.09	1.92	1.74	1.56	1.36	1.15
EER	14.2	13.7	13.1	12.5	12.1	11.8	11.2	10.6	8.6	8.1	7.7	7.3	7.1	6.6	6.0	5.3	4.7	3.9
Hi PR	388	372	358	342	334	328	315	302	290	277	266	259	255	245	235	226	218	210
Lo PR	145	134	126	115	109	105	96	86	77	69	61	57	55	46	40	34	29	23

APH1530M41*

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	34.4	32.6	30.7	28.7	27.4	26.6	24.7	22.7	18.8	17.4	16.0	15.1	14.5	13.0	11.6	10.1	8.6	7.1
ΔT	31.9	30.2	28.4	26.6	25.4	24.6	22.8	21.1	17.4	16.1	14.8	14.0	13.5	12.1	10.7	9.3	8.0	6.5
kW	2.31	2.27	2.22	2.18	2.15	2.13	2.09	2.04	2.08	2.03	1.98	1.95	1.93	1.89	1.84	1.79	1.74	1.69
Amps	11.4	10.7	10.0	9.5	9.2	9.0	8.5	8.2	7.8	7.5	7.2	7.1	7.0	6.7	6.3	6.0	5.6	5.1
COP	4.36	4.21	4.04	3.86	3.73	3.65	3.46	3.26	2.65	2.51	2.36	2.26	2.20	2.03	1.84	1.65	1.45	1.22
EER	14.9	14.4	13.8	13.2	12.8	12.5	11.8	11.2	9.1	8.6	8.1	7.7	7.5	6.9	6.3	5.6	4.9	4.2
Hi PR	383	368	353	338	330	324	311	299	286	273	262	256	251	242	233	223	215	208
Lo PR	138	128	120	110	104	100	92	82	74	66	58	54	52	44	38	32	28	22

APH1536M41*

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	44.6	42.2	39.8	37.2	35.5	34.4	32.0	29.5	23.2	21.4	19.7	18.6	17.9	16.1	14.3	12.4	10.6	8.7
ΔT	34.4	32.6	30.7	28.7	27.4	26.5	24.7	22.7	17.9	16.5	15.2	14.4	13.8	12.4	11.0	9.6	8.2	6.7
kW	3.24	3.18	3.11	3.05	3.01	2.98	2.92	2.85	2.43	2.37	2.32	2.29	2.26	2.21	2.15	2.10	2.04	1.99
Amps	17.4	16.2	15.3	14.5	14.1	13.9	13.2	12.6	12.2	11.7	11.3	11.1	10.9	10.5	9.9	9.5	8.9	8.3
COP	4.03	3.89	3.74	3.57	3.45	3.38	3.21	3.02	2.80	2.64	2.49	2.38	2.32	2.13	1.94	1.73	1.52	1.28
EER	13.8	13.3	12.8	12.2	11.8	11.5	11.0	10.3	9.6	9.0	8.5	8.1	7.9	7.3	6.6	5.9	5.2	4.4
Hi PR	454	435	418	400	390	383	368	353	338	323	310	303	297	286	275	264	254	245
Lo PR	137	127	119	109	103	99	91	81	73	65	57	53	52	44	38	32	28	22

APH1543M41*

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	33.3	31.5	29.7	27.7	26.5	25.7	23.9	22.0	16.2	15.0	13.8	13.0	12.5	11.2	10.0	8.7	7.4	6.1
ΔT	24.5	23.2	21.9	20.4	19.5	18.9	17.6	16.2	11.9	11.0	10.1	9.6	9.2	8.3	7.3	6.4	5.5	4.5
kW	2.46	2.42	2.37	2.33	2.30	2.28	2.23	2.19	2.17	2.12	2.08	2.05	2.03	1.98	1.94	1.89	1.84	1.80
Amps	12.1	11.3	10.7	10.2	9.9	9.8	9.3	9.0	8.7	8.4	8.1	8.0	7.9	7.6	7.2	6.9	6.6	6.1
COP	3.96	3.82	3.66	3.49	3.37	3.30	3.12	2.94	2.18	2.06	1.94	1.86	1.80	1.66	1.50	1.34	1.18	0.99
EER	13.5	13.0	12.5	11.9	11.5	11.3	10.7	10.0	7.5	7.0	6.6	6.3	6.2	5.7	5.1	4.6	4.0	3.4
Hi PR	395	379	364	348	340	334	321	308	295	282	270	264	259	249	240	230	222	214
Lo PR	143	133	125	114	108	104	96	85	77	69	60	56	54	46	39	33	29	23

Notes

Above information is for nominal CFM and 70-degree indoor dry bulb. Instantaneous capacity listed.

High pressure is measured at the liquid line access fitting.

Amps: Unit amps (comp.+ evaporator motor + condenser fan motor)

Low pressure is measured at the compressor suction access fitting.

kW = Total system power

EXPANDED HEATING DATA (CONT.)

APH1549M41* — LOW STAGE

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	40.0	37.8	35.6	33.3	31.8	30.8	28.6	26.4	21.8	20.1	18.5	17.5	16.9	15.1	13.4	11.7	10.0	8.2
ΔT	30.8	29.2	27.5	25.7	24.5	23.8	22.1	20.4	16.8	15.5	14.3	13.5	13.0	11.7	10.3	9.0	7.7	6.3
kW	3.04	2.98	2.92	2.86	2.83	2.80	2.74	2.69	2.81	2.74	2.68	2.64	2.62	2.55	2.49	2.43	2.36	2.30
Amps	11.5	10.8	10.2	9.7	9.4	9.3	8.8	8.5	8.2	7.9	7.6	7.5	7.4	7.1	6.8	6.5	6.1	5.7
COP	3.85	3.72	3.57	3.41	3.29	3.22	3.05	2.88	2.27	2.15	2.02	1.94	1.88	1.73	1.58	1.41	1.24	1.04
EER	13.1	12.7	12.2	11.6	11.2	11.0	10.4	9.8	7.8	7.3	6.9	6.6	6.4	5.9	5.4	4.8	4.2	3.6
Hi PR	395	379	364	348	340	334	321	308	295	282	270	264	259	249	240	230	222	214
Lo PR	139	129	121	111	105	101	93	83	75	67	59	54	52	44	38	32	28	22

APH1549M41* — HIGH STAGE

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	57.9	54.8	51.6	48.2	46.0	44.6	41.4	38.2	31.9	29.4	27.1	25.6	24.6	22.1	19.6	17.1	14.6	11.9
ΔT	39.8	37.7	35.5	33.2	31.7	30.7	28.5	26.3	21.9	20.2	18.6	17.6	17.0	15.2	13.5	11.8	10.0	8.2
kW	3.99	3.91	3.83	3.75	3.70	3.66	3.59	3.51	3.53	3.44	3.36	3.31	3.28	3.20	3.12	3.03	2.95	2.87
Amps	20.2	18.8	17.7	16.8	16.3	16.0	15.2	14.5	14.0	13.4	12.9	12.6	12.5	11.9	11.2	10.7	10.0	9.2
COP	4.25	4.11	3.95	3.77	3.64	3.56	3.38	3.19	2.64	2.50	2.36	2.26	2.20	2.02	1.84	1.65	1.45	1.22
EER	14.5	14.0	13.5	12.9	12.4	12.2	11.6	10.9	9.0	8.5	8.1	7.7	7.5	6.9	6.3	5.6	4.9	4.2
Hi PR	395	379	364	348	340	334	321	308	295	282	270	264	259	249	240	230	222	214
Lo PR	143	133	125	114	108	104	96	85	77	69	60	56	54	46	39	33	29	23

APH1560M41* — LOW STAGE

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	50.1	47.4	44.6	41.7	39.8	38.6	35.8	33.1	26.6	24.5	22.6	21.3	20.5	18.4	16.3	14.2	12.2	10.0
ΔT	34.3	32.5	30.6	28.6	27.3	26.5	24.6	22.7	18.2	16.8	15.5	14.6	14.1	12.6	11.2	9.8	8.3	6.8
kW	3.76	3.68	3.61	3.53	3.49	3.46	3.39	3.31	3.44	3.36	3.28	3.24	3.21	3.13	3.05	2.97	2.89	2.81
Amps	19.6	18.2	17.2	16.2	15.7	15.4	14.6	14.0	13.4	12.9	12.4	12.1	12.0	11.4	10.8	10.2	9.6	8.8
COP	3.90	3.76	3.62	3.45	3.34	3.26	3.09	2.92	2.26	2.13	2.01	1.93	1.87	1.72	1.57	1.40	1.23	1.04
EER	13.3	12.9	12.4	11.8	11.4	11.2	10.6	10.0	7.7	7.3	6.9	6.6	6.4	5.9	5.4	4.8	4.2	3.5
Hi PR	391	375	361	345	337	330	318	305	292	279	268	261	257	247	237	228	220	212
Lo PR	139	129	121	111	105	101	93	83	75	67	59	54	53	44	38	32	28	22

APH1560M41* — HIGH STAGE

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	70.4	66.6	62.7	58.6	56.0	54.3	50.4	46.5	38.9	35.9	33.0	31.2	30.0	27.0	23.9	20.8	17.8	14.6
ΔT	36.2	34.3	32.3	30.2	28.8	27.9	25.9	23.9	20.0	18.5	17.0	16.0	15.5	13.9	12.3	10.7	9.1	7.5
kW	5.24	5.14	5.04	4.94	4.88	4.83	4.74	4.63	4.52	4.42	4.32	4.26	4.22	4.12	4.02	3.92	3.82	3.72
Amps	26.6	24.8	23.4	22.1	21.4	21.0	20.0	19.1	18.4	17.7	16.9	16.6	16.4	15.7	14.8	14.1	13.2	12.1
COP	3.93	3.79	3.64	3.48	3.36	3.29	3.11	2.94	2.52	2.38	2.24	2.14	2.08	1.92	1.74	1.56	1.36	1.15
EER	13.4	13.0	12.5	11.9	11.5	11.2	10.6	10.0	8.6	8.1	7.7	7.3	7.1	6.5	5.9	5.3	4.7	3.9
Hi PR	411	394	379	362	354	347	333	320	306	293	281	274	269	259	249	239	230	222
Lo PR	130	121	113	104	98	94	87	77	70	62	55	51	49	42	36	30	26	21

Notes

Above information is for nominal CFM and 70-degree indoor dry bulb. Instantaneous capacity listed.

High pressure is measured at the liquid line access fitting.

Low pressure is measured at the compressor suction access fitting.

Amps: Unit amps (comp.+ evaporator motor + condenser fan motor)

kW = Total system power

AUXILIARY HEATING DATA

APH1524M41**

CONDITIONS: 860 CFM; INDOOR AIR @ 70°F DB

OUTDOOR AMBIENT °F.	BASIC UNIT W/O AUX. HEAT		CAPACITY OF UNIT W/ KW OF AUX. HEAT				
	CAPACITY BTU/H	COP	5K	8K	10K	15K	20K
65	29.41	4.14	45.80	56.72	62.18	---	---
60	27.85	4.00	44.23	55.15	60.61	---	---
55	26.21	3.84	42.59	53.51	58.97	---	---
50	24.50	3.66	40.88	51.80	57.26	---	---
45	22.67	3.46	39.06	49.98	55.44	---	---
40	21.06	3.28	37.44	48.36	53.82	---	---
35	19.42	3.09	35.80	46.73	52.19	---	---
30	15.59	2.52	31.97	42.89	48.35	---	---
25	14.39	2.38	30.77	41.69	47.15	---	---
20	13.25	2.24	29.63	40.55	46.01	---	---
15	12.05	2.09	28.43	39.35	44.81	---	---
10	10.81	1.92	27.19	38.11	43.57	---	---
5	9.58	1.74	25.97	36.89	42.35	---	---
0	8.36	1.56	24.74	35.66	41.12	---	---
-5	7.13	1.36	23.51	34.43	39.90	---	---
-10	5.84	1.15	22.22	33.15	38.61	---	---

APH1530M41**

CONDITIONS: 1000 CFM; INDOOR AIR @ 70°F DB

OUTDOOR AMBIENT °F.	BASIC UNIT W/O AUX. HEAT		CAPACITY OF UNIT W/ KW OF AUX. HEAT				
	CAPACITY BTU/H	COP	5K	8K	10K	15K	20K
65	34.44	4.36	51.51	61.75	68.57	85.64	---
60	32.61	4.21	49.67	59.91	66.74	83.80	---
55	30.69	4.04	47.75	57.99	64.82	81.88	---
50	28.69	3.86	45.75	55.99	62.82	79.88	---
45	26.55	3.65	43.62	53.85	60.68	77.75	---
40	24.66	3.36	41.73	51.96	58.79	75.86	---
35	22.74	3.26	39.81	50.05	56.87	73.94	---
30	18.81	2.70	35.88	46.12	52.94	70.01	---
25	17.37	2.55	34.43	44.67	51.50	68.56	---
20	15.99	2.40	33.06	43.29	50.12	67.19	---
15	9.89	2.24	26.95	37.19	44.02	61.08	---
10	8.87	2.06	25.94	36.18	43.00	60.07	---
5	7.87	1.87	24.93	35.17	42.00	59.06	---
0	6.86	1.67	23.93	34.16	40.99	58.06	---
-5	5.85	1.47	22.92	33.16	39.98	57.05	---
-10	7.05	1.23	24.12	34.36	41.18	58.25	---

APH1536M41**

CONDITIONS: 1200 CFM; INDOOR AIR @ 70°F DB

OUTDOOR AMBIENT °F.	BASIC UNIT W/O AUX. HEAT		CAPACITY OF UNIT W/ KW OF AUX. HEAT				
	CAPACITY BTU/H	COP	5K	8K	10K	15K	20K
65	44.59	4.02	60.97	71.89	77.35	93.73	---
60	42.21	3.89	58.59	69.51	74.97	91.36	---
55	39.73	3.74	56.11	67.03	72.49	88.87	---
50	37.14	3.57	53.52	64.44	69.90	86.28	---
45	34.37	3.38	50.75	61.67	67.14	83.52	---
40	31.92	3.20	48.31	59.23	64.69	81.07	---
35	29.44	3.02	45.82	56.74	62.20	78.59	---
30	23.20	2.80	39.58	50.50	55.97	72.35	---
25	21.41	2.64	37.80	48.72	54.18	70.56	---
20	19.72	2.49	36.10	47.02	52.48	68.87	---
15	17.93	2.32	34.31	45.24	50.70	67.08	---
10	16.09	2.13	32.47	43.39	48.85	65.23	---
5	14.26	1.94	30.65	41.57	47.03	63.41	---
0	12.44	1.73	28.82	39.74	45.20	61.59	---
-5	10.61	1.52	27.00	37.92	43.38	59.76	---
-10	8.70	1.28	25.08	36.00	41.46	57.84	---

NOTES

- COP: Coefficient of performance
- To obtain BTU capacity of the unit with Kw of auxiliary heat, multiply by 1000 (example 39.01 x 1000 = 39,010 BTU'S)

AUXILIARY HEATING DATA (CONT.)

APH1543M41**

CONDITIONS: 1350 CFM; INDOOR AIR @ 70°F DB

OUTDOOR AMBIENT °F.	BASIC UNIT W/O AUX. HEAT		CAPACITY OF UNIT W/ KW OF AUX. HEAT				
	CAPACITY BTU/H	COP	5K	8K	10K	15K	20K
65	50.28	4.31	67.35	77.58	84.41	101.48	---
60	47.60	4.16	64.67	74.90	81.73	98.80	---
55	44.80	4.00	61.87	72.10	78.93	96.00	---
50	41.88	3.82	58.95	69.18	76.01	93.08	---
45	38.76	3.61	55.83	66.06	72.89	89.96	---
40	36.00	3.43	53.07	63.30	70.13	87.20	---
35	33.20	3.24	50.27	60.50	67.33	84.40	---
30	24.92	2.53	41.99	52.22	59.05	76.12	---
25	23.00	2.39	40.07	50.30	57.13	74.20	---
20	21.18	2.25	38.25	48.48	55.31	72.38	---
15	19.26	2.10	36.33	46.56	53.39	70.46	---
10	17.28	1.93	34.35	44.58	51.41	68.48	---
5	15.32	1.76	32.39	42.62	49.45	66.52	---
-5	11.40	1.38	28.47	38.70	45.53	62.60	---
-10	9.34	1.16	26.41	36.64	43.47	60.54	---

APH1549M41**

CONDITIONS: 1700 CFM INDOOR AIR @ 70°F DB

OUTDOOR AMBIENT °F.	BASIC UNIT W/O AUX. HEAT		CAPACITY OF UNIT W/ KW OF AUX. HEAT				
	CAPACITY BTU/H	COP	5K	8K	10K	15K	20K
65	57.38	4.00	73.76	84.69	90.15	106.53	122.91
60	54.32	3.86	70.71	81.63	87.09	103.47	119.85
55	51.13	3.70	67.51	78.43	83.89	100.28	116.66
50	47.80	3.53	64.18	75.10	80.56	96.94	113.33
45	44.23	3.34	60.62	71.54	77.00	93.38	109.76
40	41.09	3.16	57.47	68.39	73.85	90.23	106.61
35	37.89	2.98	54.27	65.19	70.65	87.04	103.42
30	30.65	2.45	47.03	57.96	63.42	79.80	96.18
25	28.29	2.32	44.67	55.59	61.05	77.44	93.82
20	26.05	2.18	42.43	53.36	58.82	75.20	91.58
15	23.69	2.03	40.07	50.99	56.45	72.84	89.22
10	21.25	1.86	37.64	48.56	54.02	70.40	86.78
5	18.84	1.69	35.23	46.15	51.61	67.99	84.37
0	16.43	1.51	32.82	43.74	49.20	65.58	81.96
-5	14.02	1.32	30.40	41.33	46.79	63.17	79.55
-10	11.49	1.11	27.87	38.79	44.25	60.64	77.02

APH1560M41**

CONDITIONS: 1800 CFM; INDOOR AIR @ 70°F DB

OUTDOOR AMBIENT °F.	BASIC UNIT W/O AUX. HEAT		CAPACITY OF UNIT W/ KW OF AUX. HEAT				
	CAPACITY BTU/H	COP	5K	8K	10K	15K	20K
65	70.39	3.93	86.77	97.70	103.16	119.54	135.92
60	66.64	3.79	83.02	93.94	99.40	115.79	132.17
55	62.72	3.64	79.10	90.02	95.48	111.87	128.25
50	58.63	3.48	75.01	85.94	91.40	107.78	124.16
45	54.26	3.29	70.65	81.57	87.03	103.41	119.79
40	50.40	3.11	66.78	77.70	83.16	99.55	115.93
35	46.48	2.94	62.86	73.78	79.24	95.63	112.01
30	38.88	2.52	55.26	66.18	71.64	88.02	104.40
25	35.88	2.38	52.26	63.18	68.64	85.03	101.41
20	33.04	2.24	49.42	60.34	65.81	82.19	98.57
15	30.05	2.08	46.43	57.35	62.81	79.19	95.58
10	26.96	1.92	43.34	54.26	59.72	76.10	92.49
5	23.90	1.74	40.28	51.20	56.66	73.05	89.43
0	20.84	1.56	37.22	48.15	53.61	69.99	86.37
-5	17.78	1.36	34.17	45.09	50.55	66.93	83.31
-10	14.57	1.15	30.95	41.87	47.34	63.72	80.10

NOTES

- COP: Coefficient of performance
- To obtain BTU capacity of the unit with Kw of auxiliary heat, multiply by 1000 (example 39.01 x 1000 = 39,010 BTU'S)

HEAT KIT ELECTRICAL DATA (BLOWER ONLY, HEAT MODE)

MODEL AND HEAT KIT USAGE	CIRCUIT #1		CIRCUIT #2		SINGLE-POINT KIT		ACTUAL kW / BTU@ 240V
	MCA ¹	MOP ²	MCA ¹	MOP ²	MCA ¹	MOP ²	
APH1524M41**	5.4	---	---	---	--	--	---
HKR-05*, HKR-05C*	21 / 25	25 / 25	---	---	46	50	4.75 / 16,200
HKR-08*, HKR-08C*	32 / 36	35 / 40	---	---	58	60	7.0 / 23,800
HKR-10*, HKR-10C*	43 / 49	45 / 50	---	---	71	80	9.5 / 32,400
APH1530M41**	5.4	---	---	---	--	--	---
HKR-05*, HKR-05C*	21 / 25	25 / 25	---	---	48	50	4.75 / 16,200
HKR-08*, HKR-08C*	32 / 36	35 / 40	---	---	60	60	7.0 / 23,800
HKR-10*, HKR-10C*	43 / 49	45 / 50	---	---	73	80	9.5 / 32,400
HKP-15C*	43 / 49	45 / 50	21 / 25	25 / 25	97	100	14.25 / 48,600
APH1536M41**	5.4	---	---	---	--	--	---
HKR-05*, HKR-05C*	21 / 25	25 / 25	---	---	51	60	4.75 / 16,200
HKR-08*, HKR-08C*	32 / 36	35 / 40	---	---	63	70	7.0 / 23,800
HKR-10*, HKR-10C*	43 / 49	45 / 50	---	---	76	80	9.5 / 32,400
HKP-15C*	43 / 49	45 / 50	21 / 25	25 / 25	101	110	14.25 / 48,600
APH1543M41**	3.6	---	---	---	--	--	---
HKR-05*, HKR-05C*	21 / 25	25 / 25	---	---	51	60	4.75 / 16,200
HKR-08*, HKR-08C*	32 / 36	35 / 40	---	---	63	70	7.0 / 23,800
HKR-10*, HKR-10C*	43 / 49	45 / 50	---	---	76	80	9.5 / 32,400
HKP-15C*	43 / 49	45 / 50	21 / 25	25 / 25	101	110	14.25 / 48,600
APH1549M41**	3.6	---	---	---	--	--	---
HKR-05*, HKR-05C*	21 / 25	25 / 25	---	---	56	70	4.75 / 16,200
HKR-08*, HKR-08C*	32 / 36	35 / 40	---	---	67	80	7.00 / 23,800
HKR-10*, HKR-10C*	43 / 49	45 / 50	---	---	80	90	9.50 / 32,400
HKP-15C*	43 / 49	45 / 50	21 / 25	25 / 25	105	110	14.25 / 48,600
HKP-20C*	43 / 49	45 / 50	43 / 49	45 / 50	132	150	19.0 / 64,800
APH1560M41**	8.8	---	---	---	--	--	---
HKR-05*, HKR-05C*	21 / 25	25 / 25	---	---	67	80	4.75 / 16,200
HKR-08*, HKR-08C*	32 / 36	35 / 40	---	---	79	90	7.0 / 23,800
HKR-10*, HKR-10C*	43 / 49	45 / 50	---	---	92	100	9.5 / 32,400
HKP-15C*	43 / 49	45 / 50	21 / 25	25 / 25	116	125	14.25 / 48,600
HKP-20C*	43 / 49	45 / 50	43 / 49	45 / 50	144	150	19.0 / 64,800

¹ Minimum Circuit Ampacity @ 208 / 240 V

² Maximum Overcurrent Protection Device @ 208 / 240 V

* Revision level that may or may not be designated

C Circuit breaker option

NOTE: HKP-15C* and HKP-20C* replace HKR-15C and HKR-20C respectively to meet new UL1995 requirements.

DIPSWITCH SETTINGS

MODEL	SWITCH 1	SWITCH 2	ELECTRIC HEAT CFM	SPEED TAP
APH1524	Off	Off	1,050	A*
	On	Off	950	B
	Off	On	825	C
	On	On	700	D
APH1530	Off	Off	1,250	A*
	On	Off	1,100	B
	Off	On	1,000	C
	On	On	800	D
APH1536	Off	Off	1,250	A*
	On	Off	1,100	B
	Off	On	1,000	C
	On	On	800	D
APH1543, APH1549	Off	Off	1,800	A*
	On	Off	1,700	B
	Off	On	1,400	C**
	On	On	1,225	D
APH1560	Off	Off	2,000	A*
	On	Off	1,800	B
	Off	On	1,600	C
	On	On	1,400	D

* Denotes factory setting
 ** Denotes factory setting APH1543



NOTES:

- **Important:** Disconnect power to unit before moving jumper to prevent damage to TAP board.
- APH1560: low-stage cool will be 70% of high-stage cool.

MODEL	SWITCH 1	SWITCH 2	ELECTRIC HEAT CFM	SPEED TAP
APH1524	Off	Off	1,050	A*
	On	Off	950	B
	Off	On	825	C
	On	On	700	D
APH1530	Off	Off	1,250	A*
	On	Off	1,100	B
	Off	On	1,000	C
	On	On	800	D
APH1536	Off	Off	1,250	A*
	On	Off	1,100	B
	Off	On	1,000	C
	On	On	800	D
APH1543, APH1549	Off	Off	1,800	A*
	On	Off	1,700	B
	Off	On	1,400	C**
	On	On	1,225	D***
APH1560	Off	Off	2,000	A*
	On	Off	1,800	B
	Off	On	1,600	C
	On	On	1,400	D



* denotes factory setting
 ** Denotes factory setting APH1543
 *** Denotes factory setting APH1549

DIMENSIONS

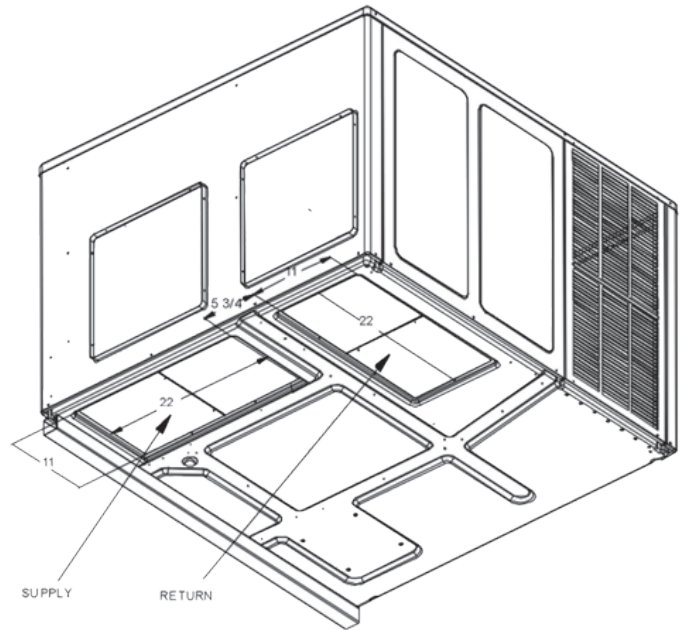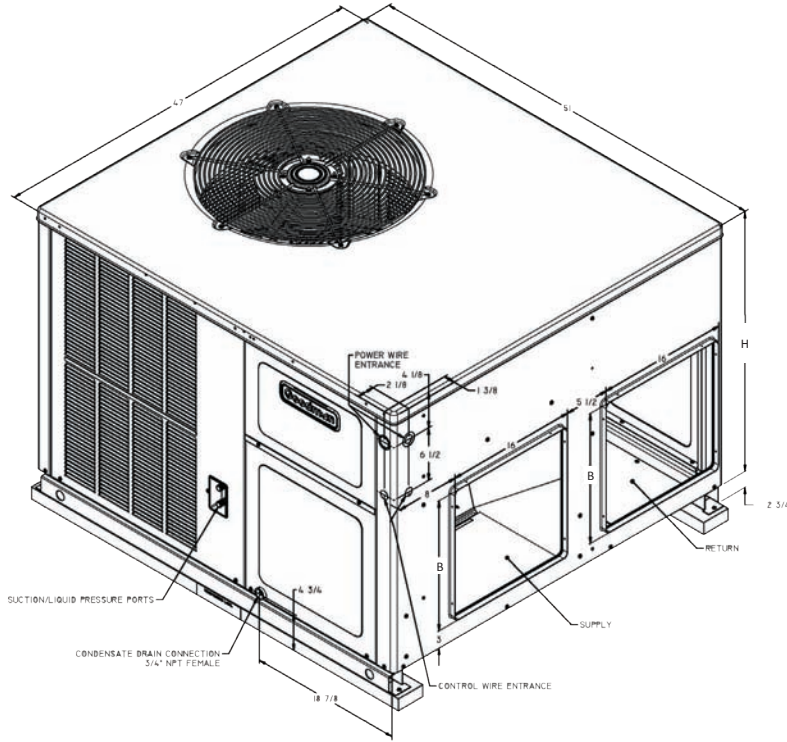

MODEL	MED.	LARGE	W"	D'	H'	B	H
APH1524M41**	X		47	51	34 $\frac{3}{4}$ "	16"	32 $\frac{1}{2}$ "
APH1530M41**	X		47	51	34 $\frac{3}{4}$ "	16"	32 $\frac{1}{2}$ "
APH1536M41**	X		47	51	34 $\frac{3}{4}$ "	16"	32 $\frac{1}{2}$ "
APH1543M41**		X	47	51	42 $\frac{1}{4}$ "	18"	40"
APH1549M41**		X	47	51	42 $\frac{1}{4}$ "	18"	40"
APH1560M41**		X	47	51	42 $\frac{1}{4}$ "	18"	40"

WIRING DIAGRAM — APH1524-36/43**

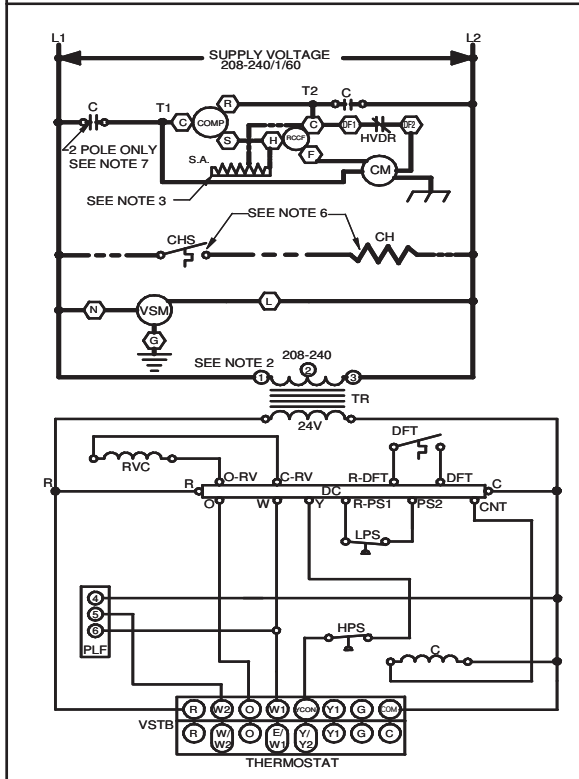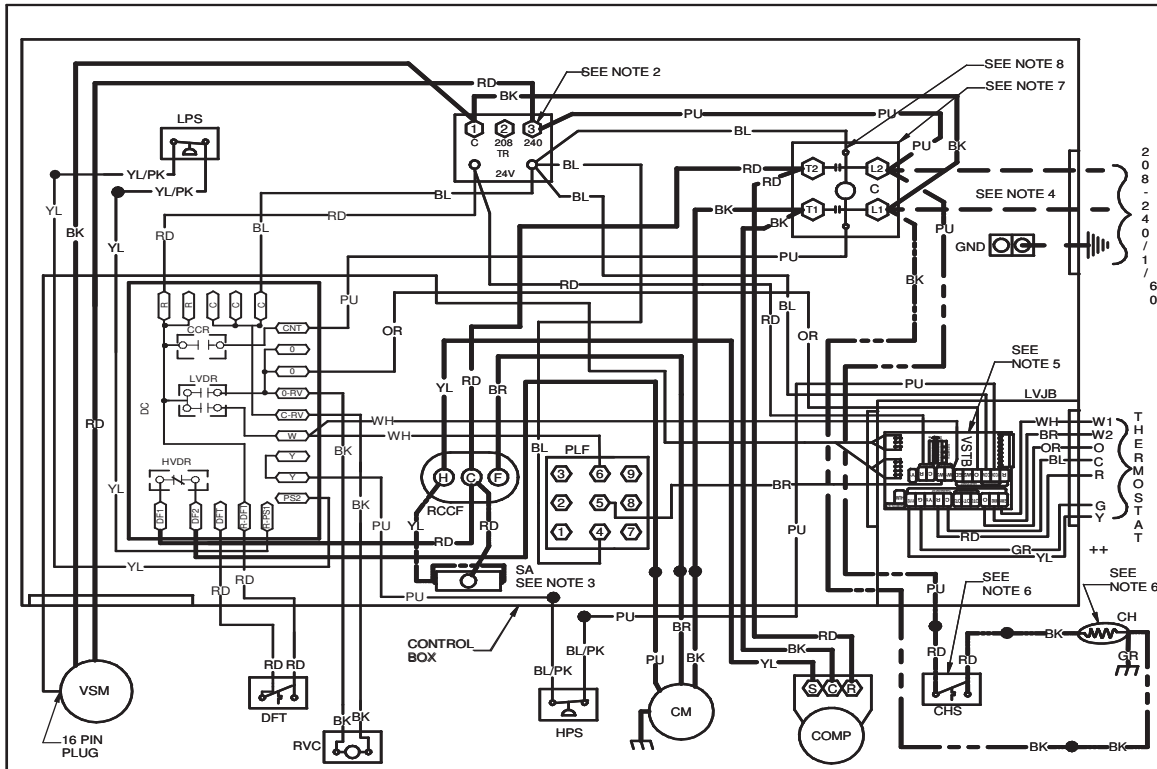

COMPONENT LEGEND

C	CONTACTOR	FACTORY WIRING
CCR	COMPRESSOR CONTACTOR RELAY	—— LINE VOLTAGE
CH	CRANKCASE HEATER	—— LOW VOLTAGE
CHS	CRANKCASE HEATER SWITCH	—— OPTIONAL HIGH VOLTAGE
CM	CONDENSER MOTOR	
COMP	COMPRESSOR	FIELD WIRING
DC	DEFROST CONTROL	—— HIGH VOLTAGE
DFT	DEFROST THERMOSTAT	—— LOW VOLTAGE
GND	EQUIPMENT GROUND	
HPS	HIGH PRESSURE SWITCH	
HVDR	HIGH VOLTAGE DEFROST RELAY	
LPS	LOW PRESSURE SWITCH	
LVDR	LOW VOLTAGE DEFROST RELAY	
LVJB	LOW VOLTAGE JUNCTION BOX	
PLF	FEMALE PLUG / CONNECTOR	WIRE CODE
RVC	REVERSING VALVE COIL	BK BLACK
RCCF	RUN CAPACITOR FOR COMPRESSOR AND FAN	BL BLUE
SA	START ASSIST	BR BROWN
TR	TRANSFORMER	GR GREEN
VSM	VARIABLE SPEED MOTOR	OR ORANGE
VSTB	VARIABLE SPEED TERM BLOCK	PU PURPLE
		RD RED
		WH WHITE
		YL YELLOW

NOTES:

- REPLACEMENT WIRE MUST BE SAME SIZE AND TYPE INSULATION AS ORIGINAL (AT LEAST 105°C) USE COPPER CONDUCTOR ONLY.
- FOR 208 VOLT TRANSFORMER OPERATION MOVE PURPLE AND RED WIRES FROM TERMINAL 3 TO TERMINAL 2 ON TRANSFORMER.
- START ASSIST FACTORY EQUIPPED WHEN REQUIRED.
- USE COPPER CONDUCTORS ONLY.
- ++ USE N.E.C. CLASS 2 WIRE.
- REFER TO I/O INSTRUCTIONS FOR SPEED SETTING.
- CRANKCASE HEATER AND CRANKCASE HEATER SWITCH FACTORY EQUIPPED WHEN REQUIRED.
- DOUBLE POLE CONTACTOR SHOWN. SINGLE POLE CONTACTOR COULD BE FACTORY EQUIPPED AS AN ALTERNATE CONFIGURATION.
- COMMON SIDE OF CONTACTOR CAN NOT BE GROUNDED OR CONNECTED TO ANY OTHER COMMON (24V).

SEE UNIT RATING PLATE FOR TYPE AND SIZE OF OVER CURRENT PROTECTION




0140G01638-B

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

WARNING

Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

WIRING DIAGRAM — APH1549/60**

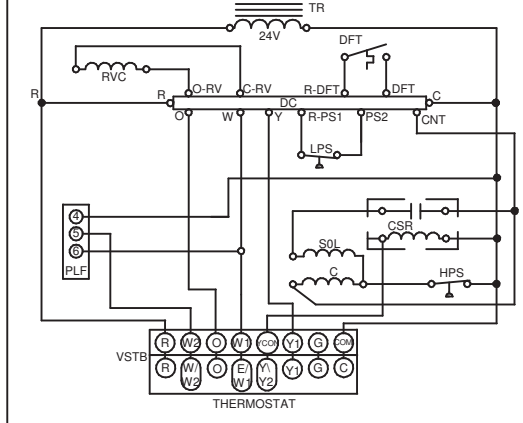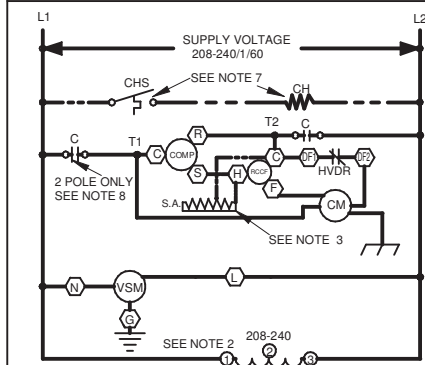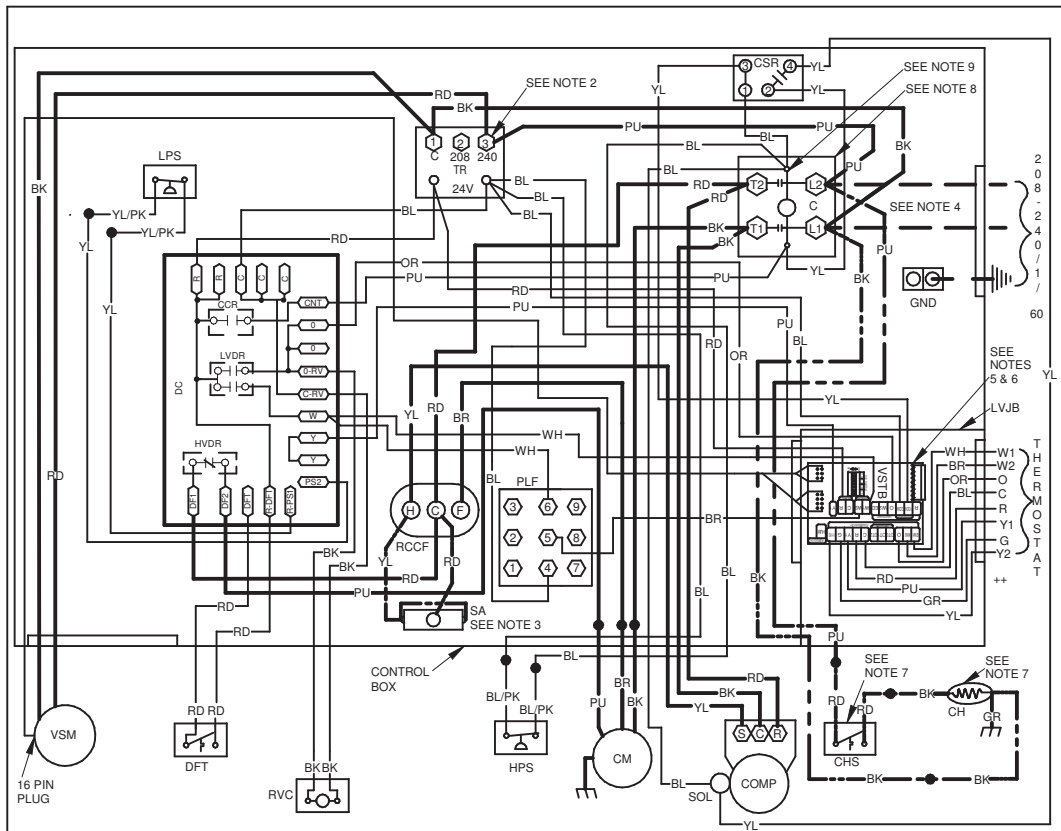

COMPONENT LEGEND		FACTORY WIRING
C	CONTACTOR	— LINE VOLTAGE
CCR	COMPRESSOR CONTACTOR RELAY	— LOW VOLTAGE
CH	CRANKCASE HEATER	--- OPTIONAL HIGH VOLTAGE
CHS	CRANKCASE HEATER SWITCH	
CM	CONDENSER MOTOR	
COMP	COMPRESSOR	
CSR	COMPRESSOR SOLENOID RELAY	
DC	DEFROST CONTROL	
DFT	DEFROST THERMOSTAT	— HIGH VOLTAGE
GND	EQUIPMENT GROUND	--- LOW VOLTAGE
HPS	HIGH PRESSURE SWITCH	
HVDR	HIGH VOLTAGE DEFROST RELAY	
LPS	LOW PRESSURE SWITCH	
LVDR	LOW VOLTAGE DEFROST RELAY	
LVJB	LOW VOLTAGE JUNCTION BOX	
PLF	FEMALE PLUG / CONNECTOR	
RVC	REVERSING VALVE COIL	
RCCF	RUN CAPACITOR FOR COMPRESSOR AND FAN	
SA	START ASSIST	
SOL	HI STAGE SOLENOID	
TR	TRANSFORMER	
VSM	VARIABLE SPEED MOTOR	
VSTB	VARIABLE SPEED TERM BLOCK	

- NOTES:**
1. REPLACEMENT WIRE MUST BE SAME SIZE AND TYPE INSULATION AS ORIGINAL (AT LEAST 105°C) USE COPPER CONDUCTOR ONLY.
 2. FOR 208 VOLT TRANSFORMER OPERATION MOVE PURPLE AND RED WIRES FROM TERMINAL 3 TO TERMINAL 2 ON TRANSFORMER.
 3. START ASSIST FACTOR EQUIPPED WHEN REQUIRED
 4. USE COPPER CONDUCTORS ONLY
 5. SET DIP SWITCH 4 ON VSTB TO OFF POSITION
 6. REFER TO IO FOR FAN SPEED SETTINGS
 7. CRANKCASE HEATER AND CRANKCASE HEATER SWITCH FACTORY EQUIPPED WHEN REQUIRED.
 8. DOUBLE POLE CONTACTOR SHOWN. SINGLE POLE CONTACTOR COULD BE FACTORY EQUIPPED AS AN ALTERNATE CONFIGURATION.
 9. COMMON SIDE OF CONTACTOR CAN NOT BE GROUNDED OR CONNECTED TO ANY OTHER COMMON (24V).

SEE UNIT RATING PLATE FOR TYPE AND SIZE OF OVER CURRENT PROTECTION

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

WARNING

Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

ACCESSORIES

ACCESSORY DESCRIPTION	ITEM NUMBER	
	MEDIUM CHASSIS	LARGE CHASSIS
Concentric Kit	CDK36	CDK4872
Downflow Economizer	GPH13MED102	GPH13MED103
Downflow Internal Filter Rack	GPH13MFR102	GPH13MFR103
Downflow Manual Damper	PGMDD101/102	PGMDD103
Downflow Motorized Damper	PGMDMD101/102	PGMDMD103
Downflow Square to Round	SQRPG101/102	SQRPG103
External Horizontal Filter Rack	GPGHFR101-103	GPGHFR101-103
Horizontal Duct Cover	20464501PDGK	20464502PDGK
Horizontal Economizer	PEHH101/102	PEHH103
Horizontal manual Damper	PGMDH102	PGMDH103
Horizontal Motorized Damper	PGMDMH102	PGMDMH103
Horizontal Square to Round	SQRPGH101/102	SQRPGH103
Outdoor Thermostat & Emergency Heat Relay Kit	OT/EHR18-60	OT/EHR18-60
Outdoor Thermostat Kit w/ Lockout Stat	OT18-60A	OT18-60A
Roof Curb	PGC101/102/103	PGC101/102/103

SINGLE-POINT KIT ACCESSORY KITS

Select the single-point kit accessory based on the unit model.

MODEL	SINGLE-POINT KIT
APH1524M41B*	SPK-30
APH1530M41B*	SPK-35
APH1536M41B*	SPK-40
APH1543M41B*	SPK-40
APH1549M41B*	SPK-50
APH1560M41B*	SPK-60

NOTES