



VSX14

SPLIT SYSTEM AIR CONDITIONER

COOLING CAPACITY: 18,000 - 60,000 BTU/H

UP TO 14 SEER & 12.5 EER

Contents

Nomenclature.....	2
Product Specifications.....	3
Expanded Cooling Data	5
Performance Data	29
AHRI Ratings	31
Dimensions	73
Wiring Diagram.....	74
Accessories	75



Standard Features

- Energy-efficient compressor
- Quiet condenser fan system
- Factory-installed liquid line filter drier
- Copper tube/aluminum fin coil
- Brass liquid and suction service valves with sweat connections
- Ground lug connection
- AHRI Certified; ETL Listed

Cabinet Features

- Sound control top designed for quiet operation
- Steel louver coil guard
- Heavy-gauge galvanized-steel cabinet
- Attractive Bahama Beige powder-paint finish with 500-hour salt-spray approval
- When properly anchored, meets the 2010 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)



* Complete warranty details available from your local dealer or at www.goodmanmfg.com/gmc. To receive the 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Registration is not required in California or Quebec.

	V	S	X	14	036	1	A	A
	1	2	3	4,5	6,7,8	9	10	11
Brand	V Standard Feature Set						Engineering Major & Minor Revisions (not used for inventory or ordering)	
Product Category	S Split System						Electrical	
Unit Type	X Condenser R-410A Z Heat Pump R-410A						1 208/230 V, 1 Phase, 60 Hz 2 220/240 V, 1 Phase, 50 Hz 3 208/230 V, 3 Phase, 60 Hz	
Efficiency	13 13 SEER 16 16 SEER 14 14 SEER 18 18 SEER						Nominal Capacity	
					018 1½ Tons 030 2½ Tons 042 3½ Tons 019 1½ Tons 031 2½ Tons 043 3½ Tons 024 2 Tons 036 3 Tons 048 4 Tons 025 2 Tons 037 3 Tons 060 5 Tons			

	VSX14 0181A*	VSX14 0191A*	VSX14 0241A*	VSX14 0251A*	VSX14 0301A*	VSX14 0311A*
CAPACITIES						
Nominal Cooling (BTU/h)	18,000	18,000	24,000	24,000	30,000	30,000
SEER / EER	14 / 12	14 / 12.2	14 / 12	14 / 12.2	14 / 12	14 / 12.2
Decibels	71	71	71	71	72	72
COMPRESSOR						
RLA	9.0	9.0	10.9	10.9	12.8	12.8
LRA	48	47.5	62.9	62.9	64	67.8
CONDENSER FAN MOTOR						
Horsepower	1/8	1/8	1/12	1/8	1/6	1/6
FLA	0.7	0.7	0.6	0.7	1.1	1.1
REFRIGERATION SYSTEM						
Refrigerant Line Size ¹						
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	3/4"	3/4"	3/4"	3/4"	3/4"
Refrigerant Connection Size						
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.) ^{4 5}	3/4"	3/4"	3/4"	3/4"	3/4"	3/4"
Valve Type	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge	68	68	70	70	80	90
Shipped with Orifice Size	0.052	0.053	0.057	0.057	0.065	0.063
ELECTRICAL DATA						
Voltage-Phase (60 Hz)	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1
Minimum Circuit Ampacity ²	12	12	14.2	14.3	17.1	17.1
Max. Overcurrent Protection ³	20 amps	20 amps	25 amps	25 amps	25 amps	25 amps
Min / Max Volts	197/253	197/253	197/253	197/253	197/253	197/253
Electrical Conduit Size	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
EQUIPMENT WEIGHT (LBS)						
	131	131	131	131	162	162
SHIP WEIGHT (LBS)						
	146	146	146	146	180	180

¹ Line sizes denoted for 25' line sets, tested and rated in accordance with AHRI Standard 210/240. For other line-set lengths or sizes, refer to the installation & Operating instructions and/or the long line-set guidelines.

² Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

³ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

⁴ Installer will need to supply 3/8" to 3/4" adapters for suction line connections.

⁵ Installer will need to supply 3/8" to 1/2" adapters for suction line connections.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.

	VSX14 0361A*	VSX14 0371A*	VSX14 0421A*	VSX14 0431A*	VSX14 0481A*	VSX14 0601A*
CAPACITIES						
Nominal Cooling (BTU/h)	36,000	36,000	42,000	42,000	48,000	60,000
SEER / EER	14 / 12	14 / 12.2	14 / 12	14 / 12.2	14 / 11.7	14 / 11.7
Decibels	73	73	73	73	74	75
COMPRESSOR						
RLA	14.1	14.1	16.7	16.7	19.9	25.0
LRA	77	72.2	79	79	109	134
CONDENSER FAN MOTOR						
Horsepower	1/6	1/6	1/6	1/6	1/4	1/4
FLA	1.1	1.1	1.1	1.1	1.5	1.5
REFRIGERATION SYSTEM						
Refrigerant Line Size ¹						
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	7/8"	7/8"	1 1/8"	1 1/8"	1 1/8"	1 1/8"
Refrigerant Connection Size						
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.) ^{4 5}	3/4" ⁴	3/4" ⁴	7/8" ⁵	7/8"	7/8" ⁵	7/8" ⁵
Valve Type	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge	80	89	112	112	131	125
Shipped with Orifice Size	0.068	0.071	0.074	0.074	0.078	0.088
ELECTRICAL DATA						
Voltage-Phase (60 Hz)	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1
Minimum Circuit Ampacity ²	18.7	18.7	22	22	26.4	32.8
Max. Overcurrent Protection ³	30 amps	30 amps	35 amps	35 amps	45 amps	50 amps
Min / Max Volts	197/253	197/253	197/253	197/253	197/253	197/253
Electrical Conduit Size	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
EQUIPMENT WEIGHT (LBS)						
	162	162	189	189	220	260
SHIP WEIGHT (LBS)						
	180	180	207	207	242	280

¹ Line sizes denoted for 25' line sets, tested and rated in accordance with AHRI Standard 210/240. For other line-set lengths or sizes, refer to the installation & Operating instructions and/or the long line-set guidelines.

² Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

³ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

⁴ Installer will need to supply 3/4" to 7/8" adapters for suction line connections.

⁵ Installer will need to supply 7/8" to 1 1/8" adapters for suction line connections.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	18.4	18.7	19.2	20.1	18.3	18.5	19.1	19.9	17.8	18.0	18.6	19.4	17.0	17.2	17.8	18.6	15.9	16.2	16.8	17.6	15.0	15.3	15.8	16.7
	S/T	0.82	0.74	0.62	0.5	1.00	0.75	0.62	0.49	1.00	0.77	0.64	0.5	1.00	0.79	0.66	0.53	1.00	1.00	0.68	0.6	1.00	1.00	0.73	0.60
	ΔT	28	27	23	19	28	27	23	19	29	27	23	20	28	27	23	19	28	26	23	19	29	27	24	20
	KW	1.09	1.09	1.09	1.1	1.22	1.22	1.21	1.22	1.36	1.36	1.36	1.35	1.4	1.51	1.51	1.50	1.68	1.68	1.67	1.7	1.87	1.87	1.87	1.88
	Amps	4.0	4.0	4.0	4.0	4.6	4.6	4.6	4.6	5.2	5.2	5.2	5.2	5.9	5.9	5.9	5.9	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.6
	HI PR	244	245	247	251	282	283	285	289	322	324	325	329	366	367	369	373	412	414	415	419	462	463	465	469
LO PR	122	124	127	132	130	131	134	140	136	138	141	146	142	143	146	151	147	149	152	157	154	155	158	164	
80	MBh	18.7	18.9	19.5	20.3	18.5	18.8	19.3	20.1	18.0	18.3	18.8	19.7	17.2	17.5	18.0	18.8	16.2	16.4	17.0	17.8	15.3	15.5	16.1	16.9
	S/T	1.00	0.80	0.67	0.5	1.00	0.81	0.68	0.54	1.00	0.83	0.70	0.6	1.00	0.85	0.72	0.58	1.00	1.00	0.74	0.6	1.00	1.00	0.79	0.65
	ΔT	27	25	22	18	27	25	22	18	28	26	22	19	27	25	22	18	27	25	22	18	28	26	23	19
	KW	1.10	1.10	1.10	1.1	1.22	1.22	1.22	1.23	1.36	1.36	1.36	1.36	1.4	1.51	1.51	1.51	1.52	1.68	1.68	1.7	1.88	1.88	1.88	1.89
	Amps	4.0	4.0	4.0	4.1	4.6	4.6	4.6	4.6	5.2	5.2	5.2	5.3	5.9	5.9	5.9	6.0	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.6
	HI PR	246	247	249	253	284	285	287	291	325	326	327	332	368	369	371	375	415	416	417	422	464	465	467	471
LO PR	124	126	129	134	132	133	136	141	138	140	143	148	143	145	148	153	149	150	153	159	156	157	160	165	
80	MBh	18.9	19.2	19.8	20.6	18.8	19.0	19.6	20.4	18.3	18.6	19.1	19.9	17.5	17.7	18.3	19.1	16.5	16.7	17.3	18.1	15.6	15.8	16.4	17.2
	S/T	1.00	0.83	0.70	0.6	1.00	0.84	0.71	0.57	1.00	0.86	0.73	0.6	1.00	1.00	0.75	0.62	1.00	1.00	0.77	0.6	1.00	1.00	0.82	0.69
	ΔT	26	25	21	17	26	24	21	17	27	25	21	18	26	24	21	17	26	24	21	17	27	25	22	18
	KW	1.10	1.10	1.10	1.1	1.23	1.23	1.23	1.24	1.37	1.37	1.37	1.37	1.4	1.52	1.52	1.53	1.69	1.69	1.69	1.7	1.89	1.89	1.88	1.89
	Amps	4.1	4.1	4.0	4.1	4.6	4.6	4.6	4.7	5.3	5.3	5.3	5.3	6.0	6.0	6.0	6.0	6.7	6.7	6.7	6.8	7.6	7.6	7.6	7.7
	HI PR	248	249	251	255	286	287	289	293	327	328	329	334	370	371	373	377	417	418	419	424	466	467	469	473
LO PR	126	128	131	136	134	135	138	143	140	141	145	150	145	147	150	155	151	152	155	161	158	159	162	167	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
85	MBh	18.7	19.0	19.5	20.4	18.6	18.8	19.4	20.2	18.1	18.3	18.9	19.7	17.3	17.5	18.1	18.9	16.3	16.5	17.1	17.9	15.3	15.6	16.1	17.0
	S/T	1.00	0.84	0.71	0.58	1.00	0.85	0.72	0.58	1.00	1.00	0.74	0.61	1.00	1.00	0.76	0.62	1.00	1.00	0.78	0.64	1.00	1.00	1.00	0.69
	ΔT	32	30	27	23	32	30	27	23	32	30	27	23	32	30	27	23	32	30	26	23	33	31	28	24
	KW	1.09	1.09	1.09	1.10	1.22	1.22	1.22	1.23	1.36	1.36	1.36	1.37	1.51	1.51	1.51	1.52	1.68	1.68	1.68	1.69	1.88	1.88	1.87	1.88
	Amps	4.0	4.0	4.0	4.0	4.6	4.6	4.6	4.6	5.2	5.2	5.2	5.3	5.9	5.9	5.9	5.9	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.6
	HI PR	245	246	248	252	283	284	286	290	324	325	326	331	367	368	370	374	414	415	416	421	463	464	466	470
LO PR	124	126	129	134	132	133	136	141	138	140	143	148	144	145	148	153	149	150	154	159	156	157	160	165	
85	MBh	19.0	19.2	19.8	20.6	18.8	19.1	19.6	20.4	18.3	18.6	19.1	20.0	17.5	17.8	18.3	19.1	16.5	16.8	17.3	18.1	15.6	15.8	16.4	17.2
	S/T	1.00	0.90	0.77	0.63	1.00	0.90	0.77	0.64	1.00	1.00	0.80	0.66	1.00	1.00	0.82	0.68	1.00	1.00	0.84	0.70	1.00	1.00	1.00	0.75
	ΔT	31	29	26	22	31	29	26	22	31	29	26	22	31	29	26	22	31	29	25	22	32	30	26	23
	KW	1.10	1.10	1.10	1.11	1.23	1.23	1.22	1.23	1.37	1.37	1.36	1.37	1.52	1.52	1.51	1.52	1.69	1.68	1.68	1.69	1.88	1.88	1.88	1.89
	Amps	4.0	4.0	4.0	4.1	4.6	4.6	4.6	4.6	5.3	5.2	5.2	5.3	5.9	5.9	5.9	6.0	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.7
	HI PR	247	248	250	254	285	287	288	292	326	327	328	333	369	370	372	376	416	417	418	423	465	467	468	472
LO PR	126	127	131	136	133	135	138	143	140	141	144	150	145	147	150	155	151	152	155	160	157	159	162	167	
85	MBh	19.3	19.5	20.1	20.9	19.1	19.4	19.9	20.7	18.6	18.9	19.4	20.3	17.8	18.1	18.6	19.4	16.8	17.0	17.6	18.4	15.9	16.1	16.7	17.5
	S/T	1.00	0.93	0.80	0.66	1.00	1.00	0.81	0.67	1.00	1.00	0.83	0.69	1.00	1.00	0.85	0.71	1.00	1.00	0.87	0.73	1.00	1.00	1.00	0.78
	ΔT	30	28	25	21	30	28	25	21	30	28	25	21	30	28	25	21	30	28	24	21	31	29	26	22
	KW	1.11	1.11	1.10	1.11	1.23	1.23	1.23	1.24	1.37	1.37	1.37	1.38	1.52	1.52	1.52	1.53	1.69	1.69	1.69	1.70	1.89	1.89	1.89	1.90
	Amps	4.1	4.1	4.1	4.1	4.6	4.6	4.6	4.7	5.3	5.3	5.3	5.3	6.0	6.0	6.0	6.0	6.7	6.7	6.7	6.8	7.6	7.6	7.6	7.7
	HI PR	249	250	252	256	287	289	290	294	328	329	330	335	371	372	374	378	418	419	420	425	467	469	470	474
LO PR	128	129	133	138	135	137	140	145	142	143	146	152	147	149	152	157	153	154	157	162	159	161	164	169	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
550	MBh	18.1	18.4	18.9	-	18.0	18.2	18.8	-	17.5	17.8	18.3	-	16.7	17.0	17.5	-	15.7	16.0	16.5	-	14.8	15.1	15.6	-
	S/T	0.65	0.57	0.44	-	0.65	0.58	0.45	-	0.68	0.60	0.47	-	1.00	0.62	0.49	-	1.00	0.64	0.51	-	1.00	0.69	0.56	-
	ΔT	20	18	14	-	20	18	14	-	20	18	14	-	20	18	14	-	19	18	14	-	21	19	15	-
	KW	1.05	1.05	1.05	-	1.17	1.17	1.16	-	1.30	1.30	1.29	-	1.44	1.44	1.43	-	1.59	1.59	1.59	-	1.78	1.78	1.77	-
	Amps	3.9	3.9	3.9	-	4.4	4.4	4.4	-	5.0	5.0	5.0	-	5.7	5.7	5.6	-	6.4	6.4	6.4	-	7.2	7.2	7.2	-
600	HI PR	240	241	242	-	277	278	280	-	316	318	319	-	359	360	362	-	404	405	407	-	453	454	456	-
	LO PR	125	126	129	-	132	134	137	-	139	140	143	-	144	146	149	-	150	151	154	-	156	158	161	-
	MBh	18.3	18.6	19.1	-	18.2	18.4	19.0	-	17.7	18.0	18.5	-	16.9	17.2	17.7	-	15.9	16.2	16.7	-	15.0	15.3	15.8	-
	S/T	0.67	0.60	0.47	-	0.68	0.61	0.47	-	0.70	0.63	0.50	-	1.00	0.65	0.52	-	1.00	0.67	0.54	-	1.00	0.72	0.59	-
	ΔT	19	17	13	-	19	17	13	-	19	17	14	-	19	17	13	-	19	17	13	-	20	18	14	-
675	KW	1.05	1.05	1.05	-	1.17	1.17	1.17	-	1.30	1.30	1.30	-	1.44	1.44	1.44	-	1.60	1.60	1.59	-	1.78	1.78	1.78	-
	Amps	3.9	3.9	3.9	-	4.4	4.4	4.4	-	5.0	5.0	5.0	-	5.7	5.7	5.7	-	6.4	6.4	6.4	-	7.2	7.2	7.2	-
	HI PR	241	242	244	-	279	280	281	-	318	319	321	-	360	361	363	-	406	407	409	-	455	456	457	-
	LO PR	126	128	131	-	133	135	138	-	140	142	145	-	146	147	150	-	151	152	156	-	158	159	162	-
	MBh	18.7	18.9	19.5	-	18.5	18.8	19.3	-	18.1	18.3	18.9	-	17.3	17.5	18.1	-	16.3	16.5	17.1	-	15.4	15.6	16.2	-
70	S/T	0.69	0.62	0.49	-	0.70	0.62	0.49	-	0.72	0.65	0.52	-	1.00	0.67	0.53	-	1.00	0.69	0.56	-	1.00	0.74	0.61	-
	ΔT	18	16	13	-	18	16	12	-	18	16	13	-	18	16	12	-	18	16	12	-	19	17	13	-
	KW	1.06	1.06	1.06	-	1.18	1.17	1.17	-	1.30	1.30	1.30	-	1.45	1.44	1.44	-	1.60	1.60	1.60	-	1.79	1.79	1.78	-
	Amps	3.9	3.9	3.9	-	4.5	4.5	4.5	-	5.1	5.1	5.0	-	5.7	5.7	5.7	-	6.4	6.4	6.4	-	7.3	7.3	7.2	-
	HI PR	243	244	246	-	281	282	283	-	320	321	323	-	362	363	365	-	408	409	411	-	457	458	459	-
LO PR	128	130	133	-	136	137	141	-	142	144	147	-	148	149	153	-	153	155	158	-	160	162	165	-	
550	MBh	18.2	18.4	18.9	19.8	18.0	18.2	18.8	19.6	17.5	17.8	18.3	19.1	16.7	17.0	17.5	18.3	15.7	16.0	16.5	17.3	14.8	15.1	15.6	16.4
	S/T	0.80	0.73	0.59	0.45	1.00	0.73	0.60	0.46	1.00	0.76	0.62	0.48	1.00	0.75	0.62	0.48	1.00	0.80	0.66	0.53	1.00	1.00	0.71	0.58
	ΔT	23	21	18	14	23	21	18	14	24	22	18	14	23	21	18	14	23	21	17	14	24	22	19	15
	KW	1.05	1.05	1.05	1.06	1.17	1.17	1.16	1.17	1.30	1.29	1.29	1.30	1.44	1.43	1.43	1.44	1.59	1.59	1.59	1.60	1.78	1.78	1.77	1.78
	Amps	3.9	3.9	3.9	3.9	4.4	4.4	4.4	4.4	5.0	5.0	5.0	5.0	5.7	5.7	5.6	5.7	6.4	6.4	6.4	6.4	7.2	7.2	7.2	7.2
600	HI PR	240	241	243	247	277	278	280	284	317	318	319	324	359	360	362	366	405	406	407	411	453	454	456	460
	LO PR	125	126	129	134	132	134	137	142	139	140	143	148	144	146	149	154	150	151	154	159	156	158	161	166
	MBh	18.4	18.6	19.1	20.0	18.2	18.4	19.0	19.8	17.7	18.0	18.5	19.3	16.9	17.2	17.7	18.5	15.9	16.2	16.7	17.5	15.0	15.3	15.8	16.6
	S/T	0.80	0.73	0.59	0.45	1.00	0.73	0.60	0.46	1.00	0.76	0.62	0.48	1.00	0.77	0.64	0.50	1.00	0.80	0.66	0.53	1.00	1.00	0.71	0.58
	ΔT	23	21	18	14	23	21	18	14	24	22	18	14	23	21	18	14	23	21	17	14	24	22	19	15
675	KW	1.05	1.05	1.05	1.06	1.17	1.17	1.16	1.17	1.30	1.30	1.30	1.31	1.44	1.44	1.44	1.45	1.60	1.60	1.59	1.60	1.78	1.78	1.78	1.79
	Amps	3.9	3.9	3.9	3.9	4.4	4.4	4.4	4.4	5.0	5.0	5.0	5.1	5.7	5.7	5.7	5.7	6.4	6.4	6.4	6.4	7.2	7.2	7.2	7.3
	HI PR	241	242	244	248	279	280	282	286	318	319	321	325	360	361	363	367	406	407	409	413	455	456	457	462
	LO PR	126	128	131	136	133	135	138	143	140	142	145	150	146	147	150	155	151	153	156	161	158	159	162	168
	MBh	18.7	19.0	19.5	20.3	18.5	18.8	19.3	20.2	18.1	18.3	18.9	19.7	17.3	17.5	18.1	18.9	16.3	16.5	17.1	17.9	15.4	15.6	16.2	17.0
75	S/T	0.82	0.74	0.61	0.47	1.00	0.75	0.62	0.48	1.00	0.77	0.64	0.50	1.00	0.79	0.66	0.52	1.00	1.00	0.68	0.54	1.00	1.00	0.73	0.59
	ΔT	22	20	17	13	22	20	17	13	23	21	17	13	22	20	17	13	22	20	16	13	23	21	18	14
	KW	1.06	1.06	1.06	1.06	1.17	1.17	1.17	1.18	1.30	1.30	1.30	1.31	1.44	1.44	1.44	1.45	1.60	1.60	1.60	1.61	1.79	1.78	1.78	1.79
	Amps	3.9	3.9	3.9	4.0	4.5	4.5	4.4	4.5	5.1	5.0	5.0	5.1	5.7	5.7	5.7	5.7	6.4	6.4	6.4	6.4	7.3	7.3	7.2	7.3
	HI PR	244	245	246	250	281	282	284	288	320	321	323	327	363	364	365	369	408	409	411	415	457	458	460	464
LO PR	128	130	133	138	136	137	141	146	142	144	147	152	148	149	153	158	153	155	158	163	160	162	165	170	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
550	MBh	18.2	18.5	19.0	19.8	18.1	18.3	18.9	19.7	17.6	17.9	18.4	19.2	16.8	17.1	17.6	18.4	15.8	16.1	16.6	17.4	14.9	15.2	15.7	16.5
	S/T	1.00	0.82	0.69	0.6	1.00	0.83	0.69	0.56	1.00	0.85	0.72	0.6	1.00	1.00	0.74	0.60	1.00	1.00	0.76	0.6	1.00	1.00	0.81	0.67
	ΔT	28	26	23	19	28	26	23	19	29	27	23	19	28	26	23	19	28	26	22	19	29	27	24	20
	KW	1.05	1.05	1.05	1.1	1.17	1.17	1.16	1.17	1.30	1.30	1.29	1.3	1.44	1.44	1.43	1.44	1.59	1.59	1.59	1.6	1.78	1.78	1.77	1.78
	Amps	3.9	3.9	3.9	3.9	4.4	4.4	4.4	4.5	5.0	5.0	5.0	5.0	5.7	5.7	5.6	5.7	6.4	6.4	6.4	6.4	7.2	7.2	7.2	7.2
600	HI PR	240	241	243	247	278	279	281	285	317	318	320	324	359	360	362	366	405	406	408	412	454	455	456	461
	LO PR	125	127	130	135	133	134	137	142	139	141	144	149	145	146	149	155	150	152	155	160	157	158	162	167
	MBh	18.4	18.7	19.2	20.0	18.3	18.5	19.1	19.9	17.8	18.1	18.6	19.4	17.0	17.3	17.8	18.6	16.0	16.3	16.8	17.6	15.1	15.4	15.9	16.7
	S/T	1.00	0.85	0.72	0.6	1.00	0.85	0.72	0.58	1.00	0.88	0.75	0.6	1.00	1.00	0.76	0.63	1.00	1.00	0.79	0.7	1.00	1.00	0.84	0.70
	ΔT	28	26	22	18	28	26	22	18	28	26	22	19	28	26	22	18	27	25	22	18	28	27	23	19
675	KW	1.06	1.06	1.06	1.1	1.17	1.17	1.17	1.18	1.30	1.30	1.30	1.3	1.44	1.44	1.44	1.45	1.60	1.60	1.59	1.6	1.78	1.78	1.78	1.79
	Amps	3.9	3.9	3.9	4.0	4.4	4.4	4.4	4.5	5.0	5.0	5.0	5.1	5.7	5.7	5.7	5.7	6.4	6.4	6.4	6.4	7.2	7.2	7.2	7.3
	HI PR	242	243	244	249	279	280	282	286	319	320	321	325	361	362	364	368	406	408	409	413	455	456	458	462
	LO PR	127	128	131	136	134	136	139	144	141	142	145	150	146	148	151	156	152	153	156	161	158	160	163	168
	MBh	18.8	19.1	19.6	20.4	18.6	18.9	19.4	20.2	18.2	18.4	19.0	19.8	17.4	17.6	18.2	19.0	16.4	16.6	17.2	18.0	15.5	15.7	16.3	17.1

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
550	MBh	18.5	18.8	19.3	20.2	18.4	18.6	19.2	20.0	17.9	18.2	18.7	19.5	17.1	17.4	17.9	18.7	16.1	16.4	16.9	17.7	15.2	15.5	16.0	16.8
	S/T	1.00	0.92	0.79	0.65	1.00	1.00	0.79	0.65	1.00	1.00	0.82	0.68	1.00	1.00	0.84	0.71	1.00	1.00	0.86	0.72	1.00	1.00	1.00	0.77
	ΔT	32	30	27	23	32	30	27	23	32	30	27	23	32	30	27	23	32	30	26	23	33	31	27	24
	KW	1.05	1.05	1.05	1.06	1.17	1.17	1.17	1.17	1.30	1.30	1.30	1.30	1.44	1.44	1.44	1.44	1.60	1.59	1.59	1.60	1.78	1.78	1.78	1.79
	Amps	3.9	3.9	3.9	3.9	4.4	4.4	4.4	4.5	5.0	5.0	5.0	5.1	5.7	5.7	5.7	5.7	6.4	6.4	6.4	6.4	7.2	7.2	7.2	7.3
600	HI PR	241	242	244	248	279	280	282	286	318	319	321	325	361	362	363	367	406	407	409	413	455	456	458	462
	LO PR	127	128	132	137	134	136	139	144	141	143	146	151	147	148	151	156	152	153	157	162	159	160	163	169
	MBh	18.7	19.0	19.5	20.4	18.6	18.8	19.4	20.2	18.1	18.4	18.9	19.7	17.3	17.6	18.1	18.9	16.3	16.6	17.1	17.9	15.4	15.7	16.2	17.0
	S/T	1.00	0.95	0.81	0.67	1.00	1.00	0.82	0.68	1.00	1.00	0.84	0.71	1.00	1.00	0.86	0.72	1.00	1.00	0.88	0.75	1.00	1.00	1.00	0.80
	ΔT	31	29	26	22	31	29	26	22	32	30	26	22	31	29	26	22	31	29	26	22	32	30	27	23
675	KW	1.06	1.06	1.06	1.07	1.18	1.18	1.17	1.18	1.30	1.30	1.30	1.31	1.44	1.44	1.44	1.45	1.60	1.60	1.60	1.61	1.78	1.78	1.78	1.79
	Amps	3.9	3.9	3.9	4.0	4.5	4.5	4.5	4.5	5.0	5.0	5.0	5.1	5.7	5.7	5.7	5.7	6.4	6.4	6.4	6.4	7.2	7.2	7.2	7.3
	HI PR	243	244	246	250	280	281	283	287	320	321	322	327	362	363	365	369	408	409	410	414	456	457	459	463
	LO PR	128	130	133	138	136	137	141	146	142	144	147	152	148	149	153	158	153	155	158	163	160	162	165	170
	MBh	19.1	19.4	19.9	20.7	18.9	19.2	19.7	20.5	18.5	18.7	19.3	20.1	17.7	17.9	18.5	19.3	16.7	16.9	17.5	18.3	15.8	16.0	16.6	17.4

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 KW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE										105										115											
		65					75					85					95					105					115						
		59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75		
		ENTERING INDOOR WET BULB TEMPERATURE																															
	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
700	MBh	24.5	24.9	25.6	-	24.3	24.7	25.4	-	23.7	24.0	24.7	-	22.6	22.9	23.7	-	21.3	21.6	22.3	-	20.1	20.4	21.1	-								
	S/T	0.63	0.56	0.43	-	0.63	0.56	0.43	-	0.66	0.59	0.46	-	0.68	0.60	0.48	-	1.00	0.62	0.50	-	1.00	0.67	0.55	-								
	ΔT	20	18	15	-	20	18	15	-	21	19	15	-	20	18	15	-	20	18	14	-	21	19	16	-								
	KW	1.41	1.40	1.40	-	1.57	1.57	1.57	-	1.75	1.75	1.75	-	1.95	1.95	1.95	-	2.17	2.17	2.17	-	2.43	2.43	2.43	-								
	Amps	5.3	5.3	5.2	-	6.0	6.0	6.0	-	6.9	6.8	6.8	-	7.8	7.8	7.7	-	8.8	8.8	8.8	-	10.0	10.0	10.0	-								
	HI PR	253	254	256	-	293	294	296	-	334	335	337	-	379	380	382	-	427	428	430	-	478	480	481	-								
	LO PR	121	123	126	-	128	130	133	-	135	136	139	-	140	142	145	-	145	147	150	-	152	153	156	-								
800	MBh	25.0	25.3	26.0	-	24.8	25.1	25.8	-	24.1	24.5	25.2	-	23.0	23.4	24.1	-	21.7	22.1	22.8	-	20.5	20.8	21.6	-								
	S/T	0.66	0.59	0.46	-	0.67	0.60	0.47	-	0.69	0.62	0.49	-	0.71	0.64	0.51	-	1.00	0.66	0.53	-	1.00	0.71	0.58	-								
	ΔT	19	17	14	-	19	17	13	-	19	17	14	-	19	17	13	-	19	17	13	-	20	18	14	-								
	KW	1.41	1.41	1.41	-	1.58	1.58	1.57	-	1.76	1.76	1.76	-	1.96	1.96	1.96	-	2.18	2.18	2.18	-	2.44	2.44	2.44	-								
	Amps	5.3	5.3	5.3	-	6.1	6.0	6.0	-	6.9	6.9	6.9	-	7.8	7.8	7.8	-	8.8	8.8	8.8	-	10.0	10.0	10.0	-								
	HI PR	255	257	258	-	295	296	298	-	337	338	339	-	381	382	384	-	429	430	432	-	481	482	484	-								
	LO PR	123	125	128	-	131	132	135	-	137	138	141	-	142	144	147	-	148	149	152	-	154	156	159	-								
900	MBh	25.5	25.9	26.6	-	25.3	25.6	26.4	-	24.7	25.0	25.7	-	23.6	23.9	24.6	-	22.3	22.6	23.3	-	21.0	21.4	22.1	-								
	S/T	0.67	0.60	0.47	-	0.68	0.60	0.48	-	0.70	0.63	0.50	-	1.00	0.65	0.52	-	1.00	0.67	0.54	-	1.00	0.72	0.59	-								
	ΔT	18	16	13	-	18	16	12	-	18	16	13	-	18	16	12	-	18	16	12	-	19	17	13	-								
	KW	1.42	1.42	1.42	-	1.59	1.58	1.58	-	1.77	1.77	1.76	-	1.97	1.97	1.96	-	2.19	2.19	2.19	-	2.45	2.45	2.45	-								
	Amps	5.3	5.3	5.3	-	6.1	6.1	6.1	-	6.9	6.9	6.9	-	7.8	7.8	7.8	-	8.8	8.8	8.8	-	10.0	10.0	10.0	-								
	HI PR	258	259	261	-	298	299	300	-	339	340	342	-	384	385	387	-	432	433	435	-	483	484	486	-								
	LO PR	126	127	130	-	133	135	138	-	140	141	144	-	145	146	149	-	150	152	155	-	157	158	161	-								
700	MBh	24.5	24.9	25.6	26.7	24.3	24.7	25.4	26.5	23.7	24.0	24.8	25.9	22.6	23.0	23.7	24.8	21.3	21.6	22.3	23.4	20.1	20.4	21.1	22.2								
	S/T	0.75	0.68	0.55	0.42	0.76	0.68	0.56	0.42	1.00	0.71	0.58	0.44	1.00	0.73	0.60	0.46	1.00	0.75	0.62	0.48	1.00	0.80	0.67	0.53								
	ΔT	25	23	19	15	25	23	19	15	25	23	19	15	25	23	19	15	24	22	19	15	26	24	20	16								
	KW	1.40	1.40	1.40	1.41	1.57	1.57	1.56	1.58	1.75	1.75	1.75	1.76	1.95	1.95	1.95	1.96	2.17	2.17	2.17	2.18	2.43	2.43	2.43	2.44								
	Amps	5.3	5.2	5.2	5.3	6.0	6.0	6.0	6.0	6.8	6.8	6.8	6.9	7.8	7.8	7.7	7.8	8.8	8.8	8.8	8.8	10.0	10.0	9.9	10.0								
	HI PR	253	254	256	261	293	294	296	300	334	335	337	342	379	380	382	386	427	428	430	434	479	480	481	486								
	LO PR	121	123	126	131	128	130	133	138	135	136	139	144	140	142	145	150	145	147	150	155	152	153	157	162								
800	MBh	25.0	25.3	26.1	27.2	24.8	25.1	25.8	26.9	24.1	24.5	25.2	26.3	23.1	23.4	24.1	25.2	21.7	22.1	22.8	23.9	20.5	20.9	21.6	22.7								
	S/T	0.78	0.71	0.58	0.45	0.79	0.72	0.59	0.46	1.00	0.74	0.61	0.48	1.00	0.76	0.63	0.50	1.00	0.78	0.65	0.52	1.00	1.00	0.70	0.57								
	ΔT	24	22	18	14	24	22	18	14	24	22	18	14	24	22	18	14	23	21	18	14	25	23	19	15								
	KW	1.41	1.41	1.41	1.42	1.58	1.58	1.57	1.59	1.76	1.76	1.76	1.77	1.96	1.96	1.96	1.97	2.18	2.18	2.18	2.19	2.44	2.44	2.44	2.45								
	Amps	5.3	5.3	5.3	5.3	6.0	6.0	6.0	6.1	6.9	6.9	6.9	6.9	7.8	7.8	7.8	7.8	8.8	8.8	8.8	8.8	10.0	10.0	10.0	10.0								
	HI PR	256	257	259	263	295	296	298	303	337	338	340	344	381	383	384	389	430	431	432	437	481	482	484	488								
	LO PR	123	125	128	133	131	132	135	140	137	138	141	147	142	144	147	152	148	149	152	157	154	156	159	164								
900	MBh	25.5	25.9	26.6	27.7	25.3	25.7	26.4	27.5	24.7	25.0	25.8	26.9	23.6	23.9	24.7	25.8	22.3	22.6	23.3	24.4	21.1	21.4	22.1	23.2								
	S/T	0.79	0.72	0.59	0.46	1.00	0.73	0.60	0.46	1.00	0.75	0.62	0.49	1.00	0.77	0.64	0.51	1.00	0.79	0.66	0.53	1.00	1.00	0.71	0.57								
	ΔT	23	21	17	13	23	21	17	13	23	21	17	13	23	21	17	13	22	20	17	13	24	22	18	14								
	KW	1.42	1.42	1.42	1.43	1.58	1.58	1.58	1.59	1.77	1.77	1.76	1.78	1.97	1.96	1.96	1.97	2.19	2.19	2.18	2.20	2.45	2.45	2.44	2.46								
	Amps	5.3	5.3	5.3	5.4	6.1	6.1	6.1	6.1	6.9	6.9	6.9	7.0	7.8	7.8	7.8	7.9	8.8	8.8	8.8	8.8	10.0	10.0	10.0	10.1								
	HI PR	258	259	261	265	298	299	301	305	339	340	342	346	384	385	387	391	432	433	435	439	483	485	486	491								
	LO PR	126	127	130	136	133	135	138	143	140	141	144	149	145	146	149	155	150	152	155	160	157	158	161	166								

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB		Outdoor Ambient Temperature															115																		
		65					75					85					95					105													
		Entering Indoor Wet Bulb Temperature																																	
Airflow	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75					
700	MBh	24.0	24.4	25.1	26.2	23.8	24.2	24.9	26.0	23.2	23.6	24.3	25.3	22.2	22.5	23.2	24.3	20.9	21.2	21.9	23.0	19.7	20.0	20.7	21.8	20.9	21.2	21.9	23.0	19.7	20.0	20.7	21.8		
	S/T	1.0	0.8	0.7	0.5	1.0	0.8	0.7	0.5	1.0	0.8	0.7	0.6	1.0	0.9	0.7	0.6	1.0	1.0	1.0	0.7	0.6	1.0	1.0	0.8	0.7	1.0	1.0	1.0	0.7	0.6	1.0	1.0	0.8	0.7
	ΔT	2.9	2.7	2.3	1.9	2.9	2.7	2.3	1.9	2.9	2.7	2.3	1.9	2.9	2.7	2.3	1.9	2.8	2.6	2.3	1.9	3.0	2.8	2.4	2.0	2.8	2.6	2.3	1.9	3.0	2.8	2.4	2.0		
	kW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.7	1.9	1.9	1.9	1.9	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4	
	Amps	5.2	5.2	5.2	5.2	5.9	5.9	5.9	6.0	6.7	6.7	6.7	6.8	7.6	7.6	7.6	7.7	8.6	8.6	8.6	8.7	9.8	9.8	9.8	9.9	8.6	8.6	8.6	8.7	9.8	9.8	9.8	9.9		
800	MBh	24.5	24.8	25.5	26.6	24.3	24.6	25.3	26.4	23.7	24.0	24.7	25.8	22.6	22.9	23.6	24.7	21.3	21.6	22.3	23.4	20.1	20.4	21.2	22.2	21.3	21.6	22.3	23.4	20.1	20.4	21.2	22.2		
	S/T	1.0	0.8	0.7	0.6	1.0	0.8	0.7	0.6	1.0	0.9	0.7	0.6	1.0	1.0	0.8	0.6	1.0	1.0	0.8	0.6	1.0	1.0	0.8	0.7	1.0	1.0	0.8	0.6	1.0	1.0	0.8	0.7		
	ΔT	2.8	2.6	2.2	1.8	2.8	2.6	2.2	1.8	2.8	2.6	2.2	1.8	2.7	2.6	2.2	1.8	2.7	2.5	2.2	1.8	2.8	2.6	2.3	1.9	2.7	2.5	2.2	1.8	2.8	2.6	2.3	1.9		
	kW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.7	1.9	1.9	1.9	1.9	2.0	2.2	2.2	2.2	2.4	2.4	2.4	2.4	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4		
	Amps	5.2	5.2	5.2	5.3	6.0	5.9	5.9	6.0	6.8	6.8	6.8	6.8	7.7	7.7	7.7	7.7	8.7	8.7	8.7	8.7	9.9	9.9	9.8	9.9	8.7	8.7	8.7	8.7	9.9	9.9	9.8	9.9		
900	MBh	25.0	25.3	26.1	27.1	24.8	25.1	25.8	26.9	24.2	24.5	25.2	26.3	23.1	23.5	24.2	25.2	21.8	22.2	22.9	23.9	20.6	21.0	21.7	22.8	21.8	22.2	22.9	23.9	20.6	21.0	21.7	22.8		
	S/T	1.0	0.8	0.7	0.6	1.0	0.9	0.7	0.6	1.0	0.9	0.7	0.6	1.0	1.0	0.8	0.6	1.0	1.0	0.8	0.6	1.0	1.0	0.8	0.7	1.0	1.0	0.8	0.6	1.0	1.0	0.8	0.7		
	ΔT	2.7	2.5	2.1	1.7	2.7	2.5	2.1	1.7	2.7	2.5	2.1	1.7	2.6	2.5	2.1	1.7	2.6	2.4	2.1	1.7	2.7	2.5	2.2	1.8	2.6	2.4	2.1	1.7	2.7	2.5	2.2	1.8		
	kW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.8	1.8	1.7	1.8	1.9	1.9	1.9	1.9	2.0	2.2	2.2	2.2	2.4	2.4	2.4	2.4	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4		
	Amps	5.2	5.2	5.2	5.3	6.0	6.0	6.0	6.0	6.8	6.8	6.8	6.9	7.7	7.7	7.7	7.7	8.7	8.7	8.7	8.7	9.9	9.9	9.9	9.9	8.7	8.7	8.7	8.7	9.9	9.9	9.9	9.9		

IDB		Outdoor Ambient Temperature															115																
		65					75					85					95					105											
		Entering Indoor Wet Bulb Temperature																															
Airflow	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75			
700	MBh	24.4	24.8	25.5	26.6	24.2	24.6	25.3	26.4	23.6	24.0	24.7	25.7	22.6	22.9	23.6	24.7	21.3	21.6	22.3	23.4	20.1	20.4	21.2	22.2	21.3	21.6	22.3	23.4	20.1	20.4	21.2	22.2
	S/T	1.0	0.9	0.8	0.6	1.0	0.9	0.8	0.6	1.0	1.0	0.8	0.7	1.0	1.0	0.8	0.7	1.0	1.0	0.8	0.7	1.0	1.0	0.8	0.7	1.0	1.0	0.8	0.7	1.0	1.0	0.8	0.7
	ΔT	3.3	3.1	2.7	2.3	3.2	3.1	2.7	2.3	3.3	3.1	2.7	2.3	3.2	3.1	2.7	2.3	3.2	3.0	2.7	2.3	3.3	3.1	2.8	2.4	3.2	3.0	2.7	2.3	3.3	3.1	2.8	2.4
	kW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.8	1.9	1.9	1.9	1.9	2.0	2.2	2.2	2.2	2.4	2.4	2.4	2.4	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4
	Amps	5.2	5.2	5.2	5.2	5.9	5.9	5.9	6.0	6.8	6.8	6.7	6.8	7.7	7.7	7.7	7.7	8.7	8.7	8.7	8.7	9.8	9.8	9.8	9.9	8.7	8.7	8.7	8.7	9.8	9.8	9.8	9.9
800	MBh	24.9	25.2	25.9	27.0	24.7	25.0	25.7	26.8	24.1	24.4	25.1	26.2	23.0	23.3	24.0	25.1	21.7	22.0	22.7	23.8	20.5	20.8	21.5	22.6	21.7	22.0	22.7	23.8	20.5	20.8	21.5	22.6
	S/T	1.0	0.9	0.8	0.7	1.0	1.0	0.8	0.7	1.0	1.0	0.8	0.7	1.0	1.0	0.9	0.7	1.0	1.0	0.9	0.7	1.0	1.0	0.8	0.7	1.0	1.0	0.9	0.7	1.0	1.0	0.8	0.7
	ΔT	3.1	2.9	2.6	2.2	3.1	2.9	2.6	2.2	3.2	3.0	2.6	2.2	3.1	2.9	2.6	2.2	3.1	2.9	2.5	2.2	3.2	3.0	2.7	2.3	3.1	2.9	2.5	2.2	3.2	3.0	2.7	2.3
	kW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.8	1.8	1.7	1.8	1.9	1.9	1.9	1.9	2.0	2.2	2.2	2.2	2.4	2.4	2.4	2.4	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4
	Amps	5.2	5.2	5.2	5.3	6.0	6.0	6.0	6.0	6.8	6.8	6.8	6.8	7.7	7.7	7.7	7.7	8.7	8.7	8.7	8.7	9.9	9.9	9.9	9.9	8.7	8.7	8.7	8.7	9.9	9.9	9.9	9.9
900	MBh	25.4	25.7	26.4	27.5	25.2	25.5	26.2	27.3	24.6	24.9	25.6	26.7	23.5	23.9	24.6	25.6	22.2	22.6	23.3	24.3	21.0	21.4	22.1	23.2	22.2	22.6	23.3	24.3	21.0	21.4	22.1	23.2
	S/T	1.0	0.9	0.8	0.7	1.0	1.0	0.8	0.7	1.0	1.0	0.8	0.7	1.0	1.0	0.9	0.7	1.0	1.0	0.9	0.7	1.0	1.0	0.8	0.7	1.0	1.0	0.9	0.7	1.0	1.0	0.8	0.7
	ΔT	3.0	2.8	2.5	2.1	3.0	2.8	2.5	2.1	3.1	2.9	2.5	2.1	3.0	2.8	2.5	2.1	3.0	2.8	2.4	2.1	3.1	2.9	2.6	2.2	3.1	2.9	2.4	2.1	3.1	2.9	2.6	2.2
	kW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.8	1.8	1.8	1.8	2.0	2.0	2.0	2.0	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4
	Amps	5.3	5.3	5.2	5.3	6.0	6.0	6.0	6.0	6.8	6.8	6.8	6.9	7.7	7.7	7.7	7.7	8.7	8.7	8.7	8.7	9.9	9.9	9.9	9.9	8.7	8.7	8.7	8.7	9.9	9.9	9.9	9.9

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																							
		65						75						85						95						105						115					
		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79
70	MBh	24.5	24.9	25.6	26.0	26.4	26.7	24.3	24.7	25.4	25.8	26.4	26.9	24.1	24.5	25.2	25.7	23.7	24.0	24.7	25.2	25.7	26.3	22.6	22.9	23.7	24.1	24.6	25.1	25.6	26.1	26.6	27.1	27.6	28.1		
	S/T	0.63	0.56	0.43	-	-	-	0.63	0.56	0.43	-	-	-	0.66	0.59	0.46	-	0.68	0.60	0.48	-	-	-	1.00	0.60	0.48	-	-	-	-	-	-	-	-			
	ΔT	20	18	15	-	-	-	20	18	15	-	-	-	21	19	15	-	20	18	15	-	-	-	20	18	14	-	-	-	-	-	-	-	-			
	KW	1.41	1.40	1.40	-	-	-	1.57	1.57	1.57	-	-	-	1.75	1.75	1.75	-	1.95	1.95	1.95	-	-	-	2.17	2.17	2.17	-	-	-	-	-	-	-	-			
	Amps	5.3	5.3	5.2	-	-	-	6.0	6.0	6.0	-	-	-	6.9	6.8	6.8	-	7.8	7.8	7.7	-	-	-	8.8	8.8	8.8	-	-	-	-	-	-	-	-			
800	MBh	25.0	25.3	26.0	26.4	26.7	27.2	24.8	25.1	25.8	26.4	26.9	24.1	24.5	25.2	25.7	23.7	24.0	24.7	25.2	25.7	26.3	22.6	22.9	23.7	24.1	24.6	25.1	25.6	26.1	26.6	27.1	27.6	28.1			
	S/T	0.66	0.59	0.46	-	-	-	0.67	0.60	0.47	-	-	-	0.69	0.62	0.49	-	0.71	0.64	0.51	-	-	-	1.00	0.64	0.51	-	-	-	-	-	-	-	-			
	ΔT	19	17	14	-	-	-	19	17	13	-	-	-	19	17	14	-	19	17	13	-	-	-	19	17	13	-	-	-	-	-	-	-	-			
	KW	1.41	1.41	1.41	-	-	-	1.58	1.58	1.57	-	-	-	1.76	1.76	1.76	-	1.96	1.96	1.96	-	-	-	2.18	2.18	2.18	-	-	-	-	-	-	-	-	-		
	Amps	5.3	5.3	5.3	-	-	-	6.1	6.0	6.0	-	-	-	6.9	6.9	6.9	-	7.8	7.8	7.8	-	-	-	8.8	8.8	8.8	-	-	-	-	-	-	-	-	-		
900	MBh	25.5	25.9	26.6	27.0	27.4	27.8	25.3	25.6	26.4	27.0	27.4	25.0	25.3	26.1	26.5	24.7	25.0	25.7	26.2	26.6	27.1	23.6	23.9	24.6	25.0	25.4	25.8	26.2	26.6	27.0	27.4	27.8	28.2			
	S/T	0.67	0.60	0.47	-	-	-	0.68	0.60	0.48	-	-	-	0.70	0.63	0.50	-	0.72	0.65	0.52	-	-	-	1.00	0.65	0.52	-	-	-	-	-	-	-	-			
	ΔT	18	16	13	-	-	-	18	16	12	-	-	-	18	16	12	-	18	16	12	-	-	-	18	16	12	-	-	-	-	-	-	-	-			
	KW	1.42	1.42	1.42	-	-	-	1.59	1.58	1.58	-	-	-	1.77	1.77	1.76	-	1.97	1.97	1.96	-	-	-	2.19	2.19	2.19	-	-	-	-	-	-	-	-	-		
	Amps	5.3	5.3	5.3	-	-	-	6.1	6.1	6.1	-	-	-	6.9	6.9	6.9	-	7.8	7.8	7.8	-	-	-	8.8	8.8	8.8	-	-	-	-	-	-	-	-	-		

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																							
		65						75						85						95						105						115					
		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79
700	MBh	24.5	24.9	25.6	26.0	26.4	26.7	24.3	24.7	25.4	25.8	26.4	26.9	24.1	24.5	25.2	25.7	23.7	24.0	24.7	25.2	25.7	26.3	22.6	22.9	23.7	24.1	24.6	25.1	25.6	26.1	26.6	27.1	27.6	28.1		
	S/T	0.75	0.68	0.55	0.42	-	-	0.76	0.68	0.56	0.42	-	-	1.00	0.71	0.58	0.44	1.00	0.73	0.60	0.48	-	-	-	1.00	0.76	0.63	0.50	-	-	-	-	-	-	-		
	ΔT	25	23	19	15	-	-	25	23	19	15	-	-	25	23	19	15	25	23	19	15	-	-	-	24	22	19	15	-	-	-	-	-	-	-		
	KW	1.40	1.40	1.40	1.41	-	-	1.57	1.57	1.56	1.58	-	-	1.75	1.75	1.75	-	1.95	1.95	1.95	-	-	-	2.17	2.17	2.17	-	-	-	-	-	-	-	-	-		
	Amps	5.3	5.2	5.2	5.3	-	-	6.0	6.0	6.0	6.0	-	-	6.8	6.8	6.8	-	7.8	7.8	7.7	-	-	-	8.8	8.8	8.8	-	-	-	-	-	-	-	-	-		
800	MBh	25.0	25.3	26.1	27.2	27.8	28.2	24.8	25.1	25.8	26.4	26.9	24.1	24.5	25.2	25.7	23.7	24.0	24.7	25.2	25.7	26.3	22.6	22.9	23.7	24.1	24.6	25.1	25.6	26.1	26.6	27.1	27.6	28.1			
	S/T	0.78	0.71	0.58	0.45	-	-	0.79	0.72	0.59	0.46	-	-	1.00	0.74	0.61	0.48	1.00	0.76	0.63	0.50	-	-	-	1.00	0.78	0.65	0.52	-	-	-	-	-	-	-		
	ΔT	24	22	18	14	-	-	24	22	18	14	-	-	24	22	18	14	24	22	18	14	-	-	-	23	21	18	14	-	-	-	-	-	-	-		
	KW	1.41	1.41	1.41	1.42	-	-	1.58	1.58	1.57	1.59	-	-	1.76	1.76	1.76	-	1.96	1.96	1.96	-	-	-	2.18	2.18	2.18	-	-	-	-	-	-	-	-	-		
	Amps	5.3	5.3	5.3	5.3	-	-	6.0	6.0	6.0	6.1	-	-	6.9	6.9	6.9	-	7.8	7.8	7.8	-	-	-	8.8	8.8	8.8	-	-	-	-	-	-	-	-	-		
900	MBh	25.5	25.9	26.6	27.7	28.3	28.7	25.3	25.6	26.4	27.0	27.4	25.0	25.3	26.1	26.5	24.7	25.0	25.7	26.2	26.6	27.1	23.6	23.9	24.6	25.0	25.4	25.8	26.2	26.6	27.0	27.4	27.8	28.2			
	S/T	0.79	0.72	0.59	0.46	-	-	1.00	0.73	0.60	0.46	-	-	1.00	0.75	0.62	0.49	1.00	0.77	0.64	0.51	-	-	-	1.00	0.79	0.66	0.53	-	-	-	-	-	-	-		
	ΔT	23	21	17	13	-	-	23	21	17	13	-	-	23	21	17	13	23	21	17	13	-	-	-	22	20	17	13	-	-	-	-	-	-	-		
	KW	1.42	1.42	1.42	1.43	-	-	1.58	1.58	1.58	1.59	-	-	1.77	1.77	1.76	1.78	1.97	1.96	1.96	-	-	-	2.19	2.19	2.19	-	-	-	-	-	-	-	-	-		
	Amps	5.3	5.3	5.3	5.4	-	-	6.1	6.1	6.1	6.1	-	-	6.9	6.9	6.9	-	7.8	7.8	7.8	-	-	-	8.8	8.8	8.8	-	-	-	-	-	-	-	-	-		

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
700	MBh	24.7	25.0	25.7	26.8	24.5	24.8	25.5	26.6	23.8	24.2	24.9	26.0	22.7	23.1	23.8	24.9	21.4	21.7	22.5	23.6	20.2	20.5	21.3	22.4
	S/T	0.87	0.80	0.67	0.5	1.00	0.80	0.67	0.54	1.00	0.83	0.70	0.6	1.00	0.84	0.72	0.58	1.00	1.00	0.74	0.6	1.00	1.00	0.79	0.65
	ΔT	29	27	23	20	29	27	23	20	29	27	24	20	29	27	23	20	29	27	23	19	30	28	24	21
	KW	1.41	1.40	1.40	1.4	1.57	1.57	1.57	1.58	1.75	1.75	1.75	1.8	1.95	1.95	1.95	1.96	2.17	2.17	2.17	2.2	2.43	2.43	2.43	2.44
	Amps	5.3	5.3	5.2	5.3	6.0	6.0	6.0	6.1	6.9	6.8	6.8	6.9	7.8	7.8	7.7	7.8	8.8	8.8	8.8	8.8	10.0	10.0	10.0	10.0
800	HI PR	254	255	257	261	293	294	296	301	335	336	338	342	380	381	382	387	428	429	431	435	479	480	482	486
	LO PR	122	123	126	131	129	130	133	139	135	137	140	145	141	142	145	150	146	147	150	156	153	154	157	162
	MBh	25.1	25.5	26.2	27.3	24.9	25.2	26.0	27.1	24.3	24.6	25.3	26.4	23.2	23.5	24.2	25.3	21.8	22.2	22.9	24.0	20.6	21.0	21.7	22.8
	S/T	1.00	0.83	0.70	0.6	1.00	0.84	0.71	0.57	1.00	0.86	0.73	0.6	1.00	0.88	0.75	0.62	1.00	1.00	0.77	0.6	1.00	1.00	0.82	0.69
	ΔT	28	26	22	18	28	26	22	18	28	26	23	19	28	26	22	18	28	26	22	18	29	27	23	19
900	KW	1.41	1.41	1.41	1.4	1.58	1.58	1.57	1.59	1.76	1.76	1.76	1.8	1.96	1.96	1.96	1.97	2.18	2.18	2.18	2.2	2.44	2.44	2.44	2.45
	Amps	5.3	5.3	5.3	5.3	6.0	6.0	6.0	6.1	6.9	6.9	6.9	6.9	7.8	7.8	7.8	7.8	8.8	8.8	8.8	8.9	10.0	10.0	10.0	10.0
	HI PR	256	257	259	263	296	297	299	303	337	338	340	344	382	383	385	389	430	431	433	437	481	483	484	489
	LO PR	124	125	128	133	131	133	136	141	138	139	142	147	143	144	147	152	148	150	153	158	155	156	159	164
	MBh	25.7	26.0	26.7	27.8	25.4	25.8	26.5	27.6	24.8	25.2	25.9	27.0	23.7	24.1	24.8	25.9	22.4	22.7	23.5	24.6	21.2	21.5	22.2	23.3

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
700	MBh	25.1	25.4	26.1	27.2	24.9	25.2	25.9	27.0	24.2	24.6	25.3	26.4	23.1	23.5	24.2	25.3	21.8	22.2	22.9	24.0	20.6	20.9	21.7	22.8
	S/T	1.00	0.89	0.76	0.63	1.00	0.90	0.77	0.63	1.00	1.00	0.79	0.66	1.00	1.00	0.81	0.68	1.00	1.00	0.83	0.70	1.00	1.00	1.00	0.75
	ΔT	33	31	27	24	33	31	27	23	33	31	28	24	33	31	27	23	33	31	27	23	34	32	28	24
	KW	1.41	1.41	1.40	1.42	1.57	1.57	1.57	1.58	1.76	1.76	1.75	1.76	1.96	1.95	1.95	1.96	2.18	2.18	2.17	2.19	2.44	2.44	2.43	2.45
	Amps	5.3	5.3	5.3	5.3	6.0	6.0	6.0	6.1	6.9	6.9	6.8	6.9	7.8	7.8	7.8	7.8	8.8	8.8	8.8	8.8	10.0	10.0	10.0	10.0
800	HI PR	255	256	258	262	295	296	297	302	336	337	339	343	381	382	384	388	429	430	432	436	480	481	483	488
	LO PR	123	125	128	133	131	132	135	140	137	139	142	147	142	144	147	152	148	149	152	157	154	156	159	164
	MBh	25.5	25.9	26.6	27.7	25.3	25.6	26.4	27.5	24.7	25.0	25.7	26.8	23.6	23.9	24.7	25.8	22.3	22.6	23.3	24.4	21.0	21.4	22.1	23.2
	S/T	1.00	0.93	0.80	0.66	1.00	0.93	0.80	0.67	1.00	1.00	0.83	0.69	1.00	1.00	0.85	0.71	1.00	1.00	0.87	0.73	1.00	1.00	1.00	0.78
	ΔT	32	30	26	22	32	30	26	22	32	30	26	23	32	30	26	22	32	30	26	22	33	31	27	23
900	KW	1.42	1.42	1.41	1.42	1.58	1.58	1.58	1.59	1.76	1.76	1.76	1.77	1.96	1.96	1.96	1.97	2.19	2.18	2.18	2.19	2.45	2.44	2.44	2.45
	Amps	5.3	5.3	5.3	5.3	6.1	6.1	6.0	6.1	6.9	6.9	6.9	6.9	7.8	7.8	7.8	7.9	8.8	8.8	8.8	8.9	10.0	10.0	10.0	10.1
	HI PR	257	258	260	265	297	298	300	304	338	339	341	346	383	384	386	390	431	432	434	438	483	484	485	490
	LO PR	126	127	130	135	133	134	137	143	139	141	144	149	145	146	149	154	150	151	154	160	157	158	161	166
	MBh	26.1	26.4	27.1	28.2	25.9	26.2	26.9	28.0	25.2	25.6	26.3	27.4	24.1	24.5	25.2	26.3	22.8	23.1	23.9	25.0	21.6	21.9	22.7	23.8

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 KW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												105												115											
		65						75						85						95						105						115					
		AIRFLOW		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
70	875	MBh	29.3	29.7	30.6	31.0	29.0	29.5	30.3	30.7	28.3	28.7	29.6	29.9	27.0	27.4	28.2	28.6	25.3	25.8	26.6	27.0	23.9	24.3	25.2	25.6	-	-	-	-	-	-	-	-			
		S/T	0.59	0.52	0.38	-	0.60	0.52	0.39	-	0.62	0.55	0.42	-	1.00	0.57	0.43	-	1.00	0.59	0.46	-	1.00	0.64	0.51	-	-	-	-	-	-	-	-	-			
		ΔT	20	18	15	-	20	18	15	-	20	18	15	-	20	18	15	-	20	18	14	-	21	19	15	-	-	-	-	-	-	-	-	-			
		KW	1.76	1.75	1.75	-	1.95	1.95	1.95	-	2.17	2.17	2.17	-	2.41	2.41	2.41	-	2.68	2.68	2.67	-	2.99	2.99	2.99	-	-	-	-	-	-	-	-	-			
		Amps	6.4	6.4	6.4	-	7.3	7.3	7.3	-	8.3	8.3	8.3	-	9.4	9.4	9.4	-	10.6	10.6	10.6	-	12.0	12.0	12.0	-	-	-	-	-	-	-	-	-			
	HI PR	250	251	252	-	289	290	292	-	330	331	333	-	375	376	377	-	422	424	425	-	474	475	476	-	-	-	-	-	-	-	-	-				
	LO PR	124	125	128	-	131	133	136	-	138	139	142	-	143	145	148	-	149	150	154	-	156	157	160	-	-	-	-	-	-	-	-	-				
	MBh	29.7	30.1	31.0	-	29.4	29.8	30.7	-	28.7	29.1	29.9	-	27.3	27.8	28.6	-	25.7	26.1	27.0	-	24.3	24.7	25.6	-	-	-	-	-	-	-	-	-				
	S/T	0.65	0.58	0.44	-	0.66	0.58	0.45	-	0.68	0.61	0.47	-	1.00	0.63	0.49	-	1.00	0.65	0.51	-	1.00	0.70	0.56	-	-	-	-	-	-	-	-	-				
	ΔT	19	17	13	-	19	17	13	-	19	17	14	-	19	17	13	-	18	17	13	-	20	18	14	-	-	-	-	-	-	-	-	-				
1000	KW	1.77	1.77	1.76	-	1.96	1.96	1.96	-	2.18	2.18	2.18	-	2.42	2.42	2.42	-	2.69	2.69	2.68	-	3.00	3.00	3.00	-	-	-	-	-	-	-	-	-				
	Amps	6.4	6.4	6.4	-	7.3	7.3	7.3	-	8.3	8.3	8.3	-	9.4	9.4	9.4	-	10.6	10.6	10.6	-	12.1	12.1	12.1	-	-	-	-	-	-	-	-	-				
	HI PR	252	253	254	-	291	292	294	-	332	333	335	-	377	378	379	-	425	426	427	-	476	477	478	-	-	-	-	-	-	-	-	-				
	LO PR	125	127	130	-	133	135	138	-	140	141	144	-	145	147	150	-	151	152	155	-	157	159	162	-	-	-	-	-	-	-	-	-				
	MBh	30.1	30.6	31.4	-	29.9	30.3	31.2	-	29.1	29.5	30.4	-	27.8	28.2	29.1	-	26.2	26.6	27.5	-	24.7	25.1	26.0	-	-	-	-	-	-	-	-	-				
S/T	0.68	0.61	0.48	-	0.69	0.61	0.48	-	0.71	0.64	0.51	-	1.00	0.66	0.53	-	1.00	0.68	0.55	-	1.00	0.73	0.60	-	-	-	-	-	-	-	-	-					
ΔT	18	16	13	-	18	16	12	-	18	16	13	-	18	16	12	-	17	16	12	-	19	17	13	-	-	-	-	-	-	-	-	-					
1125	KW	1.78	1.77	1.77	-	1.97	1.97	1.97	-	2.19	2.19	2.19	-	2.43	2.43	2.43	-	2.70	2.70	2.69	-	3.01	3.01	3.01	-	-	-	-	-	-	-	-	-				
	Amps	6.5	6.5	6.4	-	7.4	7.4	7.3	-	8.4	8.4	8.3	-	9.5	9.5	9.4	-	10.7	10.7	10.7	-	12.1	12.1	12.1	-	-	-	-	-	-	-	-	-				
	HI PR	254	255	257	-	293	294	296	-	334	335	337	-	379	380	382	-	427	428	429	-	478	479	481	-	-	-	-	-	-	-	-	-				
	LO PR	128	129	132	-	135	137	140	-	142	143	146	-	147	149	152	-	153	154	157	-	160	161	164	-	-	-	-	-	-	-	-	-				
	MBh	29.7	30.1	30.6	31.9	29.1	29.5	30.3	31.7	28.3	28.7	29.6	30.9	27.0	27.4	28.3	29.6	25.4	25.8	26.7	28.0	23.9	24.3	25.2	26.5	-	-	-	-	-	-	-	-				
S/T	0.72	0.64	0.51	0.37	0.72	0.65	0.52	0.38	1.00	0.67	0.54	0.40	1.00	0.69	0.56	0.42	1.00	0.71	0.58	0.44	1.00	1.00	0.63	0.49	-	-	-	-	-	-	-	-					
ΔT	24	22	19	15	24	22	19	15	24	22	19	15	24	22	19	15	24	22	18	15	25	23	19	16	-	-	-	-	-	-	-	-					
875	KW	1.76	1.75	1.75	1.77	1.95	1.95	1.95	1.96	2.17	2.17	2.17	2.18	2.41	2.41	2.41	2.42	2.68	2.68	2.67	2.69	2.99	2.99	2.99	3.00	-	-	-	-	-	-	-	-				
	Amps	6.4	6.4	6.3	6.4	7.3	7.3	7.2	7.3	8.3	8.3	8.3	8.3	9.4	9.4	9.3	9.4	10.6	10.6	10.6	10.6	12.0	12.0	12.0	12.1	-	-	-	-	-	-	-	-				
	HI PR	250	251	253	257	289	290	292	296	330	331	333	338	375	376	378	382	423	424	425	430	474	475	477	481	-	-	-	-	-	-	-	-				
	LO PR	124	125	128	134	131	133	136	141	138	139	142	148	143	145	148	153	149	150	154	159	156	157	160	166	-	-	-	-	-	-	-	-				
	MBh	29.7	30.1	31.0	32.3	29.4	29.9	30.7	32.1	28.7	29.1	30.0	31.3	27.4	27.8	28.6	30.0	25.8	26.2	27.0	28.4	24.3	24.7	25.6	26.9	-	-	-	-	-	-	-	-				
S/T	0.78	0.70	0.57	0.43	0.78	0.71	0.58	0.44	1.00	0.73	0.60	0.46	1.00	0.75	0.62	0.48	1.00	0.77	0.64	0.50	1.00	1.00	0.69	0.55	-	-	-	-	-	-	-	-					
ΔT	23	21	17	14	23	21	17	14	23	21	18	14	23	21	17	14	22	21	17	14	24	22	18	15	-	-	-	-	-	-	-	-					
1000	KW	1.77	1.76	1.76	1.78	1.96	1.96	1.96	1.97	2.18	2.18	2.18	2.19	2.42	2.42	2.42	2.43	2.69	2.69	2.68	2.70	3.00	3.00	3.00	3.01	-	-	-	-	-	-	-	-				
	Amps	6.4	6.4	6.4	6.5	7.3	7.3	7.3	7.4	8.3	8.3	8.3	8.4	9.4	9.4	9.4	9.5	10.6	10.6	10.6	10.7	12.1	12.1	12.0	12.1	-	-	-	-	-	-	-	-				
	HI PR	252	253	255	259	291	292	294	298	332	334	335	340	377	378	380	384	425	426	428	432	476	477	479	483	-	-	-	-	-	-	-	-				
	LO PR	126	127	130	135	133	135	138	143	140	141	144	150	145	147	150	155	151	152	155	161	158	159	162	167	-	-	-	-	-	-	-	-				
	MBh	30.2	30.6	31.5	32.8	29.9	30.3	31.2	32.5	29.1	29.6	30.4	31.8	27.8	28.2	29.1	30.4	26.2	26.6	27.5	28.8	24.7	25.2	26.0	27.4	-	-	-	-	-	-	-	-				
S/T	0.81	0.73	0.60	0.46	1.00	0.74	0.61	0.47	1.00	0.77	0.63	0.49	1.00	0.78	0.65	0.51	1.00	0.81	0.67	0.53	1.00	1.00	0.72	0.58	-	-	-	-	-	-	-	-					
ΔT	22	20	17	13	22	20	17	13	22	20	17	13	22	20	16	13	21	20	16	13	23	21	17	14	-	-	-	-	-	-	-	-					
1125	KW	1.77	1.77	1.77	1.78	1.97	1.97	1.97	1.98	2.19	2.19	2.19	2.20	2.43	2.43	2.43	2.44	2.70	2.70	2.69	2.71	3.01	3.01	3.00	3.02	-	-	-	-	-	-	-	-				
	Amps	6.5	6.4	6.4	6.5	7.4	7.4	7.3	7.4	8.4	8.4	8.3	8.4	9.5	9.5	9.4	9.5	10.7	10.7	10.7	10.7	12.1	12.1	12.1	12.2	-	-	-	-	-	-	-	-				
	HI PR	254	255	257	261	293	294	296	300	335	336	337	342	379	380	382	386	427	428	430	434	478	479	481	485	-	-	-	-	-	-	-	-				
	LO PR	128	129	132	137	135	137	140	145	142	143	146	152	147	149	152	157	153	154	157	163	160	161	164	169	-	-	-	-	-	-	-	-				
	MBh	29.7	30.1	30.6	31.9	29.1	29.5	30.3	31.7	28.3	28.7	29.6	30.9	27.0	27.4	28.3	29.6	25.4	25.8	26.7	28.0	23.9	24.3	25.2	26.5	-	-	-	-	-	-	-	-				

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	29.5	29.9	30.8	32.1	29.2	29.6	30.5	31.8	28.4	28.9	29.7	31.1	27.1	27.5	28.4	29.8	25.5	25.9	26.8	28.1	24.0	24.5	25.3	26.7
	S/T	1.00	0.77	0.63	0.5	1.00	0.77	0.64	0.50	1.00	0.80	0.66	0.5	1.00	1.00	0.68	0.54	1.00	1.00	0.70	0.6	1.00	1.00	0.75	0.61
	ΔT	28	26	23	19	28	26	23	19	28	26	23	19	28	26	23	19	28	26	22	19	29	27	23	20
	KW	1.76	1.75	1.75	1.8	1.95	1.95	1.95	1.96	2.17	2.17	2.17	2.2	2.41	2.41	2.41	2.42	2.68	2.68	2.67	2.7	2.99	2.99	2.99	3.00
	Amps	6.4	6.4	6.3	6.4	7.3	7.3	7.3	7.3	8.3	8.3	8.3	8.3	9.4	9.4	9.4	9.4	10.6	10.6	10.6	10.6	12.0	12.0	12.0	12.1
HI PR	250	251	253	257	290	291	292	297	331	332	334	338	375	376	378	382	423	424	426	430	474	475	477	481	
LO PR	124	126	129	134	132	133	136	142	138	140	143	148	144	145	149	154	149	151	154	159	156	158	161	166	
875	MBh	29.9	30.3	31.1	32.5	29.6	30.0	30.9	32.2	28.8	29.2	30.1	31.5	27.5	27.9	28.8	30.1	25.9	26.3	27.2	28.5	24.4	24.8	25.7	27.1
	S/T	1.00	0.82	0.69	0.6	1.00	0.83	0.70	0.56	1.00	0.85	0.72	0.6	1.00	1.00	0.74	0.60	1.00	1.00	0.76	0.6	1.00	1.00	0.81	0.67
	ΔT	27	25	22	18	27	25	21	18	27	25	22	18	27	25	21	18	26	25	21	18	28	26	22	19
	KW	1.77	1.76	1.76	1.8	1.96	1.96	1.96	1.97	2.18	2.18	2.18	2.2	2.42	2.42	2.42	2.43	2.69	2.69	2.68	2.7	3.00	3.00	3.00	3.01
	Amps	6.4	6.4	6.4	6.5	7.3	7.3	7.3	7.4	8.3	8.3	8.3	8.4	9.4	9.4	9.4	9.5	10.6	10.6	10.6	10.7	12.1	12.1	12.1	12.1
HI PR	252	253	255	259	292	293	295	299	333	334	336	340	377	378	380	385	425	426	428	432	476	477	479	484	
LO PR	126	128	131	136	134	135	138	144	140	142	145	150	146	147	150	156	151	153	156	161	158	160	163	168	
1000	MBh	30.3	30.7	31.6	32.9	30.1	30.5	31.3	32.7	29.3	29.7	30.6	31.9	28.0	28.4	29.3	30.6	26.4	26.8	27.7	29.0	24.9	25.3	26.2	27.5
	S/T	1.00	0.86	0.72	0.6	1.00	0.86	0.73	0.59	1.00	0.89	0.76	0.6	1.00	1.00	0.77	0.63	1.00	1.00	0.80	0.7	1.00	1.00	0.85	0.71
	ΔT	26	24	21	17	26	24	21	17	26	24	21	17	26	24	21	17	26	24	20	17	27	25	21	18
	KW	1.78	1.77	1.77	1.8	1.97	1.97	1.97	1.98	2.19	2.19	2.19	2.2	2.43	2.43	2.43	2.44	2.70	2.70	2.69	2.7	3.01	3.01	3.01	3.02
	Amps	6.5	6.5	6.4	6.5	7.4	7.4	7.3	7.4	8.4	8.4	8.3	8.4	9.5	9.5	9.4	9.5	10.7	10.7	10.7	10.7	12.1	12.1	12.1	12.2
HI PR	254	255	257	262	294	295	297	301	335	336	338	342	379	380	382	387	427	428	430	434	478	479	481	486	
LO PR	128	130	133	138	136	137	140	146	142	144	147	152	148	149	152	158	153	155	158	163	160	162	165	170	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
875	MBh	30.0	30.4	31.3	32.6	29.7	30.1	31.0	32.3	28.9	29.3	30.2	31.6	27.6	28.0	28.9	30.2	26.0	26.4	27.3	28.6	24.5	25.0	25.8	27.2
	S/T	1.00	0.86	0.73	0.59	1.00	0.87	0.74	0.60	1.00	1.00	0.76	0.62	1.00	1.00	0.78	0.64	1.00	1.00	0.80	0.66	1.00	1.00	1.00	0.71
	ΔT	31	30	26	23	31	30	26	23	32	30	26	23	31	30	26	23	31	29	26	22	32	30	27	24
	KW	1.76	1.76	1.76	1.77	1.96	1.96	1.95	1.97	2.18	2.18	2.17	2.19	2.42	2.41	2.41	2.43	2.68	2.68	2.68	2.69	3.00	2.99	2.99	3.01
	Amps	6.4	6.4	6.4	6.4	7.3	7.3	7.3	7.3	8.3	8.3	8.3	8.3	9.4	9.4	9.4	9.4	10.6	10.6	10.6	10.7	12.0	12.0	12.0	12.1
HI PR	251	252	254	259	291	292	294	298	332	333	335	339	376	377	379	384	424	425	427	431	475	476	478	483	
LO PR	126	128	131	136	134	135	138	144	140	142	145	150	146	147	150	156	151	153	156	161	158	160	163	168	
1000	MBh	30.0	31.0	32.0	33.0	30.0	30.0	31.0	33.0	29.0	30.0	31.0	32.0	28.0	28.0	29.0	31.0	26.0	27.0	28.0	29.0	25.0	25.0	26.0	28.0
	S/T	1.00	0.92	0.79	0.65	1.00	1.00	0.80	0.66	1.00	1.00	0.82	0.68	1.00	1.00	0.84	0.70	1.00	1.00	0.86	0.72	1.00	1.00	1.00	0.77
	ΔT	30	29	25	22	30	29	25	22	31	29	25	22	30	28	25	22	30	28	25	21	31	29	26	22
	KW	1.77	1.77	1.77	1.78	1.97	1.97	1.96	1.98	2.19	2.19	2.18	2.20	2.43	2.42	2.42	2.44	2.69	2.69	2.69	2.70	3.01	3.00	3.00	3.02
	Amps	6.4	6.4	6.4	6.5	7.3	7.3	7.3	7.4	8.3	8.3	8.3	8.4	9.4	9.4	9.4	9.5	10.7	10.7	10.6	10.7	12.1	12.1	12.1	12.1
HI PR	253	255	256	261	293	294	296	300	334	335	337	341	379	380	381	386	426	427	429	434	477	479	480	485	
LO PR	128	129	133	138	135	137	140	145	142	144	147	152	148	149	152	158	153	155	158	163	160	161	165	170	
1125	MBh	31.0	31.0	32.0	33.0	31.0	31.0	32.0	33.0	30.0	30.0	31.0	32.0	28.0	29.0	30.0	31.0	27.0	27.0	28.0	29.0	25.0	26.0	27.0	28.0
	S/T	1.00	0.96	0.82	0.68	1.00	1.00	0.83	0.69	1.00	1.00	0.85	0.71	1.00	1.00	0.87	0.73	1.00	1.00	0.90	0.76	1.00	1.00	1.00	0.81
	ΔT	29	28	24	21	29	28	24	21	30	28	24	21	29	28	24	21	29	27	24	20	30	28	25	22
	KW	1.78	1.78	1.77	1.79	1.98	1.97	1.97	1.99	2.20	2.20	2.19	2.21	2.44	2.43	2.43	2.45	2.70	2.70	2.70	2.71	3.01	3.01	3.01	3.02
	Amps	6.5	6.5	6.5	6.5	7.4	7.4	7.4	7.4	8.4	8.4	8.4	8.4	9.5	9.5	9.5	9.5	10.7	10.7	10.7	10.7	12.1	12.1	12.1	12.2
HI PR	256	257	258	263	295	296	298	302	336	337	339	343	381	382	383	388	428	430	431	436	480	481	482	487	
LO PR	130	131	135	140	137	139	142	147	144	146	149	154	150	151	154	160	155	157	160	165	162	163	167	172	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																							
		65						75						85						95						105						115					
		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79
875	MBh	29.1	29.5	30.4	-	-	28.8	29.2	30.1	-	-	28.1	28.5	29.4	-	-	26.8	27.2	28.0	-	-	25.2	25.6	26.5	-	-	23.7	24.1	25.0	-	-						
	S/T	0.63	0.55	0.41	-	-	0.63	0.56	0.42	-	-	0.66	0.58	0.44	-	-	0.68	0.60	0.46	-	-	1.00	0.62	0.48	-	-	1.00	0.68	0.54	-	-						
	ΔT	20	18	15	-	-	20	18	15	-	-	20	19	15	-	-	20	18	15	-	-	20	18	15	-	-	21	19	16	-	-						
	KW	1.72	1.72	1.72	-	-	1.91	1.91	1.91	-	-	2.13	2.12	2.12	-	-	2.36	2.35	2.35	-	-	2.61	2.61	2.61	-	-	2.92	2.92	2.91	-	-						
	Amps	6.2	6.2	6.2	-	-	7.1	7.1	7.1	-	-	8.1	8.0	8.0	-	-	9.1	9.1	9.1	-	-	10.3	10.3	10.3	-	-	11.7	11.7	11.7	-	-						
	HI PR	244	245	247	-	-	282	283	285	-	-	323	324	325	-	-	366	367	369	-	-	413	414	416	-	-	463	464	466	-	-						
	LO PR	123	124	127	-	-	130	132	135	-	-	137	138	141	-	-	142	144	147	-	-	148	149	152	-	-	154	156	159	-	-						
	MBh	29.5	29.9	30.8	-	-	29.2	29.6	30.5	-	-	28.5	28.9	29.7	-	-	27.2	27.6	28.4	-	-	25.6	26.0	26.8	-	-	24.1	24.5	25.4	-	-						
	S/T	0.69	0.61	0.47	-	-	0.70	0.62	0.48	-	-	0.72	0.64	0.50	-	-	1.00	0.66	0.52	-	-	1.00	0.69	0.55	-	-	1.00	0.74	0.60	-	-						
	ΔT	19	17	14	-	-	19	17	14	-	-	19	17	14	-	-	19	17	14	-	-	19	17	13	-	-	20	18	15	-	-						
	KW	1.73	1.73	1.73	-	-	1.92	1.92	1.92	-	-	2.14	2.13	2.13	-	-	2.37	2.36	2.36	-	-	2.62	2.62	2.62	-	-	2.93	2.93	2.92	-	-						
	Amps	6.2	6.2	6.2	-	-	7.1	7.1	7.1	-	-	8.1	8.1	8.1	-	-	9.2	9.2	9.1	-	-	10.3	10.3	10.3	-	-	11.7	11.7	11.7	-	-						
	HI PR	246	247	249	-	-	284	286	287	-	-	325	326	328	-	-	368	369	371	-	-	415	416	418	-	-	465	466	468	-	-						
	LO PR	124	126	129	-	-	132	133	136	-	-	138	140	143	-	-	144	145	149	-	-	149	151	154	-	-	156	158	161	-	-						
	MBh	29.9	30.3	31.2	-	-	29.7	30.1	31.0	-	-	28.9	29.3	30.2	-	-	27.6	28.0	28.9	-	-	26.0	26.4	27.3	-	-	24.6	25.0	25.8	-	-						
	S/T	0.73	0.65	0.51	-	-	0.73	0.65	0.51	-	-	0.76	0.68	0.54	-	-	1.00	0.70	0.56	-	-	1.00	0.72	0.58	-	-	1.00	0.78	0.63	-	-						
	ΔT	18	16	13	-	-	18	16	13	-	-	18	16	13	-	-	18	16	13	-	-	18	16	12	-	-	19	17	14	-	-						
	KW	1.74	1.74	1.73	-	-	1.93	1.93	1.92	-	-	2.14	2.14	2.14	-	-	2.37	2.37	2.37	-	-	2.63	2.63	2.63	-	-	2.94	2.93	2.93	-	-						
	Amps	6.3	6.3	6.3	-	-	7.2	7.2	7.1	-	-	8.1	8.1	8.1	-	-	9.2	9.2	9.2	-	-	10.4	10.4	10.4	-	-	11.8	11.8	11.7	-	-						
	HI PR	248	249	251	-	-	286	288	289	-	-	327	328	330	-	-	370	371	373	-	-	417	418	420	-	-	467	468	470	-	-						
	LO PR	126	128	131	-	-	134	135	138	-	-	140	142	145	-	-	146	147	151	-	-	151	153	156	-	-	158	160	163	-	-						

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																							
		65						75						85						95						105						115					
		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79
875	MBh	29.1	29.5	30.4	31.7	-	28.9	29.3	30.1	31.5	-	-	28.1	28.5	29.4	30.7	26.8	27.6	28.1	29.4	25.2	25.6	26.5	27.8	23.7	24.1	25.0	26.3	-	-							
	S/T	0.76	0.68	0.54	0.39	-	0.77	0.69	0.55	0.40	-	-	1.00	0.72	0.57	0.43	1.00	0.74	0.60	0.45	1.00	0.76	0.62	0.47	1.00	1.00	0.67	0.52	-	-							
	ΔT	24	22	19	15	-	24	22	19	15	-	-	25	23	19	16	24	22	19	15	24	22	19	15	25	23	20	16	-	-							
	KW	1.72	1.72	1.71	1.73	-	1.91	1.91	1.91	1.92	-	-	2.12	2.12	2.12	2.13	2.36	2.35	2.35	2.36	2.61	2.61	2.61	2.62	2.92	2.92	2.91	2.93	-	-							
	Amps	6.2	6.2	6.2	6.2	-	7.1	7.1	7.1	7.1	-	-	8.0	8.0	8.0	8.1	9.1	9.1	9.1	9.2	10.3	10.3	10.3	10.3	11.7	11.7	11.7	11.7	-	-							
	HI PR	244	245	247	251	-	283	284	285	290	-	-	323	324	326	330	366	367	369	373	413	414	416	420	463	464	466	470	-	-							
	LO PR	123	124	127	132	-	130	132	135	140	-	-	137	138	141	146	142	144	147	152	148	149	152	157	154	156	159	164	-	-							
	MBh	29.5	29.9	30.8	32.1	-	29.2	29.6	30.5	31.8	-	-	28.5	28.9	29.8	31.1	27.2	27.6	28.4	29.8	25.6	26.0	26.9	28.2	24.1	24.5	25.4	26.7	-	-							
	S/T	0.82	0.75	0.60	0.46	-	0.83	0.75	0.61	0.46	-	-	1.00	0.78	0.64	0.49	1.00	0.80	0.66	0.51	1.00	0.82	0.68	0.53	1.00	1.00	0.73	0.59	-	-							
	ΔT	23	21	18	14	-	23	21	18	14	-	-	23	22	18	14	23	21	18	14	23	21	18	14	24	22	19	15	-	-							
	KW	1.73	1.73	1.72	1.74	-	1.92	1.92	1.92	1.93	-	-	2.13	2.13	2.13	2.14	2.37	2.36	2.36	2.37	2.62	2.62	2.62	2.63	2.93	2.92	2.92	2.94	-	-							
	Amps	6.2	6.2	6.2	6.3	-	7.1	7.1	7.1	7.2	-	-	8.1	8.1	8.1	8.1	9.2	9.1	9.1	9.2	10.3	10.3	10.3	10.4	11.7	11.7	11.7	11.8	-	-							
	HI PR	246	247	249	253	-	285	286	287	292	-	-	325	326	328	332	368	369	371	375	415	416	418	422	465	466	468	472	-	-							
	LO PR	124	126	129	134	-	132	133	137	142	-	-	138	140	143	148	144	145	149	154	149	151	154	159	156	158	161	166	-	-							
	MBh	30.0	30.4	31.2	32.6	-	29.7	30.1	31.0	32.3	-	-	28.9	29.3	30.2	31.5	27.6	28.0	28.9	30.2	26.0	26.4	27.3	28.6	24.6	25.0	25.9	27.2	-	-							
	S/T	0.86	0.78	0.64	0.49	-	1.00	0.79	0.65	0.50	-	-	1.00	0.81	0.67	0.52	1.00	0.83	0.69	0.54	1.00	0.86	0.72	0.57	1.00	1.00	0.77	0.62	-	-							
	ΔT	22	20	17	13	-	22	20	17	13	-	-	22	21	17	13	22	20	17	13	22	20	17	13	23	21	18	14	-	-							
	KW	1.74	1.74	1.73	1.75	-	1.93	1.93	1.92	1.94	-	-	2.14	2.14	2.14	2.15	2.37	2.37	2.37	2.38	2.63	2.63	2.63	2.64	2.93	2.93	2.93	2.94	-	-							
	Amps	6.3	6.3	6.3	6.3	-	7.2	7.1	7.1	7.2	-	-	8.1	8.1	8.1	8.2	9.2	9.2	9.2	9.2	10.4	10.4	10.4	10.4	11.8	11.8	11.7	11.8	-	-							
	HI PR	248	249	251	255	-	287	288	289	294	-	-	327	328	330	334	370	371	373	377	417	418	420	424	467	468	470	474	-	-							
	LO PR	126	128	131	136	-	134	135	139	144	-	-	140	142	145	150	146	147	151	156	151	153	156	161	158	160	163	168	-	-							

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	29.3	29.7	30.5	31.9	29.0	29.4	30.3	31.6	28.2	28.7	29.5	30.9	26.9	27.3	28.2	29.5	25.3	25.8	26.6	27.9	23.9	24.3	25.2	26.5
	S/T	1.00	0.81	0.67	0.5	1.00	0.82	0.68	0.53	1.00	0.85	0.70	0.6	1.00	0.87	0.73	0.58	1.00	1.00	0.75	0.6	1.00	1.00	0.80	0.65
	ΔT	28	27	23	19	28	27	23	19	29	27	23	20	28	27	23	19	28	26	23	19	29	27	24	20
	KW	1.72	1.72	1.72	1.7	1.91	1.91	1.91	1.92	2.12	2.12	2.12	2.1	2.36	2.35	2.35	2.37	2.61	2.61	2.61	2.6	2.92	2.92	2.91	2.93
	Amps	6.2	6.2	6.2	6.2	7.1	7.1	7.1	7.1	8.1	8.0	8.0	8.1	9.1	9.1	9.1	9.2	10.3	10.3	10.3	10.3	11.7	11.7	11.7	11.7
	HI PR	245	246	247	252	283	284	286	290	323	324	326	330	367	368	370	374	414	415	416	421	464	465	466	471
LO PR	123	125	128	133	131	132	135	140	137	139	142	147	143	144	147	153	148	150	153	158	155	156	160	165	
875	MBh	29.6	30.1	30.9	32.3	29.4	29.8	30.7	32.0	28.6	29.0	29.9	31.2	27.3	27.7	28.6	29.9	25.7	26.1	27.0	28.3	24.3	24.7	25.5	26.9
	S/T	1.00	0.88	0.73	0.6	1.00	0.88	0.74	0.59	1.00	0.91	0.77	0.6	1.00	1.00	0.79	0.64	1.00	1.00	0.81	0.7	1.00	1.00	0.86	0.72
	ΔT	27	25	22	18	27	25	22	18	28	26	22	19	27	25	22	18	27	25	22	18	28	26	23	19
	KW	1.73	1.73	1.72	1.7	1.92	1.92	1.92	1.93	2.13	2.13	2.13	2.1	2.37	2.36	2.36	2.38	2.62	2.62	2.62	2.6	2.93	2.93	2.92	2.94
	Amps	6.2	6.2	6.2	6.3	7.1	7.1	7.1	7.2	8.1	8.1	8.1	8.1	9.2	9.2	9.2	9.2	10.3	10.3	10.3	10.4	11.7	11.7	11.7	11.8
	HI PR	247	248	249	254	285	286	288	292	325	326	328	332	369	370	372	376	416	417	418	423	466	467	468	473
LO PR	125	126	130	135	132	134	137	142	139	140	144	149	144	146	149	154	150	151	155	160	157	158	161	167	
1000	MBh	30.1	30.5	31.4	32.7	29.8	30.3	31.1	32.5	29.1	29.5	30.4	31.7	27.8	28.2	29.1	30.4	26.2	26.6	27.5	28.8	24.7	25.1	26.0	27.3
	S/T	1.00	0.91	0.77	0.6	1.00	0.92	0.78	0.63	1.00	0.94	0.80	0.7	1.00	1.00	0.82	0.67	1.00	1.00	0.85	0.7	1.00	1.00	0.90	0.75
	ΔT	26	25	21	17	26	24	21	17	27	25	21	18	26	24	21	17	26	24	21	17	27	25	22	18
	KW	1.74	1.74	1.73	1.8	1.93	1.93	1.92	1.94	2.14	2.14	2.14	2.2	2.37	2.37	2.37	2.38	2.63	2.63	2.63	2.6	2.94	2.93	2.93	2.95
	Amps	6.3	6.3	6.3	6.3	7.2	7.2	7.1	7.2	8.1	8.1	8.1	8.2	9.2	9.2	9.2	9.2	10.4	10.4	10.4	10.4	11.8	11.8	11.7	11.8
	HI PR	249	250	251	256	287	288	290	294	327	328	330	334	371	372	374	378	418	419	420	425	468	469	470	475
LO PR	127	128	132	137	134	136	139	144	141	142	146	151	146	148	151	156	152	153	157	162	159	160	163	169	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
875	MBh	29.8	30.2	31.0	32.4	29.5	29.9	30.8	32.1	28.7	29.1	30.0	31.3	27.4	27.8	28.7	30.0	25.8	26.2	27.1	28.4	24.4	24.8	25.7	27.0
	S/T	1.00	0.92	0.78	0.63	1.00	0.92	0.78	0.64	1.00	1.00	0.81	0.66	1.00	1.00	0.83	0.68	1.00	1.00	0.85	0.70	1.00	1.00	1.00	0.76
	ΔT	32	30	27	23	32	30	27	23	32	30	27	23	32	30	27	23	32	30	26	23	33	31	28	24
	KW	1.72	1.72	1.72	1.73	1.91	1.91	1.91	1.92	2.13	2.13	2.12	2.14	2.36	2.36	2.36	2.37	2.62	2.62	2.61	2.63	2.92	2.92	2.92	2.93
	Amps	6.2	6.2	6.2	6.3	7.1	7.1	7.1	7.1	8.1	8.1	8.0	8.1	9.1	9.1	9.1	9.2	10.3	10.3	10.3	10.4	11.7	11.7	11.7	11.7
	HI PR	246	247	248	253	284	285	287	291	325	326	327	332	368	369	371	375	415	416	417	422	465	466	467	472
LO PR	125	127	130	135	132	134	137	142	139	141	144	149	145	146	149	154	150	151	155	160	157	158	161	167	
1000	MBh	30.1	30.5	31.4	32.7	29.9	30.3	31.2	32.5	29.1	29.5	30.4	31.7	27.8	28.2	29.1	30.4	26.2	26.6	27.5	28.8	24.8	25.2	26.0	27.4
	S/T	1.00	0.98	0.84	0.69	1.00	1.00	0.85	0.70	1.00	1.00	0.87	0.72	1.00	1.00	0.89	0.74	1.00	1.00	0.92	0.77	1.00	1.00	1.00	0.82
	ΔT	31	29	26	22	31	29	26	22	31	29	26	22	31	29	26	22	31	29	25	22	32	30	26	23
	KW	1.73	1.73	1.73	1.74	1.92	1.92	1.92	1.93	2.14	2.14	2.13	2.15	2.37	2.37	2.36	2.38	2.63	2.63	2.62	2.64	2.93	2.93	2.93	2.94
	Amps	6.3	6.3	6.2	6.3	7.1	7.1	7.1	7.2	8.1	8.1	8.1	8.2	9.2	9.2	9.2	9.2	10.4	10.4	10.3	10.4	11.7	11.7	11.7	11.8
	HI PR	248	249	251	255	286	287	289	293	327	328	329	334	370	371	373	377	417	418	420	424	467	468	470	474
LO PR	127	128	131	137	134	136	139	144	141	142	145	151	146	148	151	156	152	153	156	162	159	160	163	168	
1125	MBh	30.6	31.0	31.9	33.2	30.3	30.7	31.6	32.9	29.6	30.0	30.9	32.2	28.3	28.7	29.5	30.9	26.7	27.1	28.0	29.3	25.2	25.6	26.5	27.8
	S/T	1.00	1.00	0.87	0.73	1.00	1.00	0.88	0.73	1.00	1.00	0.91	0.76	1.00	1.00	0.93	0.78	1.00	1.00	0.92	0.80	1.00	1.00	1.00	0.86
	ΔT	30	28	25	21	30	28	25	21	30	28	25	21	30	28	25	21	30	28	24	21	31	29	26	22
	KW	1.74	1.74	1.74	1.75	1.93	1.93	1.93	1.94	2.15	2.15	2.14	2.16	2.38	2.38	2.37	2.39	2.64	2.63	2.63	2.65	2.94	2.94	2.93	2.95
	Amps	6.3	6.3	6.3	6.3	7.2	7.2	7.2	7.2	8.2	8.1	8.1	8.2	9.2	9.2	9.2	9.3	10.4	10.4	10.4	10.4	11.8	11.8	11.8	11.8
	HI PR	250	251	253	257	288	289	291	295	329	330	331	336	372	373	375	379	419	420	422	426	469	470	472	476
LO PR	129	130	133	139	136	138	141	146	143	144	147	153	148	150	153	158	154	155	158	164	161	162	165	170	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												105												115											
		65						75						85						95						105						115					
		AIRFLOW		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71						
70	MBh	34.8	35.3	36.3	-	34.5	35.0	36.0	-	33.6	34.1	35.1	-	32.0	32.5	33.5	-	30.1	30.6	31.6	-	28.4	28.8	29.9	-												
	S/T	0.59	0.52	0.38	-	0.60	0.52	0.39	-	0.62	0.55	0.42	-	0.64	0.57	0.43	-	1.00	0.59	0.46	-	1.00	0.64	0.51	-												
	ΔT	19	17	14	-	19	17	14	-	19	18	14	-	19	17	14	-	19	17	14	-	20	18	15	-												
	KW	2.09	2.09	2.09	-	2.32	2.32	2.32	-	2.58	2.58	2.58	-	2.87	2.86	2.86	-	3.18	3.18	3.17	-	3.55	3.55	3.54	-												
	Amps	7.6	7.6	7.5	-	8.6	8.6	8.6	-	9.8	9.8	9.8	-	11.1	11.1	11.1	-	12.5	12.5	12.5	-	14.2	14.2	14.2	-												
HI PR	254	255	257	-	294	295	297	-	336	337	339	-	381	382	384	-	430	431	433	-	482	483	485	-													
LO PR	121	123	126	-	129	130	133	-	135	137	140	-	141	142	145	-	146	147	151	-	153	154	157	-													
MBh	35.3	35.7	36.8	-	34.9	35.4	36.5	-	34.0	34.5	35.6	-	32.5	33.0	34.0	-	30.6	31.0	32.1	-	28.8	29.3	30.3	-													
S/T	0.65	0.58	0.44	-	0.66	0.58	0.45	-	0.68	0.61	0.47	-	0.70	0.63	0.49	-	1.00	0.65	0.51	-	1.00	0.70	0.56	-													
ΔT	18	16	13	-	18	16	13	-	18	17	13	-	18	16	13	-	18	16	13	-	19	17	14	-													
KW	2.10	2.10	2.10	-	2.34	2.33	2.33	-	2.60	2.59	2.59	-	2.88	2.88	2.87	-	3.19	3.19	3.19	-	3.56	3.56	3.55	-													
Amps	7.6	7.6	7.6	-	8.7	8.7	8.7	-	9.9	9.9	9.9	-	11.2	11.2	11.1	-	12.6	12.6	12.6	-	14.3	14.3	14.3	-													
HI PR	256	257	259	-	296	297	299	-	338	339	341	-	384	385	386	-	432	433	435	-	484	485	487	-													
LO PR	123	125	128	-	130	132	135	-	137	138	141	-	142	144	147	-	148	149	152	-	154	156	159	-													
MBh	35.8	36.3	37.3	-	35.5	36.0	37.0	-	34.6	35.1	36.1	-	33.0	33.5	34.5	-	31.1	31.6	32.6	-	29.4	29.9	30.9	-													
S/T	0.68	0.61	0.48	-	0.69	0.61	0.48	-	0.71	0.64	0.51	-	1.00	0.66	0.53	-	1.00	0.68	0.55	-	1.00	0.73	0.60	-													
ΔT	17	15	12	-	17	15	12	-	17	16	12	-	17	15	12	-	17	15	12	-	18	16	13	-													
KW	2.11	2.11	2.11	-	2.35	2.34	2.34	-	2.61	2.60	2.60	-	2.89	2.89	2.88	-	3.20	3.20	3.20	-	3.57	3.57	3.56	-													
Amps	7.7	7.7	7.6	-	8.7	8.7	8.7	-	9.9	9.9	9.9	-	11.2	11.2	11.2	-	12.7	12.6	12.6	-	14.3	14.3	14.3	-													
HI PR	258	259	261	-	298	300	301	-	340	342	343	-	386	387	389	-	434	435	437	-	486	488	489	-													
LO PR	125	127	130	-	132	134	137	-	139	140	143	-	144	146	149	-	150	151	154	-	156	158	161	-													

IDB		OUTDOOR AMBIENT TEMPERATURE												105												115											
		65						75						85						95						105						115					
		AIRFLOW		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71						
75	MBh	34.8	35.3	36.3	37.9	34.5	35.0	36.0	37.6	33.6	34.1	35.1	36.7	32.0	32.5	33.6	35.2	35.2	30.1	30.6	31.7	33.2	28.4	28.9	29.9	31.5											
	S/T	0.72	0.64	0.51	0.37	0.72	0.65	0.52	0.38	1.00	0.67	0.54	0.40	1.00	0.69	0.56	0.42	0.48	1.00	0.71	0.58	0.44	1.00	0.76	0.63	0.49											
	ΔT	23	21	18	15	23	21	18	15	23	22	18	15	23	21	18	15	15	23	21	18	14	24	22	19	15											
	KW	2.09	2.09	2.08	2.10	2.32	2.32	2.32	2.33	2.58	2.58	2.58	2.59	2.86	2.86	2.86	2.88	2.88	3.18	3.18	3.17	3.19	3.55	3.54	3.54	3.56											
	Amps	7.6	7.6	7.5	8.0	8.6	8.6	8.7	8.7	9.8	9.8	9.8	10.0	11.1	11.1	11.1	11.2	11.2	12.5	12.5	12.5	13.0	14.2	14.2	14.2	14.3											
HI PR	254	255	257	262	294	295	297	302	336	337	339	344	382	383	384	389	389	430	430	431	433	482	484	485	490												
LO PR	121	123	126	131	129	130	133	138	135	137	140	145	141	142	145	150	150	146	147	147	151	153	154	157	162												
MBh	35.3	35.8	36.8	38.4	35.0	35.5	36.5	38.1	34.1	34.5	35.6	37.2	32.5	33.0	34.0	35.6	35.6	30.6	31.1	32.1	33.7	28.8	29.3	30.4	32.0												
S/T	0.78	0.70	0.57	0.43	0.78	0.71	0.58	0.44	1.00	0.73	0.60	0.46	1.00	0.75	0.62	0.48	0.48	1.00	0.77	0.64	0.50	1.00	1.00	0.69	0.55												
ΔT	22	20	17	14	22	20	17	13	22	20	17	14	22	20	17	13	13	22	20	17	13	23	21	18	14												
KW	2.10	2.10	2.10	2.11	2.33	2.33	2.33	2.35	2.59	2.59	2.59	2.61	2.88	2.87	2.87	2.89	2.89	3.19	3.19	3.18	3.20	3.56	3.56	3.55	3.57												
Amps	7.6	7.6	7.6	8.0	8.7	8.7	8.7	9.0	9.9	9.9	9.8	10.0	11.2	11.2	11.1	11.0	11.0	12.6	12.6	12.6	13.0	14.3	14.3	14.3	14.0												
HI PR	256	258	259	264	297	298	299	304	339	340	341	346	384	385	387	391	391	433	434	434	440	485	486	487	492												
LO PR	123	125	128	133	130	132	135	140	137	138	141	147	142	144	147	152	152	148	149	149	152	154	156	159	164												
MBh	35.8	36.3	37.4	38.9	35.5	36.0	37.0	38.6	34.6	35.1	36.1	37.7	33.0	33.5	34.6	36.2	36.2	31.1	31.6	32.7	34.2	29.4	29.9	30.9	32.5												
S/T	0.81	0.73	0.60	0.46	0.82	0.74	0.61	0.47	1.00	0.77	0.63	0.49	1.00	0.78	0.65	0.51	0.51	1.00	0.81	0.67	0.53	1.00	1.00	0.72	0.58												
ΔT	21	19	16	13	21	19	16	13	21	20	16	13	21	19	16	13	13	21	19	16	12	22	20	17	13												
KW	2.11	2.11	2.11	2.12	2.34	2.34	2.34	2.36	2.60	2.60	2.60	2.62	2.89	2.88	2.88	2.90	2.90	3.20	3.20	3.19	3.21	3.57	3.57	3.56	3.58												
Amps	7.7	7.7	7.6	8.0	8.7	8.7	8.7	9.0	9.9	9.9	9.9	10.0	11.2	11.2	11.2	11.0	11.0	12.6	12.6	12.6	13.0	14.3	14.3	14.3	14.0												
HI PR	259	260	261	266	299	300	302	306	341	342	344	348	386	387	389	393	393	435	436	436	442	487	488	490	494												
LO PR	125	127	130	135	132	134	137	142	139	140	143	149	144	146	149	154	154	150	151	151	154	156	158	161	166												

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	35.0	35.5	36.5	38.1	34.7	35.2	36.2	37.8	33.8	34.3	35.3	36.9	32.2	32.7	33.7	35.3	30.3	30.8	31.8	33.4	28.6	29.0	30.1	31.7
	S/T	0.84	0.77	0.63	0.5	1.00	0.77	0.64	0.50	1.00	0.80	0.66	0.5	1.00	0.82	0.68	0.54	1.00	1.00	0.70	0.6	1.00	1.00	0.75	0.61
	ΔT	2.09	2.25	2.22	1.9	2.7	2.5	2.2	1.8	2.7	2.5	2.2	1.9	2.7	2.5	2.2	1.8	2.7	2.5	2.2	1.8	2.8	2.6	2.3	1.9
	KW	2.09	2.09	2.09	2.1	2.32	2.32	2.32	2.34	2.58	2.58	2.58	2.6	2.86	2.86	2.86	2.88	3.18	3.18	3.17	3.2	3.55	3.55	3.54	3.56
	Amps	7.6	7.6	7.5	8.0	8.6	8.6	8.6	9.0	9.8	9.8	9.8	10.0	11.1	11.1	11.1	11.0	12.5	12.5	12.5	13.0	14.2	14.2	14.2	14.0
1050	HI PR	255	256	258	262	295	296	298	302	337	338	340	344	382	383	385	389	431	432	434	438	483	484	486	490
	LO PR	122	123	126	132	129	131	134	139	136	137	140	145	141	143	146	151	146	148	151	156	153	155	158	163
	MBh	35.5	35.9	37.0	38.6	35.1	35.6	36.7	38.3	34.2	34.7	35.8	37.4	32.7	33.2	34.2	35.8	30.8	31.2	32.3	33.9	29.0	29.5	30.5	32.1
	S/T	1.00	0.82	0.69	0.6	1.00	0.83	0.70	0.56	1.00	0.85	0.72	0.6	1.00	0.87	0.74	0.60	1.00	1.00	0.76	0.6	1.00	1.00	0.81	0.67
	ΔT	2.6	2.4	2.1	1.7	2.6	2.4	2.1	1.8	2.6	2.4	2.1	1.8	2.6	2.4	2.1	1.7	2.6	2.4	2.1	1.7	2.7	2.5	2.2	1.8
1200	KW	2.10	2.10	2.10	2.1	2.34	2.33	2.33	2.35	2.60	2.59	2.59	2.6	2.88	2.87	2.87	2.89	3.19	3.19	3.19	3.2	3.56	3.56	3.55	3.57
	Amps	7.6	7.6	7.6	8.0	8.7	8.7	8.7	9.0	9.9	9.9	9.9	10.0	11.2	11.2	11.2	11.0	12.6	12.6	12.6	13.0	14.3	14.3	14.3	14.0
	HI PR	257	258	260	264	297	298	300	304	339	340	342	346	384	385	387	392	433	434	436	440	485	486	488	492
	LO PR	124	125	128	133	131	132	136	141	137	139	142	147	143	144	147	153	148	150	153	158	155	156	160	165
	MBh	36.0	36.5	37.5	39.1	35.7	36.2	37.2	38.8	34.8	35.3	36.3	37.9	33.2	33.7	34.7	36.3	31.3	31.8	32.8	34.4	29.6	30.1	31.1	32.7
1350	S/T	1.00	0.86	0.72	0.6	1.00	0.86	0.73	0.59	1.00	0.89	0.76	0.6	1.00	1.00	0.77	0.63	1.00	1.00	0.80	0.7	1.00	1.00	0.85	0.71
	ΔT	2.5	2.3	2.0	1.7	2.5	2.3	2.0	1.7	2.5	2.4	2.0	1.7	2.5	2.3	2.0	1.6	2.5	2.3	2.0	1.6	2.6	2.4	2.1	1.7
	KW	2.11	2.11	2.11	2.1	2.35	2.34	2.34	2.36	2.61	2.60	2.60	2.6	2.89	2.89	2.88	2.90	3.20	3.20	3.20	3.2	3.57	3.57	3.56	4.00
	Amps	7.7	7.7	7.6	8.0	9.0	8.7	8.7	9.0	9.9	9.9	9.9	10.0	11.2	11.2	11.2	11.0	12.7	12.6	12.6	13.0	14.3	14.3	14.3	14.0
	HI PR	259	260	262	266	299	300	302	306	341	342	344	348	386	387	389	394	435	436	438	442	487	488	490	494
LO PR	126	127	130	135	133	134	138	143	139	141	144	149	145	146	149	155	150	152	155	160	157	158	162	167	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
85	MBh	35.6	36.1	37.1	38.7	35.3	35.8	36.8	38.4	34.4	34.9	35.9	37.5	32.8	33.3	34.3	35.9	30.9	31.4	32.4	34.0	29.1	29.6	30.7	32.3
	S/T	1.00	0.86	0.73	0.59	1.00	0.87	0.74	0.60	1.00	1.00	0.76	0.62	1.00	1.00	0.78	0.64	1.00	1.00	0.80	0.66	1.00	1.00	1.00	0.71
	ΔT	3.1	2.9	2.5	2.2	3.0	2.9	2.5	2.2	3.1	2.9	2.6	2.2	3.0	2.9	2.5	2.2	3.0	2.8	2.5	2.2	3.1	3.0	2.6	2.3
	KW	2.10	2.09	2.09	2.11	2.33	2.33	2.32	2.34	2.59	2.59	2.58	2.60	2.87	2.87	2.86	2.88	3.18	3.18	3.18	3.20	3.55	3.55	3.55	3.56
	Amps	7.6	7.6	7.6	8.0	8.7	8.6	8.6	9.0	9.8	9.8	9.8	10.0	11.1	11.1	11.1	11.0	12.6	12.6	12.5	13.0	14.3	14.2	14.2	14.0
1050	HI PR	256	257	259	263	296	297	299	303	338	339	341	345	383	384	386	391	432	433	435	439	484	485	487	491
	LO PR	124	125	128	133	131	133	136	141	137	139	142	147	143	144	148	153	148	150	153	158	155	157	160	165
	MBh	36.0	36.5	37.6	39.2	35.7	36.2	37.3	38.8	34.8	35.3	36.3	37.9	33.3	33.7	34.8	36.4	31.3	31.8	32.9	34.5	29.6	30.1	31.1	32.7
	S/T	1.00	0.92	0.79	0.65	1.00	0.93	0.80	0.66	1.00	1.00	0.82	0.68	1.00	1.00	0.84	0.70	1.00	1.00	0.86	0.72	1.00	1.00	1.00	0.77
	ΔT	2.9	2.8	2.4	2.1	2.9	2.8	2.4	2.1	3.0	2.8	2.5	2.1	2.9	2.8	2.4	2.1	2.9	2.7	2.4	2.1	3.0	2.8	2.5	2.2
1200	KW	2.11	2.11	2.10	2.12	2.34	2.34	2.33	2.35	2.60	2.60	2.59	2.61	2.88	2.88	2.88	2.89	3.20	3.19	3.19	3.21	3.56	3.56	3.56	3.58
	Amps	7.6	7.6	7.6	8.0	8.7	8.7	8.7	9.0	9.9	9.9	9.9	10.0	11.2	11.2	11.2	11.0	12.6	12.6	12.6	13.0	14.3	14.3	14.3	14.0
	HI PR	258	259	261	265	298	299	301	306	340	341	343	348	385	387	388	393	434	435	437	442	486	487	489	494
	LO PR	125	127	130	135	133	134	137	143	139	141	144	149	145	146	149	154	150	152	155	160	157	158	161	167
	MBh	36.6	37.1	38.1	39.7	36.3	36.8	37.8	39.4	35.4	35.9	36.9	38.5	33.8	34.3	35.3	36.9	31.9	32.4	33.4	35.0	30.1	30.6	31.7	33.3
1350	S/T	1.00	0.96	0.82	0.68	1.00	1.00	0.83	0.69	1.00	1.00	0.85	0.71	1.00	1.00	0.87	0.73	1.00	1.00	0.89	0.76	1.00	1.00	1.00	0.81
	ΔT	2.9	2.7	2.3	2.0	2.9	2.7	2.3	2.0	2.9	2.7	2.4	2.0	2.8	2.7	2.3	2.0	2.8	2.6	2.3	2.0	2.9	2.8	2.4	2.1
	KW	2.12	2.12	2.11	2.13	2.35	2.35	2.34	2.36	2.61	2.61	2.60	2.62	2.89	2.89	2.89	2.90	3.21	3.20	3.20	3.22	3.57	3.57	3.57	3.59
	Amps	7.7	7.7	7.7	8.0	8.8	8.7	8.7	9.0	9.9	9.9	9.9	10.0	11.2	11.2	11.2	11.0	12.7	12.7	12.6	13.0	14.4	14.3	14.3	14.0
	HI PR	260	261	263	268	300	301	303	308	342	343	345	350	388	389	390	395	436	437	439	444	488	489	491	496
LO PR	127	129	132	137	135	136	139	145	141	143	146	151	147	148	151	156	152	154	157	162	159	160	163	169	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 KW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												105												115																					
		65						75						85						95						105						115															
		ENTERING INDOOR WET BULB TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE									
AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71															
1100	MBh	35.0	35.5	36.6	-	34.7	35.2	36.3	-	33.8	34.3	35.4	-	32.3	32.8	33.8	-	30.4	30.9	31.9	-	28.6	29.1	30.2	-	30.4	30.9	31.9	-	28.6	29.1	30.2	-	30.4	30.9	31.9	-	28.6	29.1	30.2	-						
	S/T	0.66	0.59	0.45	-	0.67	0.59	0.46	-	0.70	0.62	0.48	-	0.71	0.64	0.50	-	1.00	0.66	0.53	-	1.00	0.71	0.58	-	1.00	0.66	0.53	-	1.00	0.71	0.58	-	1.00	0.66	0.53	-	1.00	0.71	0.58	-						
	ΔT	2.0	18	14	-	2.0	18	14	-	2.0	18	14	-	1.9	18	14	-	1.9	17	14	-	2.0	19	15	-	1.9	17	14	-	2.0	19	15	-	1.9	17	14	-	2.0	19	15	-						
	KW	2.03	2.03	2.02	-	2.26	2.26	2.26	-	2.53	2.53	2.52	-	2.81	2.81	2.81	-	3.13	3.13	3.13	-	3.51	3.50	3.50	-	3.13	3.13	3.13	-	3.51	3.50	3.50	-	3.13	3.13	3.13	-	3.51	3.50	3.50	-						
	Amps	7.4	7.4	7.4	-	8.5	8.5	8.5	-	9.7	9.7	9.7	-	11.0	11.0	11.0	-	12.5	12.5	12.5	-	14.2	14.2	14.2	-	12.5	12.5	12.5	-	14.2	14.2	14.2	-	12.5	12.5	12.5	-	14.2	14.2	14.2	-						
1200	MBh	35.4	35.9	37.0	-	35.1	35.6	36.6	-	34.2	34.7	35.7	-	32.7	33.2	34.2	-	30.8	31.3	32.3	-	29.0	29.5	30.6	-	30.8	31.3	32.3	-	29.0	29.5	30.6	-	30.8	31.3	32.3	-	29.0	29.5	30.6	-						
	S/T	0.69	0.62	0.48	-	0.70	0.62	0.49	-	0.72	0.65	0.51	-	0.74	0.67	0.53	-	1.00	0.69	0.55	-	1.00	0.74	0.60	-	1.00	0.69	0.55	-	1.00	0.74	0.60	-	1.00	0.69	0.55	-	1.00	0.74	0.60	-						
	ΔT	19	17	13	-	19	17	13	-	19	17	14	-	19	17	13	-	19	17	13	-	20	18	14	-	19	17	13	-	20	18	14	-	19	17	13	-	20	18	14	-						
	KW	2.04	2.03	2.03	-	2.27	2.27	2.27	-	2.54	2.53	2.53	-	2.82	2.82	2.82	-	3.14	3.14	3.13	-	3.51	3.51	3.51	-	3.14	3.14	3.13	-	3.51	3.51	3.51	-	3.14	3.14	3.13	-	3.51	3.51	3.51	-						
	Amps	7.5	7.5	7.5	-	8.6	8.6	8.5	-	9.8	9.8	9.7	-	11.1	11.1	11.0	-	12.5	12.5	12.5	-	14.2	14.2	14.2	-	12.5	12.5	12.5	-	14.2	14.2	14.2	-	12.5	12.5	12.5	-	14.2	14.2	14.2	-						
1350	MBh	36.1	36.6	37.6	-	35.8	36.3	37.3	-	34.9	35.4	36.4	-	33.4	33.8	34.9	-	31.5	31.9	33.0	-	29.7	30.2	31.2	-	31.5	31.9	33.0	-	29.7	30.2	31.2	-	31.5	31.9	33.0	-	29.7	30.2	31.2	-						
	S/T	0.71	0.63	0.50	-	0.71	0.64	0.50	-	0.74	0.66	0.53	-	1.00	0.68	0.55	-	1.00	0.71	0.57	-	1.00	0.76	0.62	-	1.00	0.71	0.57	-	1.00	0.76	0.62	-	1.00	0.71	0.57	-	1.00	0.76	0.62	-						
	ΔT	18	16	12	-	18	16	12	-	18	16	13	-	18	16	12	-	18	16	12	-	19	17	13	-	18	16	12	-	19	17	13	-	18	16	12	-	19	17	13	-						
	KW	2.05	2.04	2.04	-	2.28	2.28	2.28	-	2.55	2.54	2.54	-	2.83	2.83	2.83	-	3.15	3.15	3.14	-	3.52	3.52	3.52	-	3.15	3.15	3.14	-	3.52	3.52	3.52	-	3.15	3.15	3.14	-	3.52	3.52	3.52	-						
	Amps	7.5	7.5	7.5	-	8.6	8.6	8.6	-	9.8	9.8	9.8	-	11.1	11.1	11.1	-	12.6	12.6	12.6	-	14.3	14.3	14.3	-	12.6	12.6	12.6	-	14.3	14.3	14.3	-	12.6	12.6	12.6	-	14.3	14.3	14.3	-						

IDB		OUTDOOR AMBIENT TEMPERATURE												105												115																					
		65						75						85						95						105						115															
		ENTERING INDOOR WET BULB TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE									
AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71											
1100	MBh	35.1	35.6	36.6	37.9	34.8	35.2	36.3	37.9	33.9	34.3	35.4	37.0	32.3	32.8	33.8	35.4	30.4	30.9	31.9	33.5	28.7	29.2	30.2	31.8	30.4	30.9	31.9	33.5	28.7	29.2	30.2	31.8	30.4	30.9	31.9	33.5	28.7	29.2	30.2	31.8						
	S/T	0.82	0.74	0.61	0.47	0.83	0.75	0.61	0.47	1.00	0.77	0.64	0.50	1.00	0.77	0.63	0.49	1.00	0.79	0.65	0.51	1.00	0.84	0.71	0.56	1.00	0.77	0.64	0.50	1.00	0.84	0.71	0.56	1.00	0.77	0.64	0.50	1.00	0.84	0.71	0.56						
	ΔT	24	22	18	15	24	22	18	15	24	22	18	15	24	22	18	14	23	22	18	14	25	23	19	15	23	22	18	14	25	23	19	15	23	22	18	14	25	23	19	15						
	KW	2.03	2.02	2.02	2.04	2.26	2.26	2.26	2.28	2.53	2.52	2.52	2.54	2.81	2.81	2.81	2.82	3.13	3.13	3.12	3.14	3.50	3.50	3.50	3.52	3.13	3.13	3.12	3.14	3.50	3.50	3.50	3.52	3.13	3.13	3.12	3.14	3.50	3.50	3.50	3.52						
	Amps	7.4	7.4	7.4	7.5	8.5	8.5	8.5	8.6	9.7	9.7	9.7	9.8	11.0	11.0	11.0	11.1	12.5	12.5	12.5	12.5	14.2	14.2	14.2	14.3	12.5	12.5	12.5	12.5	14.2	14.2	14.2	14.3	12.5	12.5	12.5	12.5	14.2	14.2	14.2	14.3						
1200	MBh	35.5	35.9	37.0	38.6	35.1	35.6	36.7	38.2	34.2	34.7	35.8	37.3	32.7	33.2	34.2	35.8	30.8	31.3	32.3	33.9	29.1	29.5	30.6	32.2	30.8	31.3	32.3	33.9	29.1	29.5	30.6	32.2	30.8	31.3	32.3	33.9	29.1	29.5	30.6	32.2						
	S/T	0.82	0.74	0.61	0.47	0.83	0.75	0.61	0.47	1.00	0.77	0.64	0.50	1.00	0.79	0.66	0.52	1.00	0.82	0.68	0.54	1.00	1.00	0.73	0.59	1.00	0.77	0.64	0.50	1.00	1.00	0.73	0.59	1.00	0.77	0.64	0.50	1.00	1.00	0.73	0.59						
	ΔT	23	21	18	14	23	21	17	14	23	21	18	14	23	21	17	14	23	21	17	14	24	22	18	15	23	21	17	14	24	22	18	15	23	21	17	14	24	22	18	15						
	KW	2.03	2.03	2.03	2.05	2.27	2.27	2.26	2.28	2.53	2.53	2.53	2.55	2.82	2.82	2.81	2.83	3.14	3.14	3.13	3.15	3.51	3.51	3.51	3.52	3.14	3.14	3.13	3.15	3.51	3.51	3.51	3.52	3.14	3.14	3.13	3.15	3.51	3.51	3.51	3.52						
	Amps	7.5	7.5	7.4	7.5	8.6	8.5	8.5	8.6	9.7	9.8	9.7	9.8	11.1	11.1	11.0	11.1	12.5	12.5	12.5	12.5	14.2	14.2	14.2	14.3	12.5	12.5	12.5	12.5	14.2	14.2	14.2	14.3	12.5	12.5	12.5	12.5	14.2	14.2	14.2	14.3						
1350	MBh	36.1	36.6	37.7	39.2	35.8	36.3	37.4	38.9	34.9	35.4	36.4	38.0	33.4	33.9	34.9	36.5	31.5	32.0	33.0	34.6	29.7	30.2	31.3	32.8	31.5	32.0	33.0	34.6	29.7	30.2	31.3	32.8	31.5	32.0	33.0	34.6	29.7	30.2	31.3	32.8						
	S/T	0.84	0.76	0.63	0.48	0.84	0.77	0.63	0.49	1.00	0.79	0.66	0.51	1.00	0.81	0.68	0.53	1.00	0.83	0.70	0.56	1.00	1.00	0.75	0.61	1.00	0.79	0.66	0.51	1.00	1.00	0.75	0.61	1.00	0.79	0.66	0.51	1.00	1.00	0.75	0.61						
	ΔT	22	20	17	13	22	20	17	13	22	20	17	13	22	20	17	13	22	20	16	13	23	21	17	14	22	20	16	13	23	21	17	14	22	20	16	13	23	21	17	14						
	KW	2.04	2.04	2.04	2.06	2.28	2.28	2.27	2.29	2.54	2.54	2.54	2.56	2.83	2.83	2.82	2.84	3.15	3.15	3.14	3.16	3.52	3.52	3.52	3.53	3.15	3.15	3.14	3.16	3.52	3.52	3.52	3.53	3.15	3.15	3.14	3.16	3.52	3.52	3.52	3.53						
	Amps	7.5	7.5	7.5	7.6	8.6	8.6	8.6	8.7	9.8	9.8	9.8	9.9	11.1	11.1	11.1	11.2	12.6	12.6	12.5	12.6	14.3	14.3	14.3	14.3	12.6	12.6	12.5	12.6	14.3	14.3	14.3	14.3	12.6	12.6	12.5	12.6	14.3	14.3	14.3	14.3						

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	35.2	35.7	36.8	38.3	34.9	35.4	36.5	38.0	34.0	34.5	35.6	37.1	32.5	33.0	34.0	35.6	30.6	31.1	32.1	33.7	28.8	29.3	30.4	31.9
	S/T	0.92	0.84	0.71	0.6	1.00	0.85	0.71	0.57	1.00	0.87	0.74	0.6	1.00	0.89	0.76	0.61	1.00	1.00	0.78	0.6	1.00	1.00	0.83	0.69
	ΔT	28	26	23	19	28	26	22	19	28	26	23	19	28	26	22	19	28	26	22	18	29	27	23	20
	KW	2.03	2.03	2.02	2.0	2.26	2.26	2.26	2.28	2.53	2.53	2.52	2.5	2.81	2.81	2.81	2.83	3.13	3.13	3.13	3.1	3.51	3.50	3.50	3.52
	Amps	7.4	7.4	7.4	7.5	8.5	8.5	8.5	8.6	9.7	9.7	9.7	9.8	11.0	11.0	11.0	11.1	12.5	12.5	12.5	12.6	14.2	14.2	14.2	14.3
1100	HI PR	256	257	259	263	296	297	298	303	337	339	340	345	382	384	385	390	431	432	434	438	483	484	486	490
	LO PR	122	124	127	132	130	131	134	139	136	137	140	146	141	143	146	151	147	148	151	156	153	155	158	163
	MBh	35.6	36.1	37.2	38.7	35.3	35.8	36.8	38.4	34.4	34.9	35.9	37.5	32.9	33.4	34.4	36.0	31.0	31.5	32.5	34.1	29.2	29.7	30.8	32.3
	S/T	1.00	0.87	0.73	0.6	1.00	0.87	0.74	0.60	1.00	0.90	0.76	0.6	1.00	0.92	0.78	0.64	1.00	1.00	0.81	0.7	1.00	1.00	0.86	0.72
	ΔT	27	25	22	18	27	25	22	18	27	26	22	18	27	25	22	18	27	25	21	18	28	26	23	19
1200	KW	2.04	2.03	2.03	2.1	2.27	2.27	2.27	2.28	2.54	2.53	2.53	2.6	2.82	2.82	2.81	2.83	3.14	3.14	3.13	3.2	3.51	3.51	3.51	3.53
	Amps	7.5	7.5	7.5	7.5	8.6	8.6	8.5	8.6	9.8	9.8	9.7	9.8	11.1	11.1	11.1	11.1	12.5	12.5	12.5	12.6	14.2	14.2	14.2	14.3
	HI PR	257	258	260	265	297	298	300	304	339	340	342	346	384	385	387	391	432	434	435	440	484	485	487	492
	LO PR	124	125	128	133	131	132	135	141	137	139	142	147	143	144	147	152	148	150	153	158	155	156	159	164
	MBh	36.3	36.8	37.8	39.4	36.0	36.5	37.5	39.1	35.1	35.6	36.6	38.2	33.6	34.0	35.1	36.7	31.7	32.1	33.2	34.8	29.9	30.4	31.4	33.0
1350	S/T	1.00	0.89	0.75	0.6	1.00	0.89	0.76	0.61	1.00	0.92	0.78	0.6	1.00	1.00	0.80	0.66	1.00	1.00	0.82	0.7	1.00	1.00	0.88	0.73
	ΔT	26	24	21	17	26	24	21	17	27	25	21	17	26	24	21	17	26	24	20	17	27	25	22	18
	KW	2.05	2.04	2.04	2.1	2.28	2.28	2.28	2.29	2.55	2.54	2.54	2.6	2.83	2.83	2.83	2.84	3.15	3.15	3.14	3.2	3.52	3.52	3.52	3.54
	Amps	7.5	7.5	7.5	7.6	8.6	8.6	8.6	8.7	9.8	9.8	9.8	9.9	11.1	11.1	11.1	11.2	12.6	12.6	12.6	12.6	14.3	14.3	14.3	14.3
	HI PR	260	261	262	267	299	301	302	307	341	342	344	349	386	387	389	394	435	436	438	442	487	488	489	494
LO PR	126	127	131	136	133	135	138	143	140	141	144	149	145	147	150	155	150	152	155	160	157	159	162	167	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
85	MBh	35.8	36.3	37.3	38.9	35.5	36.0	37.0	38.6	34.6	35.1	36.1	37.7	33.1	33.5	34.6	36.2	31.2	31.7	32.7	34.3	29.4	29.9	30.9	32.5
	S/T	1.00	0.94	0.81	0.67	1.00	0.95	0.81	0.67	1.00	1.00	0.84	0.70	1.00	1.00	0.86	0.72	1.00	1.00	0.88	0.74	1.00	1.00	1.00	0.79
	ΔT	32	30	26	23	32	30	26	23	32	30	26	23	32	30	26	22	31	30	26	22	33	31	27	23
	KW	2.03	2.03	2.03	2.04	2.27	2.27	2.26	2.28	2.53	2.53	2.53	2.54	2.82	2.82	2.81	2.83	3.14	3.13	3.13	3.15	3.51	3.51	3.50	3.52
	Amps	7.5	7.5	7.4	7.5	8.5	8.5	8.5	8.6	9.8	9.7	9.7	9.8	11.1	11.1	11.0	11.1	12.5	12.5	12.5	12.6	14.2	14.2	14.2	14.3
1100	HI PR	257	258	260	264	297	298	300	304	339	340	341	346	384	385	386	391	432	433	435	439	484	485	487	491
	LO PR	124	126	129	134	131	133	136	141	138	139	142	147	143	145	148	153	148	150	153	158	155	157	160	165
	MBh	36.2	36.7	37.7	39.3	35.9	36.4	37.4	39.0	35.0	35.5	36.5	38.1	33.4	33.9	35.0	36.5	31.5	32.0	33.1	34.6	29.8	30.3	31.3	32.9
	S/T	1.00	0.97	0.83	0.69	1.00	0.98	0.84	0.70	1.00	1.00	0.87	0.72	1.00	1.00	0.89	0.74	1.00	1.00	0.91	0.76	1.00	1.00	1.00	0.82
	ΔT	31	29	26	22	31	29	25	22	31	29	26	22	31	29	25	22	31	29	25	22	32	30	26	23
1200	KW	2.04	2.04	2.03	2.05	2.28	2.27	2.27	2.29	2.54	2.54	2.53	2.55	2.83	2.82	2.82	2.84	3.14	3.14	3.14	3.16	3.52	3.52	3.51	3.53
	Amps	7.5	7.5	7.5	7.6	8.6	8.6	8.6	8.6	9.8	9.8	9.8	9.8	11.1	11.1	11.1	11.2	12.6	12.5	12.5	12.6	14.3	14.3	14.2	14.3
	HI PR	258	260	261	266	298	299	301	306	340	341	343	347	385	386	388	392	434	435	437	441	485	487	488	493
	LO PR	125	127	130	135	133	134	137	142	139	141	144	149	145	146	149	154	150	151	154	159	156	158	161	166
	MBh	36.9	37.4	38.4	40.0	36.6	37.1	38.1	39.7	35.7	36.2	37.2	38.8	34.1	34.6	35.7	37.2	32.2	32.7	33.8	35.3	30.5	31.0	32.0	33.6
1350	S/T	1.00	0.99	0.85	0.71	1.00	1.00	0.86	0.72	1.00	1.00	0.88	0.74	1.00	1.00	0.90	0.76	1.00	1.00	0.92	0.78	1.00	1.00	1.00	0.83
	ΔT	30	28	25	21	30	28	25	21	30	28	25	21	30	28	25	21	30	28	24	21	31	29	25	22
	KW	2.05	2.05	2.04	2.06	2.29	2.28	2.28	2.30	2.55	2.55	2.54	2.56	2.84	2.83	2.83	2.85	3.15	3.15	3.15	3.17	3.53	3.53	3.52	3.54
	Amps	7.5	7.5	7.5	7.6	8.6	8.6	8.6	8.7	9.8	9.8	9.8	9.9	11.1	11.1	11.1	11.2	12.6	12.6	12.6	12.7	14.3	14.3	14.3	14.4
	HI PR	261	262	264	268	301	302	304	308	342	344	345	350	387	389	390	395	436	437	439	443	488	489	491	495
LO PR	128	129	132	137	135	137	140	145	141	143	146	151	147	148	151	157	152	154	157	162	159	160	163	168	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																							
		65						75						85						95						105						115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
70	AIRFLOW	39.7	40.2	41.4	-	39.3	39.9	41.1	-	38.3	38.8	40.0	-	36.5	37.1	38.2	-	34.3	34.9	36.1	-	32.3	32.9	34.1	-	32.3	32.9	34.1	-								
	MBh	0.63	0.55	0.41	-	0.64	0.56	0.42	-	0.66	0.58	0.44	-	1.00	0.60	0.46	-	1.00	0.63	0.49	-	1.00	0.68	0.54	-	1.00	0.68	0.54	-								
	S/T	20	18	15	-	20	18	15	-	20	18	15	-	20	18	15	-	20	18	14	-	21	19	15	-	21	19	15	-								
	ΔT	2.32	2.32	2.31	-	2.59	2.59	2.58	-	2.89	2.89	2.88	-	3.21	3.21	3.21	-	3.58	3.57	3.57	-	4.00	4.00	4.00	-	4.00	4.00	4.00	-								
	KW	8.3	8.3	8.3	-	9.5	9.5	9.5	-	10.9	10.9	10.9	-	12.4	12.4	12.3	-	14.0	14.0	14.0	-	16.0	16.0	16.0	-	16.0	16.0	16.0	-								
	Amps	264	266	267	-	306	307	309	-	350	351	353	-	397	398	400	-	448	449	451	-	502	503	505	-	502	503	505	-								
	HI PR	126	128	131	-	134	135	139	-	140	142	145	-	146	148	151	-	152	153	157	-	159	160	163	-	159	160	163	-								
	LO PR	40.2	40.8	41.9	-	39.8	40.4	41.6	-	38.8	39.4	40.6	-	37.0	37.6	38.8	-	34.8	35.4	36.6	-	32.9	33.4	34.6	-	32.9	33.4	34.6	-								
	MBh	0.69	0.61	0.47	-	0.70	0.62	0.48	-	0.73	0.65	0.51	-	1.00	0.67	0.53	-	1.00	0.69	0.55	-	1.00	0.74	0.60	-	1.00	0.74	0.60	-								
	S/T	19	17	13	-	19	17	13	-	19	17	14	-	19	17	13	-	18	17	13	-	20	18	14	-	20	18	14	-								
ΔT	2.34	2.33	2.33	-	2.60	2.60	2.60	-	2.90	2.90	2.90	-	3.23	3.23	3.22	-	3.59	3.59	3.58	-	4.02	4.01	4.01	-	4.02	4.01	4.01	-									
KW	8.4	8.3	8.3	-	9.6	9.6	9.6	-	11.0	10.9	10.9	-	12.4	12.4	12.4	-	14.1	14.1	14.1	-	16.0	16.0	16.0	-	16.0	16.0	16.0	-									
Amps	267	268	270	-	308	309	311	-	352	353	355	-	399	400	402	-	450	451	453	-	504	505	507	-	504	505	507	-									
HI PR	128	130	133	-	136	137	140	-	142	144	147	-	148	150	153	-	154	155	158	-	161	162	165	-	161	162	165	-									
LO PR	40.8	41.4	42.6	-	40.5	41.0	42.2	-	39.4	40.0	41.2	-	37.7	38.2	39.4	-	35.5	36.0	37.2	-	33.5	34.0	35.2	-	33.5	34.0	35.2	-									
MBh	0.73	0.65	0.51	-	0.74	0.66	0.52	-	1.00	0.68	0.54	-	1.00	0.70	0.56	-	1.00	0.73	0.58	-	1.00	1.00	0.64	-	1.00	1.00	0.64	-									
S/T	18	16	13	-	18	16	12	-	18	16	13	-	18	16	12	-	17	16	12	-	19	17	13	-	19	17	13	-									
ΔT	2.35	2.34	2.34	-	2.62	2.61	2.61	-	2.92	2.91	2.91	-	3.24	3.24	3.23	-	3.60	3.60	3.60	-	4.03	4.03	4.02	-	4.03	4.03	4.02	-									
KW	8.4	8.4	8.4	-	9.6	9.6	9.6	-	11.0	11.0	11.0	-	12.5	12.5	12.5	-	14.2	14.1	14.1	-	16.1	16.1	16.1	-	16.1	16.1	16.1	-									
Amps	269	270	272	-	311	312	314	-	354	355	357	-	401	402	404	-	452	453	455	-	506	507	509	-	506	507	509	-									
HI PR	130	132	135	-	138	139	142	-	144	146	149	-	150	152	155	-	156	157	160	-	163	164	167	-	163	164	167	-									
LO PR																																					

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																							
		65						75						85						95						105						115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
75	AIRFLOW	39.7	40.3	41.4	43.3	39.3	39.9	41.1	42.9	38.3	38.9	40.1	41.9	36.5	37.1	38.3	40.1	34.3	34.9	36.1	37.9	32.4	32.9	34.1	35.9	32.4	32.9	34.1	35.9								
	MBh	0.77	0.69	0.55	0.40	1.00	0.69	0.55	0.40	1.00	0.72	0.58	0.43	1.00	0.74	0.60	0.45	1.00	0.76	0.62	0.47	1.00	1.00	0.67	0.53	1.00	1.00	0.74	0.59								
	S/T	24	22	19	15	24	22	19	15	24	22	19	15	24	21	17	14	24	22	18	15	25	25	23	19	25	23	19	16								
	ΔT	2.32	2.32	2.31	2.33	2.59	2.59	2.58	2.60	2.89	2.89	2.88	2.90	3.21	3.21	3.21	3.23	3.58	3.57	3.57	3.59	4.00	4.00	4.00	4.01	4.00	4.00	3.99	4.01								
	KW	8.3	8.3	8.3	8.0	9.5	9.5	9.5	9.6	10.9	10.9	10.9	11.0	12.4	12.4	12.3	12.4	14.0	14.0	14.0	14.0	16.0	16.0	16.0	16.0	16.0	16.0	15.9	16.0								
	Amps	265	266	268	272	306	307	309	314	350	351	353	358	397	398	400	405	448	449	451	455	502	502	503	505	502	502	503	505	510							
	HI PR	126	128	131	136	134	135	139	144	141	142	145	151	146	148	151	156	152	153	157	162	159	159	160	164	159	159	160	164	169							
	LO PR	40.2	40.8	42.0	43.8	39.9	40.4	41.6	43.4	38.8	39.4	40.6	42.4	37.0	37.6	38.8	40.6	34.9	35.4	36.6	38.4	32.9	33.4	34.6	36.4	32.9	33.4	34.6	36.4								
	MBh	0.83	0.75	0.61	0.46	1.00	0.76	0.61	0.47	1.00	0.78	0.64	0.49	1.00	0.80	0.66	0.51	1.00	1.00	0.68	0.53	1.00	1.00	0.74	0.59	1.00	1.00	0.74	0.59								
	S/T	23	21	17	14	23	21	17	14	23	21	18	14	23	21	17	14	22	21	17	14	24	24	22	18	24	22	18	15								
ΔT	2.33	2.33	2.33	2.35	2.60	2.60	2.60	2.62	2.90	2.90	2.90	2.92	3.23	3.22	3.22	3.24	3.59	3.59	3.58	3.60	4.01	4.01	4.01	4.03	4.01	4.01	4.01	4.03									
KW	8.3	8.3	8.3	8.0	9.6	9.6	9.5	10.0	10.9	10.9	10.9	11.0	12.4	12.4	12.4	12.0	14.1	14.1	14.1	14.0	16.0	16.0	16.0	16.0	16.0	16.0	16.0	16.1									
Amps	267	268	270	274	309	310	312	316	352	353	355	360	399	400	402	407	450	451	453	458	504	504	505	507	504	504	505	512									
HI PR	128	130	133	138	136	137	140	146	142	144	147	153	148	150	153	158	154	155	158	164	161	161	162	165	161	161	162	165	171								
LO PR	40.8	41.4	42.6	44.4	40.5	41.1	42.2	44.0	39.5	40.0	41.2	43.0	37.7	38.2	39.4	41.2	35.5	36.1	37.2	39.1	33.5	34.1	35.3	37.1	33.5	34.1	35.3	37.1									
MBh	0.86	0.78	0.64	0.49	1.00	0.79	0.65	0.50	1.00	0.82	0.68	0.53	1.00	0.84	0.70	0.55	1.00	1.00	0.72	0.57	1.00	1.00	0.77	0.62	1.00	1.00	0.77	0.62									
S/T	22	20	17	13	22	20	17	13	22	20	17	13	22	20	16	13	21	20	16	13	23	23	21	17	23	21	17	14									
ΔT	2.35	2.34	2.34	2.36	2.61	2.61	2.61	2.63	2.91	2.91	2.91	2.93	3.24	3.24	3.23	3.25	3.60	3.60	3.59	3.61	4.03	4.03	4.02	4.04	4.03	4.03	4.02	4.04									
KW	8.4	8.4	8.4	8.0	9.6	9.6	9.6	10.0	11.0	11.0	11.0	11.0	12.5	12.5	12.5	13.0	14.1	14.1	14.1	14.0	16.1	16.1	16.1	16.2	16.1	16.1	16.1	16.2									
Amps	269	270	272	277	311	312	314	318	354	356	357	362	402	403	405	409	452	453	455	460	506	506	508	509	506	506	508	509	514								
HI PR	130	132	135	140	138	139	142	148	144	146	149	155	150	152	155	160	156	157	160	166	163	163	164	167	163	163	164	167	173								
LO PR																																					

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	39.9	40.5	41.7	43.5	39.6	40.1	41.3	43.1	38.5	39.1	40.3	42.1	36.7	37.3	38.5	40.3	34.6	35.1	36.3	38.1	32.6	33.1	34.3	36.1
	S/T	1.00	0.82	0.68	0.5	1.00	0.82	0.68	0.53	1.00	0.85	0.71	0.6	1.00	1.00	0.73	0.58	1.00	1.00	0.75	0.6	1.00	1.00	0.81	0.66
	ΔT	28	26	23	19	28	26	23	19	28	26	23	19	28	26	23	19	28	26	23	19	29	27	23	20
	KW	2.32	2.32	2.31	2.3	2.59	2.59	2.58	2.60	2.89	2.89	2.88	2.9	3.21	3.21	3.21	3.23	3.58	3.57	3.57	3.6	4.00	4.00	4.00	4.02
	Amps	8.3	8.3	8.3	8.0	9.5	9.5	9.5	10.0	10.9	10.9	10.9	11.0	12.4	12.4	12.3	12.0	14.0	14.0	14.0	14.0	16.0	16.0	16.0	16.0
1225	HI PR	265	266	268	273	307	308	310	314	351	352	354	358	398	399	401	405	448	449	451	456	502	504	505	510
	LO PR	127	128	131	137	134	136	139	144	141	143	146	151	147	148	152	157	152	154	157	162	159	161	164	169
	MBh	40.4	41.0	42.2	44.0	40.1	40.6	41.8	43.6	39.0	39.6	40.8	42.6	37.3	37.8	39.0	40.8	35.1	35.6	36.8	38.6	33.1	33.6	34.8	36.6
	S/T	1.00	0.88	0.74	0.6	1.00	0.89	0.74	0.60	1.00	0.91	0.77	0.6	1.00	1.00	0.79	0.64	1.00	1.00	0.81	0.7	1.00	1.00	0.87	0.72
	ΔT	27	25	22	18	27	25	21	18	27	25	22	18	27	25	21	18	26	25	21	18	28	26	22	19
1400	KW	2.33	2.33	2.33	2.4	2.60	2.60	2.60	2.62	2.90	2.90	2.90	2.9	3.23	3.23	3.22	3.24	3.59	3.59	3.58	3.6	4.02	4.01	4.01	4.03
	Amps	8.4	8.3	8.3	8.0	9.6	9.6	9.6	10.0	11.0	11.0	10.9	11.0	12.4	12.4	12.4	12.0	14.1	14.1	14.1	14.0	16.0	16.0	16.0	16.1
	HI PR	267	268	270	275	309	310	312	317	353	354	356	360	400	401	403	407	451	452	454	458	505	506	508	512
	LO PR	129	130	133	139	136	138	141	146	143	144	148	153	149	150	153	159	154	156	159	164	161	163	166	171
	MBh	41.1	41.6	42.8	44.6	40.7	41.3	42.4	44.3	39.7	40.2	41.4	43.2	37.9	38.4	39.6	41.4	35.7	36.3	37.4	39.3	33.7	34.3	35.5	37.3
1575	S/T	1.00	0.91	0.77	0.6	1.00	0.92	0.78	0.63	1.00	1.00	0.81	0.7	1.00	1.00	0.83	0.68	1.00	1.00	0.85	0.7	1.00	1.00	1.00	0.75
	ΔT	26	24	21	17	26	24	21	17	26	24	21	17	26	24	21	17	26	24	20	17	27	25	21	18
	KW	2.35	2.34	2.34	2.4	2.62	2.61	2.61	2.63	2.92	2.91	2.91	2.9	3.24	3.24	3.23	3.25	3.60	3.60	3.60	3.6	4.03	4.03	4.02	4.00
	Amps	8.4	8.4	8.4	8.0	9.6	9.6	9.6	10.0	11.0	11.0	11.0	11.0	12.5	12.5	12.5	13.0	14.2	14.1	14.1	14.0	16.1	16.1	16.1	16.2
	HI PR	270	271	273	277	311	312	314	319	355	356	358	363	402	403	405	410	453	454	456	460	507	508	510	514
LO PR	131	132	135	141	138	140	143	148	145	147	150	155	151	152	155	161	156	158	161	166	163	165	168	173	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
85	MBh	40.6	41.1	42.3	44.1	40.2	40.8	42.0	43.8	39.2	39.7	40.9	42.7	37.4	38.0	39.1	41.0	35.2	35.8	37.0	38.8	33.2	33.8	35.0	36.8
	S/T	1.00	0.92	0.78	0.63	1.00	1.00	0.79	0.64	1.00	1.00	0.81	0.67	1.00	1.00	0.83	0.69	1.00	1.00	0.77	0.71	1.00	1.00	1.00	0.82
	ΔT	31	30	26	23	31	30	26	23	32	30	26	23	31	30	26	23	31	29	26	22	32	30	27	24
	KW	2.33	2.32	2.32	2.34	2.59	2.59	2.59	2.61	2.89	2.89	2.89	2.91	3.22	3.22	3.21	3.23	3.58	3.58	3.58	3.60	4.01	4.01	4.00	4.02
	Amps	8.3	8.3	8.3	8.0	9.5	9.5	9.5	10.0	10.9	10.9	10.9	11.0	12.4	12.4	12.4	12.0	14.1	14.0	14.0	14.0	16.0	16.0	16.0	16.1
1225	HI PR	266	267	269	274	308	309	311	316	352	353	355	359	399	400	402	406	450	451	453	457	504	505	507	511
	LO PR	129	130	133	139	136	138	141	146	143	145	148	153	149	150	153	159	154	156	159	164	161	163	166	171
	MBh	41.1	41.7	42.8	44.7	40.7	41.3	42.5	44.3	39.7	40.3	41.5	43.3	37.9	38.5	39.7	41.5	35.7	36.3	37.5	39.3	33.8	34.3	35.5	37.3
	S/T	1.00	0.99	0.84	0.69	1.00	1.00	0.85	0.70	1.00	1.00	0.88	0.73	1.00	1.00	0.90	0.75	1.00	1.00	0.77	0.71	1.00	1.00	1.00	0.82
	ΔT	30	29	25	22	30	28	25	22	31	29	25	22	30	28	25	22	30	28	25	21	31	29	26	22
1400	KW	2.34	2.34	2.33	2.35	2.61	2.61	2.60	2.62	2.91	2.91	2.90	2.92	3.23	3.23	3.23	3.25	3.60	3.59	3.59	3.61	4.02	4.02	4.01	4.04
	Amps	8.4	8.4	8.3	8.0	9.6	9.6	9.6	10.0	11.0	11.0	10.9	11.0	12.5	12.5	12.4	13.0	14.1	14.1	14.1	14.0	16.1	16.1	16.0	16.1
	HI PR	269	270	272	276	310	311	313	318	354	355	357	362	401	402	404	409	452	453	455	459	506	507	509	514
	LO PR	130	132	135	141	138	140	143	148	145	146	150	155	150	152	155	161	156	158	161	166	163	165	168	173
	MBh	41.7	42.3	43.5	45.3	41.4	41.9	43.1	44.9	40.3	40.9	42.1	43.9	38.5	39.1	40.3	42.1	36.4	36.9	38.1	39.9	34.4	34.9	36.1	37.9
1575	S/T	1.00	1.00	0.88	0.73	1.00	1.00	0.89	0.74	1.00	1.00	0.91	0.76	1.00	1.00	0.93	0.78	1.00	1.00	0.81	0.81	1.00	1.00	1.00	0.86
	ΔT	29	28	24	21	29	28	24	21	30	28	24	21	29	28	24	21	29	27	24	20	30	28	25	21
	KW	2.35	2.35	2.34	2.37	2.62	2.62	2.61	2.63	2.92	2.92	2.91	2.93	3.24	3.24	3.24	3.26	3.61	3.61	3.60	3.62	4.03	4.03	4.03	4.05
	Amps	8.4	8.4	8.4	8.0	9.7	9.6	9.6	10.0	11.0	11.0	11.0	11.0	12.5	12.5	12.5	13.0	14.2	14.2	14.1	14.0	16.1	16.1	16.1	16.2
	HI PR	271	272	274	278	312	314	315	320	356	357	359	364	403	404	406	411	454	455	457	462	508	509	511	516
LO PR	132	134	137	143	140	142	145	150	147	148	152	157	153	154	157	163	158	160	163	168	165	167	170	175	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 KW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	AIRFLOW	39.7	40.2	41.4	-	39.3	39.9	41.1	-	38.3	38.8	40.0	-	36.5	37.1	38.2	-	34.3	34.9	36.1	-	32.3	32.9	34.1	-
	MBh	39.7	40.2	41.4	-	39.3	39.9	41.1	-	38.3	38.8	40.0	-	36.5	37.1	38.2	-	34.3	34.9	36.1	-	32.3	32.9	34.1	-
	S/T	0.63	0.55	0.41	-	0.64	0.56	0.42	-	0.66	0.58	0.44	-	1.00	0.60	0.46	-	1.00	0.63	0.49	-	1.00	0.68	0.54	-
	Δ T	20	18	15	-	20	18	15	-	20	18	15	-	20	18	15	-	20	18	14	-	21	19	15	-
	KW	2.32	2.32	2.31	-	2.59	2.59	2.58	-	2.89	2.89	2.88	-	3.21	3.21	3.21	-	3.58	3.57	3.57	-	4.00	4.00	4.00	-
	Amps	8.3	8.3	8.3	-	9.5	9.5	9.5	-	10.9	10.9	10.9	-	12.4	12.4	12.3	-	14.0	14.0	14.0	-	16.0	16.0	16.0	-
	HI PR	267	266	267	-	306	307	309	-	350	351	353	-	397	398	400	-	448	449	451	-	502	503	505	-
	LO PR	126	128	131	-	134	135	139	-	140	142	145	-	146	148	151	-	152	153	157	-	159	160	163	-
	MBh	40.2	40.8	41.9	-	39.8	40.4	41.6	-	38.8	39.4	40.6	-	37.0	37.6	38.8	-	34.8	35.4	36.6	-	32.9	33.4	34.6	-
	S/T	0.69	0.61	0.47	-	0.70	0.62	0.48	-	0.73	0.65	0.51	-	1.00	0.67	0.53	-	1.00	0.69	0.55	-	1.00	0.74	0.60	-
	Δ T	19	17	13	-	19	17	13	-	19	17	14	-	19	17	13	-	18	17	13	-	20	18	14	-
	KW	2.34	2.33	2.33	-	2.60	2.60	2.60	-	2.90	2.90	2.90	-	3.23	3.23	3.22	-	3.59	3.59	3.58	-	4.02	4.01	4.01	-
Amps	8.4	8.3	8.3	-	9.6	9.6	9.6	-	11.0	10.9	10.9	-	12.4	12.4	12.4	-	14.1	14.1	14.1	-	16.0	16.0	16.0	-	
HI PR	267	268	270	-	308	309	311	-	352	353	355	-	399	400	402	-	450	451	453	-	504	505	507	-	
LO PR	128	130	133	-	136	137	140	-	142	144	147	-	148	150	153	-	154	155	158	-	161	162	165	-	
MBh	40.8	41.4	42.6	-	40.5	41.0	42.2	-	39.4	40.0	41.2	-	37.7	38.2	39.4	-	35.5	36.0	37.2	-	33.5	34.0	35.2	-	
S/T	0.73	0.65	0.51	-	0.74	0.66	0.52	-	1.00	0.68	0.54	-	1.00	0.70	0.56	-	1.00	0.73	0.58	-	1.00	1.00	0.64	-	
Δ T	18	16	13	-	18	16	12	-	18	16	13	-	18	16	12	-	17	16	12	-	19	17	13	-	
KW	2.35	2.34	2.34	-	2.62	2.61	2.61	-	2.92	2.91	2.91	-	3.24	3.24	3.23	-	3.60	3.60	3.60	-	4.03	4.03	4.02	-	
Amps	8.4	8.4	8.4	-	9.6	9.6	9.6	-	11.0	11.0	11.0	-	12.5	12.5	12.5	-	14.2	14.1	14.1	-	16.1	16.1	16.1	-	
HI PR	269	270	272	-	311	312	314	-	354	355	357	-	401	402	404	-	452	453	455	-	506	507	509	-	
LO PR	130	132	135	-	138	139	142	-	144	146	149	-	150	152	155	-	156	157	160	-	163	164	167	-	
75	AIRFLOW	39.7	40.3	41.4	43.3	39.3	39.9	41.1	42.9	38.3	38.9	40.1	41.9	36.5	37.1	38.3	40.1	34.3	34.9	36.1	37.9	32.4	32.9	34.1	35.9
	MBh	39.7	40.3	41.4	43.3	39.3	39.9	41.1	42.9	38.3	38.9	40.1	41.9	36.5	37.1	38.3	40.1	34.3	34.9	36.1	37.9	32.4	32.9	34.1	35.9
	S/T	0.77	0.69	0.55	0.40	1.00	0.69	0.55	0.40	1.00	0.72	0.58	0.43	1.00	0.74	0.60	0.45	1.00	0.76	0.62	0.47	1.00	1.00	0.67	0.53
	Δ T	24	22	19	15	24	21	19	15	24	22	19	15	24	22	19	15	24	22	18	15	25	23	19	16
	KW	2.32	2.32	2.31	2.33	2.59	2.59	2.58	2.60	2.89	2.89	2.88	2.90	3.21	3.21	3.21	3.23	3.58	3.57	3.57	3.59	4.00	4.00	3.99	4.01
	Amps	8.3	8.3	8.3	8.0	9.5	9.5	9.5	9.6	10.9	10.9	10.9	11.0	12.4	12.4	12.3	12.4	14.0	14.0	14.0	14.0	16.0	16.0	15.9	16.0
	HI PR	265	266	268	272	306	307	309	314	350	351	353	358	397	398	400	405	448	449	451	455	502	503	505	510
	LO PR	126	128	131	136	134	135	139	144	141	142	145	151	146	148	151	156	152	153	157	162	159	160	164	169
	MBh	40.2	40.8	42.0	43.8	39.9	40.4	41.6	43.4	38.8	39.4	40.6	42.4	37.0	37.6	38.8	40.6	34.9	35.4	36.6	38.4	32.9	33.4	34.6	36.4
	S/T	0.83	0.75	0.61	0.46	1.00	0.76	0.61	0.47	1.00	0.78	0.64	0.49	1.00	0.80	0.66	0.51	1.00	1.00	0.68	0.53	1.00	1.00	0.74	0.59
	Δ T	23	21	17	14	23	21	17	14	23	21	18	14	23	21	17	14	22	21	17	14	24	22	18	15
	KW	2.33	2.33	2.33	2.35	2.60	2.60	2.60	2.62	2.90	2.90	2.90	2.92	3.23	3.23	3.22	3.24	3.59	3.59	3.58	3.60	4.01	4.01	4.01	4.03
Amps	8.3	8.3	8.3	8.0	9.6	9.6	9.5	9.6	10.9	10.9	10.9	11.0	12.4	12.4	12.4	12.0	14.1	14.1	14.1	14.0	16.0	16.0	16.0	16.1	
HI PR	267	268	270	274	309	310	312	316	352	353	355	360	399	400	402	407	450	451	453	458	504	505	507	512	
LO PR	128	130	133	138	136	137	140	146	142	144	147	153	148	150	153	158	154	155	158	164	161	162	165	171	
MBh	40.8	41.4	42.6	44.4	40.5	41.1	42.2	44.0	39.5	40.0	41.2	43.0	37.7	38.2	39.4	41.2	35.5	36.1	37.2	39.1	33.5	34.1	35.3	37.1	
S/T	0.86	0.78	0.64	0.49	1.00	0.79	0.65	0.50	1.00	0.82	0.68	0.53	1.00	0.84	0.70	0.55	1.00	1.00	0.72	0.57	1.00	1.00	0.77	0.62	
Δ T	22	20	17	13	22	20	17	13	22	20	17	13	22	20	16	13	21	20	16	13	23	21	17	14	
KW	2.35	2.34	2.34	2.36	2.61	2.61	2.61	2.63	2.91	2.91	2.91	2.93	3.24	3.24	3.23	3.25	3.60	3.60	3.59	3.61	4.03	4.02	4.02	4.04	
Amps	8.4	8.4	8.4	8.0	9.6	9.6	9.6	10.0	11.0	11.0	11.0	11.0	12.5	12.5	12.5	13.0	14.1	14.1	14.1	14.0	16.1	16.1	16.1	16.2	
HI PR	269	270	272	277	311	312	314	318	354	356	357	362	402	403	405	409	452	453	455	460	506	508	509	514	
LO PR	130	132	135	140	138	139	142	148	144	146	149	155	150	152	155	160	156	157	160	166	163	164	167	173	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE																											
		65				75				85				95				105				115							
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
		ENTERING INDOOR WET BULB TEMPERATURE																											
AIRFLOW		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	39.9	40.5	41.7	43.5	39.6	40.1	41.3	43.1	38.5	39.1	40.3	42.1	36.7	37.3	38.5	40.3	34.6	35.1	36.3	38.1	32.6	33.1	34.3	36.1				
	S/T	1.00	0.82	0.68	0.5	1.00	0.82	0.68	0.53	1.00	0.85	0.71	0.6	1.00	1.00	0.73	0.58	1.00	1.00	0.75	0.6	1.00	1.00	0.81	0.66				
	ΔT	28	26	23	19	28	26	23	19	28	26	23	19	28	26	23	19	28	26	23	19	29	27	23	20				
	KW	2.32	2.32	2.31	2.3	2.59	2.59	2.58	2.60	2.89	2.89	2.88	2.9	3.21	3.21	3.21	3.23	3.58	3.57	3.57	3.6	4.00	4.00	4.00	4.02				
	Amps	8.3	8.3	8.3	8.0	9.5	9.5	9.5	10.0	10.9	10.9	10.9	11.0	12.4	12.4	12.3	12.0	14.0	14.0	14.0	14.0	16.0	16.0	16.0	16.0				
HI PR	265	266	268	273	307	308	310	314	351	352	354	358	398	399	401	405	448	449	451	456	502	504	505	510					
LO PR	127	128	131	137	134	136	139	144	141	143	146	151	147	148	152	157	152	154	157	162	159	161	164	169					
1400	MBh	40.4	41.0	42.2	44.0	40.1	40.6	41.8	43.6	39.0	39.6	40.8	42.6	37.3	37.8	39.0	40.8	35.1	35.6	36.8	38.6	33.1	33.6	34.8	36.6				
	S/T	1.00	0.88	0.74	0.6	1.00	0.89	0.74	0.60	1.00	0.91	0.77	0.6	1.00	1.00	0.79	0.64	1.00	1.00	0.81	0.7	1.00	1.00	0.87	0.72				
	ΔT	27	25	22	18	27	25	21	18	27	25	22	18	27	25	21	18	26	25	21	18	28	26	22	19				
	KW	2.33	2.33	2.33	2.4	2.60	2.60	2.60	2.62	2.90	2.90	2.90	2.9	3.23	3.23	3.22	3.24	3.59	3.59	3.58	3.6	4.02	4.01	4.01	4.03				
	Amps	8.4	8.3	8.3	8.0	9.6	9.6	9.6	10.0	11.0	10.9	10.9	11.0	12.4	12.4	12.4	12.0	14.1	14.1	14.1	14.0	16.0	16.0	16.0	16.1				
HI PR	267	268	270	275	309	310	312	317	353	354	356	360	400	401	403	407	451	452	454	458	505	506	508	512					
LO PR	129	130	133	139	136	138	141	146	143	144	148	153	149	150	153	159	154	156	159	164	161	163	166	171					
1575	MBh	41.1	41.6	42.8	44.6	40.7	41.3	42.4	44.3	39.7	40.2	41.4	43.2	37.9	38.4	39.6	41.4	35.7	36.3	37.4	39.3	33.7	34.3	35.5	37.3				
	S/T	1.00	0.91	0.77	0.6	1.00	0.92	0.78	0.63	1.00	1.00	0.81	0.7	1.00	1.00	0.83	0.68	1.00	1.00	0.85	0.7	1.00	1.00	1.00	0.75				
	ΔT	26	24	21	17	26	24	21	17	26	24	21	17	26	24	21	17	26	24	20	17	27	25	21	18				
	KW	2.35	2.34	2.34	2.4	2.62	2.61	2.61	2.63	2.92	2.91	2.91	2.9	3.24	3.24	3.23	3.25	3.60	3.60	3.60	3.6	4.03	4.03	4.02	4.00				
	Amps	8.4	8.4	8.4	8.0	9.6	9.6	9.6	10.0	11.0	11.0	11.0	11.0	12.5	12.5	12.5	13.0	14.2	14.1	14.1	14.0	16.1	16.1	16.1	16.2				
HI PR	270	271	273	277	311	312	314	319	355	356	358	363	402	403	405	410	453	454	456	460	507	508	510	514					
LO PR	131	132	135	141	138	140	143	148	145	147	150	155	151	152	155	161	156	158	161	166	163	165	168	173					

IDB		OUTDOOR AMBIENT TEMPERATURE																											
		65				75				85				95				105				115							
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
		ENTERING INDOOR WET BULB TEMPERATURE																											
AIRFLOW		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
85	MBh	40.6	41.1	42.3	44.1	40.2	40.8	42.0	43.8	39.2	39.7	40.9	42.7	37.4	38.0	39.1	41.0	35.2	35.8	37.0	38.8	33.2	33.8	35.0	36.8				
	S/T	1.00	0.92	0.78	0.63	1.00	1.00	0.79	0.64	1.00	1.00	0.81	0.67	1.00	1.00	0.83	0.69	1.00	1.00	1.00	0.71	1.00	1.00	1.00	0.76				
	ΔT	31	30	26	23	31	30	26	23	32	30	26	23	31	30	26	23	31	29	26	22	32	30	27	24				
	KW	2.33	2.32	2.32	2.34	2.59	2.59	2.59	2.61	2.89	2.89	2.89	2.91	3.22	3.22	3.21	3.23	3.58	3.58	3.58	3.60	4.01	4.01	4.00	4.02				
	Amps	8.3	8.3	8.3	8.0	9.5	9.5	9.5	10.0	10.9	10.9	10.9	11.0	12.4	12.4	12.4	12.0	14.1	14.0	14.0	14.0	16.0	16.0	16.0	16.1				
HI PR	266	267	269	274	308	309	311	316	352	353	355	359	399	400	402	406	450	451	453	457	504	505	507	511					
LO PR	129	130	133	139	136	138	141	146	143	145	148	153	149	150	153	159	154	156	159	164	161	163	166	171					
1400	MBh	41.1	41.7	42.8	44.7	40.7	41.3	42.5	44.3	39.7	40.3	41.5	43.3	37.9	38.5	39.7	41.5	35.7	36.3	37.5	39.3	33.8	34.3	35.5	37.3				
	S/T	1.00	0.99	0.84	0.69	1.00	1.00	0.85	0.70	1.00	1.00	0.88	0.73	1.00	1.00	0.90	0.75	1.00	1.00	1.00	0.77	1.00	1.00	1.00	0.82				
	ΔT	30	29	25	22	30	28	25	22	31	29	25	22	30	28	25	22	30	28	25	21	31	29	26	22				
	KW	2.34	2.34	2.33	2.35	2.61	2.61	2.60	2.62	2.91	2.91	2.90	2.92	3.23	3.23	3.23	3.25	3.60	3.59	3.59	3.61	4.02	4.02	4.01	4.04				
	Amps	8.4	8.4	8.3	8.0	9.6	9.6	9.6	10.0	11.0	11.0	10.9	11.0	12.5	12.5	12.4	13.0	14.1	14.1	14.1	14.0	16.1	16.1	16.0	16.1				
HI PR	269	270	272	276	310	311	313	318	354	355	357	362	401	402	404	409	452	453	455	459	506	507	509	514					
LO PR	130	132	135	141	138	140	143	148	145	146	150	155	150	152	155	161	156	158	161	166	163	165	168	173					
1575	MBh	41.7	42.3	43.5	45.3	41.4	41.9	43.1	44.9	40.3	40.9	42.1	43.9	38.5	39.1	40.3	42.1	36.4	36.9	38.1	39.9	34.4	34.9	36.1	37.9				
	S/T	1.00	1.00	0.88	0.73	1.00	1.00	0.89	0.74	1.00	1.00	0.91	0.76	1.00	1.00	0.93	0.78	1.00	1.00	1.00	0.81	1.00	1.00	1.00	0.86				
	ΔT	29	28	24	21	29	28	24	21	30	28	24	21	29	28	24	21	29	27	24	20	30	28	25	21				
	KW	2.35	2.35	2.34	2.37	2.62	2.62	2.61	2.63	2.92	2.92	2.91	2.93	3.24	3.24	3.24	3.26	3.61	3.61	3.60	3.62	4.03	4.03	4.03	4.05				
	Amps	8.4	8.4	8.4	8.0	9.7	9.6	9.6	10.0	11.0	11.0	11.0	11.0	12.5	12.5	12.5	13.0	14.2	14.2	14.1	14.0	16.1	16.1	16.1	16.2				
HI PR	271	272	274	278	312	314	315	320	356	357	359	364	403	404	406	411	454	455	457	462	508	509	511	516					
LO PR	132	134	137	143	140	142	145	150	147	148	152	157	153	154	157	163	158	160	163	168	165	167	170	175					

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																							
		65						75						85						95						105						115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
70	1400	MBh	46.4	47.1	48.5	-	46.0	46.7	48.0	-	44.8	45.4	46.8	-	42.7	43.4	44.8	-	40.2	40.8	42.2	-	37.9	38.5	39.9	-	40.2	40.8	42.2	-	37.9	38.5	39.9	-			
		S/T	0.61	0.54	0.41	-	0.62	0.55	0.41	-	0.65	0.57	0.44	-	0.66	0.59	0.46	-	1.00	0.61	0.48	-	1.00	0.66	0.53	-	1.00	0.61	0.48	-	1.00	0.66	0.53	-			
		ΔT	19	17	14	-	19	17	14	-	19	18	14	-	19	17	14	-	19	17	14	-	20	18	15	-	19	17	14	-	20	18	15	-			
	1550	KW	2.77	2.77	2.76	-	3.09	3.08	3.08	-	3.44	3.44	3.43	-	3.83	3.82	3.82	-	4.26	4.25	4.25	-	4.76	4.76	4.75	-	4.26	4.25	4.25	-	4.76	4.76	4.75	-			
		Amps	10.1	10.1	10.0	-	11.5	11.5	11.5	-	13.2	13.2	13.1	-	14.9	14.9	14.9	-	16.9	16.9	16.9	-	19.2	19.2	19.2	-	16.9	16.9	16.9	-	19.2	19.2	19.2	-			
		HI PR	257	259	260	-	298	299	301	-	341	342	343	-	386	387	389	-	436	437	438	-	488	489	491	-	436	437	438	-	488	489	491	-			
	1800	LO PR	123	125	128	-	131	132	136	-	137	139	142	-	143	145	148	-	148	150	153	-	155	157	160	-	148	150	153	-	155	157	160	-			
		MBh	46.9	47.6	48.9	-	46.5	47.1	48.5	-	45.3	45.9	47.3	-	43.2	43.9	45.2	-	40.7	41.3	42.7	-	38.3	39.0	40.4	-	40.7	41.3	42.7	-	38.3	39.0	40.4	-			
		S/T	0.66	0.58	0.45	-	0.66	0.59	0.45	-	0.69	0.61	0.48	-	1.00	0.63	0.50	-	1.00	0.65	0.52	-	1.00	0.71	0.57	-	1.00	0.65	0.52	-	1.00	0.71	0.57	-			
	75	1400	ΔT	18	17	13	-	18	17	13	-	19	17	13	-	18	17	13	-	18	16	13	-	19	17	14	-	18	16	13	-	19	17	14	-		
			KW	2.80	2.80	2.79	-	3.12	3.11	3.11	-	3.47	3.47	3.46	-	3.86	3.85	3.85	-	4.29	4.28	4.28	-	4.79	4.79	4.78	-	4.29	4.28	4.28	-	4.79	4.79	4.78	-		
			Amps	10.2	10.2	10.2	-	11.7	11.7	11.6	-	13.3	13.3	13.3	-	15.1	15.0	15.0	-	17.0	17.0	17.0	-	19.3	19.3	19.3	-	17.0	17.0	17.0	-	19.3	19.3	19.3	-		
1550		HI PR	262	263	265	-	302	304	305	-	345	346	348	-	391	392	394	-	440	441	443	-	493	494	496	-	440	441	443	-	493	494	496	-			
		LO PR	127	129	132	-	135	136	140	-	141	143	146	-	147	149	152	-	152	154	157	-	159	161	164	-	152	154	157	-	159	161	164	-			
		MBh	47.9	48.5	49.9	-	47.5	48.1	49.5	-	46.2	46.9	48.3	-	44.2	44.8	46.2	-	41.6	42.3	43.7	-	39.3	40.0	41.3	-	41.6	42.3	43.7	-	39.3	40.0	41.3	-			
1800		S/T	0.70	0.62	0.49	-	0.70	0.63	0.49	-	0.73	0.65	0.52	-	1.00	0.67	0.54	-	1.00	0.69	0.56	-	1.00	0.74	0.61	-	1.00	0.74	0.61	-	1.00	0.74	0.61	-			
		ΔT	17	15	12	-	17	15	12	-	17	16	12	-	17	15	12	-	17	15	12	-	18	16	13	-	17	15	12	-	18	16	13	-			
		KW	2.80	2.80	2.79	-	3.12	3.11	3.11	-	3.47	3.47	3.46	-	3.86	3.85	3.85	-	4.29	4.28	4.28	-	4.79	4.79	4.78	-	4.29	4.28	4.28	-	4.79	4.79	4.78	-			
75		1400	Amps	10.1	10.1	10.0	-	11.5	11.5	11.5	-	13.2	13.2	13.2	-	14.9	14.9	14.9	-	16.9	16.9	16.8	-	19.2	19.2	19.1	-	16.9	16.9	16.9	-	19.2	19.2	19.1	-		
			HI PR	258	259	261	265	298	299	301	306	341	342	344	348	386	388	389	394	436	437	439	443	488	490	491	496	436	437	439	443	488	490	491	496		
			LO PR	123	125	128	133	131	132	136	141	137	139	142	147	143	145	148	153	148	150	153	158	155	157	160	165	148	150	153	158	155	157	160	165		
	1550	MBh	46.9	47.6	49.0	51.1	46.5	47.2	48.5	50.7	45.3	46.0	47.3	49.5	43.2	43.9	45.3	47.4	40.7	41.3	42.7	44.8	38.4	39.0	40.4	42.5	40.7	41.3	42.7	44.8	38.4	39.0	40.4	42.5			
		S/T	0.79	0.71	0.58	0.44	0.79	0.72	0.58	0.44	1.00	0.74	0.61	0.47	1.00	0.76	0.63	0.49	1.00	0.78	0.65	0.51	1.00	1.00	0.70	0.56	1.00	0.78	0.65	0.51	1.00	1.00	0.70	0.56			
		ΔT	22	21	17	14	22	20	17	14	23	21	17	14	22	20	17	14	22	20	17	13	23	21	18	15	22	20	17	13	23	21	18	15			
	1800	KW	2.78	2.78	2.77	2.80	3.10	3.09	3.09	3.11	3.45	3.45	3.44	3.47	3.84	3.83	3.83	3.85	4.27	4.26	4.26	4.28	4.77	4.77	4.76	4.79	4.27	4.26	4.26	4.28	4.77	4.77	4.76	4.79			
		Amps	10.1	10.1	10.1	10.2	11.6	11.5	11.5	11.7	13.2	13.2	13.2	13.3	15.0	14.9	14.9	15.0	16.9	16.9	16.9	17.0	19.2	19.2	19.2	19.3	16.9	16.9	16.9	17.0	19.2	19.2	19.2	19.3			
		HI PR	259	260	262	267	300	301	303	307	342	344	345	350	388	389	391	396	437	439	440	445	490	491	493	498	437	439	440	445	490	491	493	498			
	75	LO PR	125	126	129	135	132	134	137	142	139	140	144	149	144	146	149	154	150	151	155	160	157	158	161	167	150	151	155	160	157	158	161	167			
		MBh	47.9	48.5	49.9	52.0	47.5	48.1	49.5	51.6	46.3	46.9	48.3	50.4	44.2	44.8	46.2	48.3	41.7	42.3	43.7	45.8	39.3	40.0	41.4	43.5	41.7	42.3	43.7	45.8	39.3	40.0	41.4	43.5			
		S/T	0.82	0.75	0.62	0.47	1.00	0.76	0.62	0.48	1.00	0.78	0.65	0.50	1.00	0.80	0.67	0.52	1.00	0.82	0.69	0.55	1.00	1.00	0.74	0.60	1.00	0.82	0.69	0.55	1.00	1.00	0.74	0.60			
1800	ΔT	21	19	16	13	21	19	16	12	21	20	16	13	21	19	16	12	21	19	16	12	22	20	17	13	21	19	16	12	22	20	17	13				
	KW	2.80	2.79	2.79	2.81	3.11	3.11	3.11	3.13	3.47	3.47	3.46	3.49	3.85	3.85	3.85	3.87	4.28	4.28	4.28	4.30	4.79	4.79	4.78	4.80	4.28	4.28	4.28	4.30	4.79	4.79	4.78	4.80				
	Amps	10.2	10.2	10.2	10.3	11.7	11.7	11.6	11.7	13.3	13.3	13.3	13.4	15.1	15.0	15.0	15.1	17.0	17.0	17.0	17.1	19.3	19.3	19.3	19.4	17.0	17.0	17.0	17.1	19.3	19.3	19.3	19.4				
75	HI PR	262	263	265	270	303	304	306	310	345	346	348	353	391	392	394	398	440	441	443	448	493	494	496	500	440	441	443	448	493	494	496	500				
	LO PR	127	129	132	137	135	136	140	145	142	143	146	151	147	149	152	157	152	154	157	162	159	161	164	169	152	154	157	162	159	161	164	169				
	MBh	47.9	48.5	49.9	52.0	47.5	48.1	49.5	51.6	46.3	46.9	48.3	50.4	44.2	44.8	46.2	48.3	41.7	42.3	43.7	45.8	39.3	40.0	41.4	43.5	41.7	42.3	43.7	45.8	39.3	40.0	41.4	43.5				

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

Shaded area reflects ACCA (TVA) conditions

IDB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	46.7	47.3	48.7	50.8	46.3	46.9	48.3	50.4	45.1	45.7	47.1	49.2	43.0	43.6	45.0	47.1	40.4	41.1	42.5	44.6	38.1	38.8	40.2	42.3
	S/T	1.00	0.79	0.66	0.5	1.00	0.80	0.66	0.52	1.00	0.82	0.69	0.6	1.00	0.84	0.71	0.57	1.00	1.00	0.73	0.6	1.00	1.00	0.78	0.64
	ΔT	27	25	22	19	27	25	22	18	27	26	22	19	27	25	22	18	27	25	22	18	28	26	23	19
	KW	2.77	2.77	2.76	2.8	3.09	3.08	3.08	3.10	3.44	3.44	3.43	3.5	3.83	3.82	3.82	3.84	4.26	4.25	4.25	4.3	4.76	4.76	4.75	4.78
	Amps	10.1	10.1	10.0	10.2	11.5	11.5	11.5	11.6	13.2	13.1	13.1	13.2	14.9	14.9	14.9	15.0	16.9	16.9	16.9	17.0	19.2	19.2	19.2	19.3
	HI PR	258	259	261	266	299	300	302	306	341	342	344	349	387	388	390	394	436	437	439	444	489	490	492	496
	LO PR	124	125	129	134	131	133	136	141	138	140	143	148	144	145	148	153	149	151	154	159	156	157	160	166
	MBh	47.2	47.8	49.2	51.3	46.8	47.4	48.8	50.9	45.5	46.2	47.6	49.7	43.5	44.1	45.5	47.6	40.9	41.6	43.0	45.1	38.6	39.3	40.6	42.8
	S/T	1.00	0.83	0.70	0.6	1.00	0.84	0.71	0.57	1.00	0.86	0.73	0.6	1.00	1.00	0.75	0.61	1.00	1.00	0.77	0.6	1.00	1.00	0.82	0.68
	ΔT	26	25	21	18	26	24	21	18	27	25	21	18	26	24	21	18	26	24	21	17	27	25	22	18
KW	2.78	2.78	2.77	2.8	3.10	3.10	3.09	3.12	3.45	3.45	3.45	3.5	3.84	3.84	3.83	3.86	4.27	4.27	4.26	4.3	4.77	4.77	4.76	4.79	
Amps	10.1	10.1	10.1	10.2	11.6	11.6	11.6	11.7	13.2	13.2	13.2	13.3	15.0	15.0	14.9	15.1	16.9	16.9	16.9	17.0	19.3	19.2	19.2	19.3	
HI PR	260	261	263	267	300	302	303	308	343	344	346	350	389	390	392	396	438	439	441	445	491	492	493	498	
LO PR	125	127	130	135	133	134	138	143	139	141	144	149	145	146	150	155	150	152	155	160	157	159	162	167	
MBh	48.1	48.8	50.2	52.3	47.7	48.4	49.8	51.9	46.5	47.2	48.5	50.7	44.4	45.1	46.5	48.6	41.9	42.5	43.9	46.0	39.6	40.2	41.6	43.7	
S/T	1.00	0.87	0.74	0.6	1.00	0.88	0.75	0.60	1.00	0.90	0.77	0.6	1.00	1.00	0.79	0.65	1.00	1.00	0.81	0.7	1.00	1.00	0.86	0.72	
ΔT	25	23	20	17	25	23	20	16	25	24	20	17	25	23	20	16	25	23	20	16	26	24	21	17	
KW	2.80	2.80	2.79	2.8	3.12	3.11	3.11	3.13	3.47	3.47	3.46	3.5	3.86	3.85	3.85	3.87	4.29	4.28	4.28	4.3	4.79	4.79	4.78	4.81	
Amps	10.2	10.2	10.2	10.3	11.7	11.7	11.6	11.7	13.3	13.3	13.3	13.4	15.1	15.0	15.0	15.1	17.0	17.0	17.0	17.1	19.3	19.3	19.3	19.4	
HI PR	263	264	266	270	303	304	306	311	346	347	349	353	391	392	394	399	441	442	444	448	493	494	496	501	
LO PR	128	130	133	138	136	137	140	145	142	144	147	152	148	149	152	157	153	155	158	163	160	161	165	170	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
85	MBh	47.5	48.1	49.5	51.6	47.1	47.7	49.1	51.2	45.8	46.5	47.9	50.0	43.8	44.4	45.8	47.9	41.2	41.9	43.3	45.4	38.9	39.6	40.9	43.0
	S/T	1.00	0.89	0.76	0.62	1.00	0.90	0.76	0.62	1.00	1.00	0.79	0.65	1.00	1.00	0.81	0.67	1.00	1.00	0.83	0.69	1.00	1.00	1.00	0.74
	ΔT	31	29	26	22	31	29	25	22	31	29	26	22	31	29	25	22	30	29	25	22	31	30	26	23
	KW	2.77	2.77	2.77	2.79	3.09	3.09	3.08	3.11	3.45	3.45	3.44	3.46	3.83	3.83	3.82	3.85	4.26	4.26	4.25	4.28	4.77	4.76	4.76	4.78
	Amps	10.1	10.1	10.1	10.2	11.6	11.6	11.5	11.6	13.2	13.2	13.2	13.3	14.9	14.9	14.9	15.0	16.9	16.9	16.9	17.0	19.2	19.2	19.2	19.3
	HI PR	259	261	262	267	300	301	303	307	342	344	345	350	388	389	391	396	437	439	440	445	490	491	493	498
	LO PR	126	127	130	136	133	135	138	143	140	141	145	150	145	147	150	155	151	152	155	161	158	159	162	168
	MBh	47.9	48.6	50.0	52.1	47.5	48.2	49.6	51.7	46.3	47.0	48.4	50.5	44.2	44.9	46.3	48.4	41.7	42.4	43.7	45.9	39.4	40.0	41.4	43.5
	S/T	1.00	0.93	0.80	0.66	1.00	1.00	0.81	0.67	1.00	1.00	0.83	0.69	1.00	1.00	0.85	0.71	1.00	1.00	0.87	0.73	1.00	1.00	1.00	0.78
	ΔT	30	28	25	21	30	28	25	21	30	28	25	21	30	28	25	21	30	28	24	21	31	29	26	22
KW	2.79	2.78	2.78	2.80	3.10	3.10	3.10	3.12	3.46	3.46	3.45	3.48	3.84	3.84	3.84	3.86	4.27	4.27	4.27	4.29	4.78	4.78	4.77	4.79	
Amps	10.2	10.2	10.1	10.2	11.6	11.6	11.6	11.7	13.2	13.2	13.2	13.3	15.0	15.0	15.0	15.1	17.0	17.0	16.9	17.0	19.3	19.3	19.2	19.4	
HI PR	261	262	264	268	302	303	305	309	344	345	347	351	390	391	393	397	439	440	442	447	492	493	495	499	
LO PR	127	129	132	137	135	136	139	145	141	143	146	151	147	148	151	157	152	154	157	162	159	161	164	169	
MBh	48.9	49.6	51.0	53.1	48.5	49.2	50.5	52.6	47.3	47.9	49.3	51.4	45.2	45.9	47.2	49.4	42.7	43.3	44.7	46.8	40.3	41.0	42.4	44.5	
S/T	1.00	0.97	0.84	0.70	1.00	1.00	0.85	0.70	1.00	1.00	0.87	0.73	1.00	1.00	0.89	0.75	1.00	1.00	1.00	0.77	1.00	1.00	1.00	0.82	
ΔT	29	27	24	20	29	27	24	20	29	27	24	20	29	27	23	20	28	27	23	20	30	28	24	21	
KW	2.80	2.80	2.80	2.82	3.12	3.12	3.11	3.14	3.48	3.48	3.47	3.49	3.86	3.86	3.85	3.88	4.29	4.29	4.28	4.31	4.80	4.79	4.79	4.81	
Amps	10.2	10.2	10.2	10.3	11.7	11.7	11.7	11.8	13.3	13.3	13.3	13.4	15.1	15.1	15.0	15.2	17.1	17.0	17.0	17.1	19.4	19.3	19.3	19.4	
HI PR	264	265	267	271	304	305	307	312	347	348	350	354	393	394	395	400	442	443	445	449	495	496	497	502	
LO PR	130	131	135	140	137	139	142	147	144	145	149	154	149	151	154	159	155	156	160	165	162	163	166	172	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	58.8	59.6	61.3	-	58.2	59.1	60.8	-	56.7	57.5	59.3	-	54.1	54.9	56.7	-	50.9	51.7	53.5	-	48.0	48.8	50.6	-
	S/T	0.62	0.55	0.42	-	0.62	0.55	0.43	-	0.65	0.58	0.45	-	0.66	0.59	0.47	-	0.69	0.61	0.49	-	1.00	0.66	0.54	-
	ΔT	21	19	15	-	21	19	15	-	21	19	15	-	21	19	15	-	21	19	15	-	22	20	16	-
	KW	3.43	3.42	3.42	-	3.85	3.85	3.84	-	4.33	4.33	4.32	-	4.84	4.84	4.83	-	5.42	5.42	5.41	-	6.09	6.09	6.08	-
	Amps	13.2	13.2	13.1	-	15.1	15.1	15.1	-	17.3	17.3	17.3	-	19.7	19.6	19.6	-	22.3	22.3	22.2	-	25.4	25.4	25.3	-
	HI PR	270	271	273	-	312	313	315	-	356	358	359	-	404	405	407	-	455	457	459	-	510	511	513	-
LO PR	117	118	121	-	124	125	128	-	130	131	134	-	135	136	139	-	140	141	144	-	146	148	151	-	
1550	MBh	59.7	60.5	62.3	-	59.2	60.0	61.7	-	57.7	58.5	60.2	-	55.1	55.9	57.6	-	51.9	52.7	54.4	-	49.0	49.8	51.5	-
	S/T	0.65	0.58	0.45	-	0.66	0.58	0.46	-	0.68	0.61	0.48	-	0.70	0.63	0.50	-	0.72	0.65	0.52	-	1.00	0.69	0.57	-
	ΔT	20	18	14	-	20	18	14	-	20	18	14	-	20	18	14	-	19	17	14	-	21	19	15	-
	KW	3.45	3.44	3.43	-	3.87	3.87	3.86	-	4.35	4.34	4.34	-	4.86	4.86	4.85	-	5.44	5.43	5.43	-	6.11	6.11	6.10	-
	Amps	13.3	13.3	13.2	-	15.2	15.2	15.2	-	17.4	17.4	17.3	-	19.8	19.7	19.7	-	22.4	22.4	22.3	-	25.5	25.5	25.4	-
	HI PR	272	273	275	-	314	316	318	-	359	360	362	-	406	408	409	-	458	459	461	-	513	514	516	-
LO PR	118	120	123	-	125	127	130	-	132	133	136	-	137	138	141	-	142	143	146	-	148	150	153	-	
2000	MBh	61.2	62.0	63.7	-	60.6	61.5	63.2	-	59.1	60.0	61.7	-	56.5	57.3	59.1	-	53.3	54.2	55.9	-	50.4	51.3	53.0	-
	S/T	0.66	0.59	0.46	-	0.66	0.59	0.47	-	0.69	0.62	0.49	-	0.71	0.64	0.51	-	1.00	0.66	0.53	-	1.00	0.70	0.58	-
	ΔT	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	16	12	-	20	18	14	-
	KW	3.47	3.46	3.46	-	3.89	3.89	3.88	-	4.37	4.37	4.36	-	4.88	4.88	4.87	-	5.46	5.46	5.45	-	6.13	6.13	6.12	-
	Amps	13.4	13.3	13.3	-	15.3	15.3	15.3	-	17.5	17.5	17.4	-	19.8	19.8	19.8	-	22.5	22.5	22.4	-	25.6	25.6	25.5	-
	HI PR	275	276	278	-	317	319	320	-	362	363	365	-	409	410	412	-	461	462	464	-	516	517	519	-
LO PR	121	123	126	-	128	130	133	-	134	136	139	-	140	141	144	-	145	146	149	-	151	152	155	-	
75	MBh	58.8	59.6	61.3	64.0	58.3	59.1	60.8	63.5	56.8	57.6	59.3	62.0	54.1	55.0	56.7	59.3	51.0	51.8	53.5	56.2	48.1	48.9	50.6	53.3
	S/T	0.74	0.67	0.54	0.41	0.74	0.67	0.55	0.41	0.77	0.70	0.57	0.44	1.00	0.71	0.59	0.46	1.00	0.73	0.61	0.48	1.00	0.78	0.66	0.52
	ΔT	25	23	20	16	25	23	19	16	26	24	20	16	25	23	19	16	25	23	19	15	26	24	20	17
	KW	3.42	3.42	3.41	3.45	3.85	3.85	3.84	3.87	4.33	4.32	4.32	4.35	4.84	4.84	4.83	4.86	5.42	5.41	5.41	5.44	6.09	6.09	6.08	6.11
	Amps	13.2	13.1	13.1	13.3	15.1	15.1	15.1	15.2	17.3	17.3	17.2	17.4	19.7	19.6	19.6	19.8	22.3	22.3	22.2	22.4	25.4	25.4	25.3	25.5
	HI PR	270	271	273	278	312	314	315	320	357	358	360	364	404	405	407	412	456	457	459	463	511	512	514	518
LO PR	117	118	121	126	124	125	128	133	130	131	134	139	135	136	139	144	140	141	144	149	146	148	151	155	
1550	MBh	59.7	60.6	62.3	64.9	59.2	60.0	61.8	64.4	57.7	58.5	60.3	62.9	55.1	55.9	57.6	60.3	51.9	52.7	54.5	57.1	49.0	49.8	51.6	54.2
	S/T	0.77	0.70	0.57	0.44	0.78	0.70	0.58	0.45	0.80	0.73	0.60	0.47	1.00	0.75	0.62	0.49	1.00	0.77	0.64	0.51	1.00	0.81	0.69	0.56
	ΔT	24	22	18	15	24	22	18	14	25	23	19	15	24	22	18	14	24	22	18	14	25	23	19	15
	KW	3.44	3.44	3.43	3.46	3.87	3.87	3.86	3.89	4.34	4.34	4.33	4.37	4.86	4.86	4.85	4.88	5.44	5.43	5.42	5.46	6.11	6.11	6.10	6.13
	Amps	13.3	13.2	13.2	13.4	15.2	15.2	15.2	15.3	17.4	17.4	17.3	17.5	19.7	19.7	19.7	19.8	22.4	22.4	22.3	22.5	25.5	25.4	25.4	25.6
	HI PR	272	274	276	280	315	316	318	322	359	360	362	367	407	408	410	414	458	459	461	466	513	514	516	521
LO PR	118	120	123	128	125	127	130	135	132	133	136	141	137	138	141	146	142	143	146	151	148	150	153	157	
1750	MBh	61.2	62.0	63.8	66.4	60.7	61.5	63.2	65.9	59.2	60.0	61.7	64.4	56.6	57.4	59.1	61.8	53.4	54.2	55.9	58.6	50.5	51.3	53.0	55.7
	S/T	0.78	0.71	0.58	0.45	0.78	0.71	0.59	0.46	1.00	0.74	0.61	0.48	1.00	0.75	0.63	0.50	1.00	0.78	0.65	0.52	1.00	0.82	0.70	0.56
	ΔT	23	21	17	13	23	21	17	13	23	21	18	14	23	21	17	13	23	21	17	13	24	22	18	14
	KW	3.46	3.46	3.45	3.49	3.89	3.89	3.88	3.91	4.37	4.36	4.36	4.39	4.88	4.88	4.87	4.90	5.46	5.45	5.45	5.48	6.13	6.13	6.12	6.15
	Amps	13.3	13.3	13.3	13.4	15.3	15.3	15.3	15.4	17.5	17.5	17.4	17.6	19.8	19.8	19.8	19.9	22.5	22.5	22.4	22.6	25.6	25.6	25.5	25.7
	HI PR	275	277	278	283	318	319	321	325	362	363	365	370	410	411	413	417	461	462	464	469	516	517	519	523
LO PR	121	123	126	131	128	130	133	138	134	136	139	144	140	141	144	149	145	146	149	154	151	152	155	160	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	59.1	59.9	61.6	64.3	58.6	59.4	61.1	63.8	57.1	57.9	59.6	62.3	54.4	55.3	57.0	59.6	51.3	52.1	53.8	56.5	48.4	49.2	50.9	53.6
	S/T	0.85	0.78	0.66	0.5	1.00	0.79	0.66	0.53	1.00	0.81	0.69	0.6	1.00	0.83	0.70	0.57	1.00	0.85	0.72	0.6	1.00	1.00	0.77	0.64
	ΔT	30	28	24	20	30	28	24	20	30	28	24	20	30	28	24	20	30	28	24	20	31	29	25	21
	KW	3.43	3.42	3.42	3.5	3.85	3.85	3.84	3.87	4.33	4.32	4.32	4.4	4.84	4.84	4.83	4.87	5.42	5.42	5.41	5.4	6.09	6.09	6.08	6.12
	Amps	13.2	13.2	13.1	13.3	15.1	15.1	15.1	15.2	17.3	17.3	17.3	17.4	19.7	19.6	19.6	19.8	22.3	22.3	22.2	22.4	25.4	25.4	25.3	25.5
	HI PR	271	272	274	278	313	314	316	321	357	358	360	365	405	406	408	413	456	457	459	464	511	512	514	519
	LO PR	117	118	121	126	124	125	128	133	130	132	135	139	135	137	140	145	140	142	145	150	147	148	151	156
	MBh	60.0	60.9	62.6	65.2	59.5	60.3	62.1	64.7	58.0	58.8	60.6	63.2	55.4	56.2	57.9	60.6	52.2	53.0	54.8	57.4	49.3	50.1	51.9	54.5
	S/T	0.89	0.81	0.69	0.6	1.00	0.82	0.70	0.56	1.00	0.84	0.72	0.6	1.00	0.86	0.74	0.60	1.00	0.88	0.76	0.6	1.00	1.00	0.80	0.67
	ΔT	29	27	23	19	29	27	23	19	29	27	23	19	29	27	23	19	29	26	23	19	30	28	24	20
KW	3.44	3.44	3.43	3.5	3.87	3.87	3.86	3.89	4.35	4.34	4.34	4.4	4.86	4.86	4.85	4.88	5.44	5.43	5.43	5.5	6.11	6.11	6.10	6.13	
Amps	13.3	13.2	13.2	13.4	15.2	15.2	15.2	15.3	17.4	17.4	17.3	17.5	19.7	19.7	19.7	19.8	22.4	22.4	22.3	22.5	25.5	25.5	25.4	25.6	
HI PR	273	274	276	281	315	316	318	323	359	361	362	367	407	408	410	415	458	460	462	466	513	514	516	521	
LO PR	119	120	123	128	126	127	130	135	132	134	136	141	137	139	142	146	142	144	147	152	149	150	153	158	
MBh	61.5	62.3	64.1	66.7	61.0	61.8	63.5	66.2	59.5	60.3	62.0	64.7	56.9	57.7	59.4	62.1	53.7	54.5	56.2	58.9	50.8	51.6	53.3	56.0	
S/T	0.89	0.82	0.70	0.6	1.00	0.83	0.70	0.57	1.00	0.85	0.73	0.6	1.00	0.87	0.75	0.61	1.00	1.00	0.77	0.6	1.00	1.00	0.81	0.68	
ΔT	28	26	22	18	28	26	22	18	28	26	22	18	28	26	22	18	27	25	21	18	29	27	23	19	
KW	3.47	3.46	3.46	3.5	3.89	3.89	3.88	3.91	4.37	4.36	4.36	4.4	4.88	4.88	4.87	4.90	5.46	5.46	5.45	5.5	6.13	6.13	6.12	6.16	
Amps	13.4	13.3	13.3	13.5	15.3	15.3	15.3	15.4	17.5	17.5	17.4	17.6	19.8	19.8	19.8	19.9	22.5	22.5	22.4	22.6	25.6	25.6	25.5	25.7	
HI PR	276	277	279	284	318	319	321	326	362	364	365	370	410	411	413	418	461	463	464	469	516	517	519	524	
LO PR	122	123	126	131	129	130	133	138	135	136	139	144	140	142	144	149	145	147	150	154	152	153	156	161	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
85	MBh	60.1	60.9	62.6	65.3	59.5	60.4	62.1	64.7	58.0	58.8	60.6	63.2	55.4	56.2	58.0	60.6	52.2	53.1	54.8	57.4	49.3	50.2	51.9	54.5
	S/T	1.00	0.88	0.75	0.62	1.00	0.88	0.76	0.62	1.00	0.91	0.78	0.65	1.00	1.00	0.80	0.67	1.00	1.00	0.82	0.69	1.00	1.00	0.87	0.73
	ΔT	34	32	28	24	34	32	28	24	34	32	28	24	34	32	28	24	34	32	28	24	35	33	29	25
	KW	3.43	3.43	3.42	3.46	3.86	3.86	3.85	3.88	4.34	4.33	4.33	4.36	4.85	4.85	4.84	4.87	5.43	5.42	5.42	5.45	6.10	6.10	6.09	6.12
	Amps	13.2	13.2	13.2	13.3	15.2	15.1	15.1	15.3	17.3	17.3	17.3	17.4	19.7	19.7	19.7	19.8	22.3	22.3	22.3	22.4	25.4	25.4	25.4	25.5
	HI PR	272	273	275	280	314	315	317	322	358	360	361	366	406	407	409	414	457	459	460	465	512	513	515	520
	LO PR	119	120	123	128	126	127	130	135	132	133	136	141	137	138	141	146	142	144	146	151	148	150	153	158
	MBh	61.0	61.8	63.6	66.2	60.5	61.3	63.0	65.7	59.0	59.8	61.5	64.2	56.4	57.2	58.9	61.6	53.2	54.0	55.7	58.4	50.3	51.1	52.8	55.5
	S/T	1.00	0.91	0.78	0.65	1.00	0.91	0.79	0.66	1.00	0.94	0.81	0.68	1.00	1.00	0.83	0.70	1.00	1.00	0.85	0.72	1.00	1.00	0.90	0.77
	ΔT	33	31	27	23	33	31	27	23	33	31	27	23	33	31	27	23	33	31	27	23	34	32	28	24
KW	3.45	3.45	3.44	3.48	3.88	3.88	3.87	3.90	4.36	4.35	4.34	4.38	4.87	4.87	4.86	4.89	5.45	5.44	5.44	5.47	6.12	6.12	6.11	6.14	
Amps	13.3	13.3	13.3	13.4	15.3	15.2	15.2	15.4	17.4	17.4	17.4	17.5	19.8	19.8	19.7	19.9	22.4	22.4	22.4	22.5	25.5	25.5	25.5	25.6	
HI PR	274	275	277	282	316	318	319	324	361	362	364	368	408	410	411	416	460	461	463	467	515	516	518	522	
LO PR	121	122	125	130	128	129	132	137	134	135	138	143	139	140	143	148	144	145	148	153	150	152	155	160	
MBh	62.5	63.3	65.0	67.7	62.0	62.8	64.5	67.2	60.4	61.3	63.0	65.6	57.8	58.7	60.4	63.0	54.7	55.5	57.2	59.9	51.7	52.6	54.3	56.9	
S/T	1.00	0.92	0.79	0.66	1.00	0.92	0.80	0.67	1.00	1.00	0.82	0.69	1.00	1.00	0.84	0.71	1.00	1.00	0.86	0.73	1.00	1.00	0.91	0.77	
ΔT	32	30	26	22	32	30	26	22	32	30	26	22	32	30	26	22	31	29	26	22	33	31	27	23	
KW	3.47	3.47	3.46	3.50	3.90	3.90	3.89	3.92	4.38	4.37	4.37	4.40	4.89	4.89	4.88	4.91	5.47	5.46	5.46	5.49	6.14	6.14	6.13	6.16	
Amps	13.4	13.4	13.3	13.5	15.3	15.3	15.3	15.4	17.5	17.5	17.5	17.6	19.9	19.9	19.8	20.0	22.5	22.5	22.5	22.6	25.6	25.6	25.6	25.7	
HI PR	277	278	280	285	319	321	322	327	364	365	367	371	411	412	414	419	463	464	466	470	518	519	521	525	
LO PR	124	125	128	133	131	132	135	140	137	138	141	146	142	143	146	151	147	148	151	156	153	155	158	162	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

VSX140181A* / CA*F3636*6** W/.052" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 600 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75	19,300	13,124	6,176	1,220
80	19,050	13,142	5,908	1,290
85	18,800	13,160	5,640	1,360
90	18,400	13,060	5,340	1,435
95	18,000	12,960	5,040	1,510
100	17,500	12,770	4,730	1,595
105	17,000	12,580	4,420	1,680
110	16,550	12,650	3,901	1,780
115	16,100	12,719	3,381	1,880
TVA CONDITIONS @ 95° OD DB, 75° ID DB 63° ID WB				
95°	17,400	12,700	4,700	1,510

VSX140191A* / CA*F3636*6** W/.053" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 550 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75	18,900	13,041	5,859	1,160
80	18,650	13,145	5,506	1,225
85	18,400	13,248	5,152	1,290
90	18,000	13,136	4,864	1,360
95	17,600	13,024	4,576	1,430
100	17,100	12,820	4,280	1,530
105	16,600	12,616	3,984	1,590
110	16,150	12,667	3,484	1,680
115	15,700	12,717	2,983	1,770
TVA CONDITIONS @ 95° OD DB, 75° ID DB 63° ID WB				
95°	17,000	12,750	4,250	1,430

VSX140241A* / CA*F3636*6** W/.057" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 700 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75	24,877	16,961	7,916	1,554
80	24,568	17,040	7,528	1,644
85	24,260	17,120	7,140	1,735
90	23,730	16,961	6,769	1,833
95	23,200	16,802	6,397	1,931
100	22,552	16,564	5,988	2,040
105	21,904	16,326	5,578	2,149
110	21,312	16,393	4,919	2,278
115	20,721	16,461	4,260	2,406
TVA CONDITIONS @ 95° OD DB, 75° ID DB 63° ID WB				
95°	22,400	16,802	5,598	1,931

VSX140251A* / CA*F3636*6** W/.057" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 700 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75	25,500	17,085	8,415	1,570
80	25,200	17,258	7,943	1,660
85	24,900	17,430	7,470	1,750
90	24,350	17,283	7,067	1,850
95	23,800	17,136	6,664	1,950
100	23,150	16,893	6,257	2,060
105	22,500	16,650	5,850	2,170
110	21,900	16,739	5,162	2,300
115	21,300	16,827	4,473	2,430
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	23,000	16,790	6,210	1,950

VSX140301A* / CA*F3642*6** W/.065" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1000 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75	30,900	21,630	9,270	1,960
80	30,500	21,651	8,849	2,070
85	30,100	21,672	8,428	2,180
90	29,450	21,492	7,958	2,300
95	28,800	21,312	7,488	2,420
100	28,000	20,992	7,008	2,550
105	27,200	20,672	6,528	2,680
110	26,450	20,745	5,706	2,840
115	25,700	20,817	4,883	3,000
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	27,800	20,850	6,950	2,420

VSX140311A* / CA*F3137*6** W/.063" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1000 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75	30,700	22,718	7,982	1,920
80	30,300	22,871	7,430	2,025
85	29,900	23,023	6,877	2,130
90	29,250	22,809	6,442	2,245
95	28,600	22,594	6,006	2,360
100	27,800	22,232	5,568	2,490
105	27,000	21,870	5,130	2,620
110	26,250	21,900	4,350	2,770
115	25,500	21,930	3,570	2,920
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	27,600	20,080	5,520	2,360

VSX140361A* / CA*F3642*6** W/.068" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1200 CFM				
Outdoor Tem. ° F.	Total Btuh	Sensible Btuh	Latent Btuh	Total Watts
75	36,700	25,690	11,010	2,330
80	36,250	25,733	10,517	2,460
85	35,800	25,776	10,024	2,590
90	35,000	25,542	9,458	2,730
95	34,200	25,308	8,892	2,870
100	33,250	24,928	8,322	3,030
105	32,300	24,548	7,752	3,190
110	31,400	24,627	6,774	3,370
115	30,500	24,705	5,795	3,550
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	33,000	24,750	8,250	2,870

VSX140371A* / CA*F3137*6** W/.071" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1100 CFM				
Outdoor Tem. ° F.	Total Btuh	Sensible Btuh	Latent Btuh	Total Watts
75	36,500	25,915	10,585	2,260
80	36,050	26,130	9,921	2,400
85	35,600	26,344	9,256	2,540
90	34,800	26,092	8,708	2,675
95	34,000	25,840	8,160	2,810
100	33,050	25,439	7,611	2,970
105	32,100	25,038	7,062	3,130
110	31,250	25,135	6,115	3,315
115	30,400	25,232	5,168	3,500
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	32,800	25,256	7,544	2,810

VSX140421A* / CA*F4961*6** W/.074" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1400 CFM				
Outdoor Tem. ° F.	Total Btuh	Sensible Btuh	Latent Btuh	Total Watts
75	41,800	30,932	10,868	2,600
80	41,300	31,174	10,126	2,750
85	40,800	31,416	9,384	2,900
90	39,900	31,113	8,787	3,060
95	39,000	30,810	8,190	3,220
100	37,900	30,309	7,591	3,400
105	36,800	29,808	6,992	3,580
110	35,800	30,042	5,758	3,795
115	34,800	30,276	4,524	4,010
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	37,600	30,080	7,520	3,220

VSX140431A* / CA*F4961*6D* W/.074" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1400 CFM				
Outdoor Tem. ° F.	Total Btuh	Sensible Btuh	Latent Btuh	Total Watts
75	41,800	30,932	10,868	2,600
80	41,300	31,174	10,126	2,750
85	40,800	31,416	9,384	2,900
90	39,900	31,113	8,787	3,060
95	39,000	30,810	8,190	3,220
100	37,900	30,309	7,591	3,400
105	36,800	29,808	6,992	3,580
110	35,800	30,042	5,758	3,795
115	34,800	30,276	4,524	4,010
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	37,600	30,080	7,520	3,220

VSX140481A* / CA*F4860*6** W/.078" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1400 CFM				
Outdoor Tem. ° F.	Total Btuh	Sensible Btuh	Latent Btuh	Total Watts
75	48,300	31,878	16,422	3,080
80	47,700	32,189	15,511	3,255
85	47,100	32,500	14,600	3,430
90	46,050	32,225	13,825	3,625
95	45,000	31,950	13,050	3,820
100	43,750	31,488	12,263	4,035
105	42,500	31,025	11,475	4,250
110	41,350	31,191	10,160	4,500
115	40,200	31,356	8,844	4,750
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	43,400	31,248	12,152	3,820

VSX140601A* / CA*F4961*6** W/.088" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1550 CFM				
Outdoor Tem. ° F.	Total Btuh	Sensible Btuh	Latent Btuh	Total Watts
75	61,100	40,326	20,774	3,840
80	60,350	40,725	19,625	4,080
85	59,600	41,124	18,476	4,320
90	58,300	40,512	17,788	4,575
95	57,000	39,900	17,100	4,830
100	55,400	39,318	16,082	5,120
105	53,800	38,736	15,064	5,410
110	52,350	38,965	13,386	5,745
115	50,900	39,193	11,707	6,080
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	55,000	39,050	15,950	4,840

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0181A*	ARUF25B14A*		17,800	12,800	14.0	11.5	570	7984201
	ASPT24B14A*		18,000	13,000	14.5	12.0	605	7517537
	ASPT25B14A*		17,800	12,800	14.5	12.0	580	8242093
	ASPT29B14A*		18,000	13,000	15.0	12.5	560	8242094
	ASPT30C14A*		18,400	13,300	14.5	12.0	580	7517538
	AVPTC24B14A*		18,000	13,000	14.5	12.0	600	7517539
	AVPTC30C14A*		18,400	13,300	14.5	12.0	615	7517540
	AWUF19XX16A*		17,000	12,200	14.0	11.5	600	8033009
	AWUF31XX16A*		17,400	12,500	14.5	11.5	600	7517541
	AWUF32XX16A*		17,400	12,500	14.5	11.5	600	7517542
	CA*F3636*6D*+EEP+TXV		17,800	12,800	14.0	11.5	600	7517543
	CA*F3636*6D*+MBVC1200**-1A*+TXV		17,800	12,800	14.5	11.5	600	7517565
	CA*F3636*6D*+TXV	A*EC960302BNA*	17,800	12,800	14.5	11.5	575	7517544
	CA*F3636*6D*+TXV	A*EC960402BNA*	17,800	12,800	14.5	11.5	575	7517545
	CA*F3636*6D*+TXV	A*EC960603BNA*	17,800	12,800	14.5	11.5	500	7517546
	CA*F3636*6D*+TXV	A*EC960803BNA*	17,800	12,800	14.5	11.5	540	7517547
	CA*F3636*6D*+TXV	A*VC80604B*B*	18,000	13,000	14.5	11.5	620	7517548
	CA*F3636*6D*+TXV	A*VC960403BNA*	18,000	13,000	14.5	11.5	615	7517549
	CA*F3636*6D*+TXV	A*VC960603BNA*	18,000	13,000	14.5	11.5	625	7517550
	CA*F3636*6D*+TXV	A*VC960803BNA*	18,000	13,000	14.5	11.5	620	7517551
	CA*F3636*6D*+TXV	A*VM970603BNA*	18,000	13,000	14.5	11.5	625	7517552
	CA*F3636*6D*+TXV	A*VM970804CNA*	18,000	13,000	14.5	11.5	620	7517553
	CA*F3636*6D*+TXV	G*E80603B*B*	18,000	13,000	14.5	11.5	670	7517554
	CA*F3636*6D*+TXV	G*EC960302BNA*	17,800	12,800	14.5	11.5	575	7517555
	CA*F3636*6D*+TXV	G*EC960402BNA*	17,800	12,800	14.5	11.5	575	7517556
	CA*F3636*6D*+TXV	G*EC960603BNA*	17,800	12,800	14.5	11.5	500	7517557
	CA*F3636*6D*+TXV	G*EC960803BNA*	17,800	12,800	14.5	11.5	540	7517558
	CA*F3636*6D*+TXV	G*VC80604B*B*	18,000	13,000	14.5	11.5	620	7517559
	CA*F3636*6D*+TXV	G*VC960403BNA*	18,000	13,000	14.5	11.5	615	7517560
	CA*F3636*6D*+TXV	G*VC960603BNA*	18,000	13,000	14.5	11.5	625	7517561
	CA*F3636*6D*+TXV	G*VC960803BNA*	18,000	13,000	14.5	11.5	620	7517562
	CA*F3636*6D*+TXV	G*VM970603BNA*	18,000	13,000	14.5	11.5	625	7517563
	CA*F3636*6D*+TXV	G*VM970804CNA*	18,000	13,000	14.5	11.5	620	7517564
	CA*F3743*6D*+EEP+TXV		18,000	13,000	14.5	11.5	600	7517566
	CAPT3743*4A*	A*EC960302BNA*	17,800	12,800	14.5	11.5	575	7517568
	CAPT3743*4A*	A*EC960402BNA*	17,800	12,800	14.5	11.5	575	7517569
	CAPT3743*4A*	A*EC960603BNA*	17,800	12,800	14.5	11.5	500	7517570
	CAPT3743*4A*	A*EC960803BNA*	17,800	12,800	14.5	11.5	540	7517571
	CAPT3743*4A*	A*VC80604B*B*	18,000	13,000	14.5	11.5	620	7517572
	CAPT3743*4A*	A*VC960403BNA*	18,000	13,000	14.5	11.5	615	7517573
	CAPT3743*4A*	A*VC960603BNA*	18,000	13,000	14.5	11.5	625	7517574
	CAPT3743*4A*	A*VC960803BNA*	18,000	13,000	14.5	11.5	620	7517575
	CAPT3743*4A*	A*VM970603BNA*	18,000	13,000	14.5	11.5	625	7517576
	CAPT3743*4A*	A*VM970804CNA*	18,000	13,000	14.5	11.5	620	7517577
	CAPT3743*4A*	G*E80603B*B*	18,000	13,000	14.5	11.5	670	7517578
CAPT3743*4A*	G*EC960302BNA*	17,800	12,800	14.5	11.5	575	7517579	
CAPT3743*4A*	G*EC960402BNA*	17,800	12,800	14.5	11.5	575	7517580	
CAPT3743*4A*	G*EC960603BNA*	17,800	12,800	14.5	11.5	500	7517581	
CAPT3743*4A*	G*EC960803BNA*	17,800	12,800	14.5	11.5	540	7517582	
CAPT3743*4A*	G*VC80604B*B*	18,000	13,000	14.5	11.5	620	7517583	
CAPT3743*4A*	G*VC960403BNA*	18,000	13,000	14.5	11.5	615	7517584	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0181A* (cont)	CAPT3743*4A*	G*VC960603BNA*	18,000	13,000	14.5	11.5	625	7517585
	CAPT3743*4A*	G*VC960803BNA*	18,000	13,000	14.5	11.5	620	7517586
	CAPT3743*4A*	G*VM970603BNA*	18,000	13,000	14.5	11.5	625	7517587
	CAPT3743*4A*	G*VM970804CNA*	18,000	13,000	14.5	11.5	620	7517588
	CAPT3743*4A*+EEP		17,800	12,800	14.0	11.5	550	7517567
	CAPT3743*4A*+MBVC1200**-1A*		17,400	12,500	14.5	12.0	535	7517589
	CHPF2430B6C*+EEP+TXV		17,800	12,800	14.0	11.5	600	7517590
	CHPF2430B6C*+MBVC1200**-1A*+TXV		17,800	12,800	14.5	11.5	600	7517591
	CHPF2430B6C*+TXV	A*VC80604B*B*	18,000	13,000	14.5	11.5	620	7517592
	CHPF2430B6C*+TXV	G*VC80604B*B*	18,000	13,000	14.5	11.5	620	7517593
	CHPF3636B6C*+EEP+TXV		18,000	13,000	14.5	11.5	600	7517594
	CHPF3636B6C*+TXV	A*EC960302BNA*	17,800	12,800	14.5	11.5	575	7517595
	CHPF3636B6C*+TXV	A*EC960402BNA*	17,800	12,800	14.5	11.5	575	7517596
	CHPF3636B6C*+TXV	A*EC960603BNA*	17,800	12,800	14.5	11.5	500	7517597
	CHPF3636B6C*+TXV	A*EC960803BNA*	17,800	12,800	14.5	11.5	540	7517598
	CHPF3636B6C*+TXV	A*VC960403BNA*	18,000	13,000	14.5	11.5	615	7517599
	CHPF3636B6C*+TXV	A*VC960603BNA*	18,000	13,000	14.5	11.5	625	7517600
	CHPF3636B6C*+TXV	A*VC960803BNA*	18,000	13,000	14.5	11.5	620	7517601
	CHPF3636B6C*+TXV	A*VM970603BNA*	18,000	13,000	14.5	11.5	625	7517602
	CHPF3636B6C*+TXV	A*VM970804CNA*	18,000	13,000	14.5	11.5	620	7517603
	CHPF3636B6C*+TXV	G*E80603B*B*	18,000	13,000	14.5	11.5	670	7517604
	CHPF3636B6C*+TXV	G*EC960302BNA*	17,800	12,800	14.5	11.5	575	7517605
	CHPF3636B6C*+TXV	G*EC960402BNA*	17,800	12,800	14.5	11.5	575	7517606
	CHPF3636B6C*+TXV	G*EC960603BNA*	17,800	12,800	14.5	11.5	500	7517607
	CHPF3636B6C*+TXV	G*EC960803BNA*	17,800	12,800	14.5	11.5	540	7517608
	CHPF3636B6C*+TXV	G*VC960403BNA*	18,000	13,000	14.5	11.5	615	7517609
	CHPF3636B6C*+TXV	G*VC960603BNA*	18,000	13,000	14.5	11.5	625	7517610
	CHPF3636B6C*+TXV	G*VC960803BNA*	18,000	13,000	14.5	11.5	620	7517611
	CHPF3636B6C*+TXV	G*VM970603BNA*	18,000	13,000	14.5	11.5	625	7517612
	CHPF3636B6C*+TXV	G*VM970804CNA*	18,000	13,000	14.5	11.5	620	7517613
	CSCF3036N6D*+EEP+TXV		17,800	12,800	14.0	11.5	600	7517614
	CSCF3036N6D*+TXV	A*VC80604B*B*	18,000	13,000	14.5	11.5	620	7517615
	CSCF3036N6D*+TXV	G*VC80604B*B*	18,000	13,000	14.5	11.5	620	7517616
	CSCF3036N6D*+TXV	A*EC960302BNA*	17,800	12,800	14.5	11.5	575	7517617
	CSCF3036N6D*+TXV	A*EC960402BNA*	17,800	12,800	14.5	11.5	575	7517618
	CSCF3036N6D*+TXV	A*EC960603BNA*	17,800	12,800	14.5	11.5	500	7517619
	CSCF3036N6D*+TXV	A*EC960803BNA*	17,800	12,800	14.5	11.5	540	7517620
	CSCF3036N6D*+TXV	A*VC960403BNA*	18,000	13,000	14.5	11.5	615	7517621
	CSCF3036N6D*+TXV	A*VC960603BNA*	18,000	13,000	14.5	11.5	625	7517622
	CSCF3036N6D*+TXV	A*VC960803BNA*	18,000	13,000	14.5	11.5	620	7517623
	CSCF3036N6D*+TXV	A*VM970603BNA*	18,000	13,000	14.5	11.5	625	7517624
	CSCF3036N6D*+TXV	A*VM970804CNA*	18,000	13,000	14.5	11.5	620	7517625
CSCF3036N6D*+TXV	G*EC960302BNA*	17,800	12,800	14.5	11.5	575	7517626	
CSCF3036N6D*+TXV	G*EC960402BNA*	17,800	12,800	14.5	11.5	575	7517627	
CSCF3036N6D*+TXV	G*EC960603BNA*	17,800	12,800	14.5	11.5	500	7517628	
CSCF3036N6D*+TXV	G*EC960803BNA*	17,800	12,800	14.5	11.5	540	7517629	
CSCF3036N6D*+TXV	G*VC960403BNA*	18,000	13,000	14.5	11.5	615	7517630	
CSCF3036N6D*+TXV	G*VC960603BNA*	18,000	13,000	14.5	11.5	625	7517631	
CSCF3036N6D*+TXV	G*VC960803BNA*	18,000	13,000	14.5	11.5	620	7517632	
CSCF3036N6D*+TXV	G*VM970603BNA*	18,000	13,000	14.5	11.5	625	7517633	
CSCF3036N6D*+TXV	G*VM970804CNA*	18,000	13,000	14.5	11.5	620	7517634	
CSCF3642N6D*+EEP+TXV		18,000	13,000	14.5	11.5	600	7517635	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0191A*	ARUF25B14A*		17,800	13,100	14.0	12.2	570	7984202
	ASPT24B14A*		17,800	13,100	14.5	12.2	525	7517636
	ASPT25B14A*		17,800	13,100	14.5	12.2	580	8242095
	ASPT29B14A*		18,000	13,300	15.0	12.5	560	8242096
	ASPT30C14A*		18,000	13,300	15.0	12.5	600	7517637
	AVPTC24B14A*		17,800	13,100	14.5	12.2	600	7517638
	AVPTC30C14A*		18,200	13,400	15.0	12.5	615	7517639
	AWUF19XX16A*		17,000	12,600	14.0	12.2	600	8033010
	AWUF31XX16A*		17,200	12,700	15.0	12.5	550	7517640
	AWUF32XX16A*		17,200	12,700	15.0	12.5	550	7517641
	CA*F3636*6D*+EEP+TXV		17,600	13,000	14.0	12.2	550	7517642
	CA*F3636*6D*+MBVC1200**-1A*+TXV		18,000	13,300	15.0	12.5	600	7517643
	CA*F3636*6D*+TXV	A*EC960302BNA*	17,800	13,100	15.0	12.5	575	7517644
	CA*F3636*6D*+TXV	A*EC960402BNA*	17,800	13,100	15.0	12.5	575	7517645
	CA*F3636*6D*+TXV	A*EC960603BNA*	17,800	13,100	15.0	12.5	500	7517646
	CA*F3636*6D*+TXV	A*EC960803BNA*	17,800	13,100	15.0	12.5	540	7517647
	CA*F3636*6D*+TXV	A*VC80604B*B*	17,800	13,100	15.0	12.5	620	7517648
	CA*F3636*6D*+TXV	A*VC960403BNA*	17,800	13,100	15.0	12.5	615	7517649
	CA*F3636*6D*+TXV	A*VC960603BNA*	17,800	13,100	15.0	12.5	625	7517650
	CA*F3636*6D*+TXV	A*VC960803BNA*	17,800	13,100	15.0	12.5	620	7517651
	CA*F3636*6D*+TXV	A*VM970603BNA*	17,800	13,100	15.0	12.5	625	7517652
	CA*F3636*6D*+TXV	A*VM970804CNA*	17,800	13,100	15.0	12.5	620	7517653
	CA*F3636*6D*+TXV	G*E80603B*B*	17,800	13,100	15.0	12.5	600	7517654
	CA*F3636*6D*+TXV	G*EC960302BNA*	17,800	13,100	15.0	12.5	575	7517655
	CA*F3636*6D*+TXV	G*EC960402BNA*	17,800	13,100	15.0	12.5	575	7517656
	CA*F3636*6D*+TXV	G*EC960603BNA*	17,800	13,100	15.0	12.5	500	7517657
	CA*F3636*6D*+TXV	G*EC960803BNA*	17,800	13,100	15.0	12.5	540	7517658
	CA*F3636*6D*+TXV	G*VC80604B*B*	17,800	13,100	15.0	12.5	620	7517659
	CA*F3636*6D*+TXV	G*VC960403BNA*	17,800	13,100	15.0	12.5	615	7517660
	CA*F3636*6D*+TXV	G*VC960603BNA*	17,800	13,100	15.0	12.5	625	7517661
	CA*F3636*6D*+TXV	G*VC960803BNA*	17,800	13,100	15.0	12.5	620	7517662
	CA*F3636*6D*+TXV	G*VM970603BNA*	17,800	13,100	15.0	12.5	625	7517663
	CA*F3636*6D*+TXV	G*VM970804CNA*	17,800	13,100	15.0	12.5	620	7517664
	CA*F3743*6D*+EEP+TXV		18,000	13,300	14.5	12.2	550	7517665
	CAPT3743*4A*	A*EC960302BNA*	17,800	13,100	15.0	12.5	575	7517668
	CAPT3743*4A*	A*EC960402BNA*	17,800	13,100	15.0	12.5	575	7517669
	CAPT3743*4A*	A*EC960603BNA*	17,800	13,100	15.0	12.5	500	7517670
	CAPT3743*4A*	A*EC960803BNA*	17,800	13,100	15.0	12.5	540	7517671
	CAPT3743*4A*	A*VC80604B*B*	17,800	13,100	15.0	12.5	620	7517672
	CAPT3743*4A*	A*VC960403BNA*	17,800	13,100	15.0	12.5	615	7517673
	CAPT3743*4A*	A*VC960603BNA*	17,800	13,100	15.0	12.5	625	7517674
	CAPT3743*4A*	A*VC960803BNA*	17,800	13,100	15.0	12.5	620	7517675
	CAPT3743*4A*	A*VM970603BNA*	17,800	13,100	15.0	12.5	625	7517676
	CAPT3743*4A*	A*VM970804CNA*	17,800	13,100	15.0	12.5	620	7517677
	CAPT3743*4A*	G*E80603B*B*	17,800	13,100	15.0	12.5	600	7517678
	CAPT3743*4A*	G*EC960302BNA*	17,800	13,100	15.0	12.5	575	7517679
	CAPT3743*4A*	G*EC960402BNA*	17,800	13,100	15.0	12.5	575	7517680
CAPT3743*4A*	G*EC960603BNA*	17,800	13,100	15.0	12.5	500	7517681	
CAPT3743*4A*	G*EC960803BNA*	17,800	13,100	15.0	12.5	540	7517682	
CAPT3743*4A*	G*VC80604B*B*	17,800	13,100	15.0	12.5	620	7517683	
CAPT3743*4A*	G*VC960403BNA*	17,800	13,100	15.0	12.5	615	7517684	
CAPT3743*4A*	G*VC960603BNA*	17,800	13,100	15.0	12.5	625	7517685	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0191A* (cont.)	CAPT3743*4A*	G*VC960803BNA*	17,800	13,100	15.0	12.5	620	7517686
	CAPT3743*4A*	G*VM970603BNA*	17,800	13,100	15.0	12.5	625	7517687
	CAPT3743*4A*	G*VM970804CNA*	17,800	13,100	15.0	12.5	620	7517688
	CAPT3743*4A*+EEP		17,600	13,000	14.0	12.2	550	7517666
	CAPT3743*4A*+MBVC1200**-1A*		17,800	13,100	15.0	12.5	600	7517667
	CHPF3636B6C*+EEP+TXV		17,600	13,000	14.5	12.2	550	7517689
	CHPF3636B6C*+MBVC1200**-1A*+TXV		18,200	13,400	15.0	12.5	600	7517690
	CHPF3636B6C*+TXV	A*EC960302BNA*	17,800	13,100	15.0	12.5	575	7517691
	CHPF3636B6C*+TXV	A*EC960402BNA*	17,800	13,100	15.0	12.5	575	7517692
	CHPF3636B6C*+TXV	A*EC960603BNA*	17,800	13,100	15.0	12.5	500	7517693
	CHPF3636B6C*+TXV	A*EC960803BNA*	17,800	13,100	15.0	12.5	540	7517694
	CHPF3636B6C*+TXV	A*VC80604B*B*	17,800	13,100	15.0	12.5	620	7517695
	CHPF3636B6C*+TXV	A*VC960403BNA*	17,800	13,100	15.0	12.5	615	7517696
	CHPF3636B6C*+TXV	A*VC960603BNA*	17,800	13,100	15.0	12.5	625	7517697
	CHPF3636B6C*+TXV	A*VC960803BNA*	17,800	13,100	15.0	12.5	620	7517698
	CHPF3636B6C*+TXV	A*VM970603BNA*	17,800	13,100	15.0	12.5	625	7517699
	CHPF3636B6C*+TXV	A*VM970804CNA*	17,800	13,100	15.0	12.5	620	7517700
	CHPF3636B6C*+TXV	G*E80603B*B*	17,800	13,100	15.0	12.5	600	7517701
	CHPF3636B6C*+TXV	G*EC960302BNA*	17,800	13,100	15.0	12.5	575	7517702
	CHPF3636B6C*+TXV	G*EC960402BNA*	17,800	13,100	15.0	12.5	575	7517703
	CHPF3636B6C*+TXV	G*EC960603BNA*	17,800	13,100	15.0	12.5	500	7517704
	CHPF3636B6C*+TXV	G*EC960803BNA*	17,800	13,100	15.0	12.5	540	7517705
	CHPF3636B6C*+TXV	G*VC80604B*B*	17,800	13,100	15.0	12.5	620	7517706
	CHPF3636B6C*+TXV	G*VC960403BNA*	17,800	13,100	15.0	12.5	615	7517707
	CHPF3636B6C*+TXV	G*VC960603BNA*	17,800	13,100	15.0	12.5	625	7517708
	CHPF3636B6C*+TXV	G*VC960803BNA*	17,800	13,100	15.0	12.5	620	7517709
	CHPF3636B6C*+TXV	G*VM970603BNA*	17,800	13,100	15.0	12.5	625	7517710
	CHPF3636B6C*+TXV	G*VM970804CNA*	17,800	13,100	15.0	12.5	620	7517711
	CSCF3036N6D*+EEP+TXV		17,600	13,000	14.0	12.2	550	7517712
	CSCF3036N6D*+TXV	A*VC80604B*B*	17,800	13,100	15.0	12.5	620	7517713
	CSCF3036N6D*+TXV	A*VC960403BNA*	17,800	13,100	15.0	12.5	615	7517714
	CSCF3036N6D*+TXV	A*VC960603BNA*	17,800	13,100	15.0	12.5	625	7517715
	CSCF3036N6D*+TXV	A*VC960803BNA*	17,800	13,100	15.0	12.5	620	7517716
	CSCF3036N6D*+TXV	A*VM970603BNA*	17,800	13,100	15.0	12.5	625	7517717
	CSCF3036N6D*+TXV	A*VM970804CNA*	17,800	13,100	15.0	12.5	620	7517718
	CSCF3036N6D*+TXV	G*VC80604B*B*	17,800	13,100	15.0	12.5	620	7517719
	CSCF3036N6D*+TXV	G*VC960403BNA*	17,800	13,100	15.0	12.5	615	7517720
	CSCF3036N6D*+TXV	G*VC960603BNA*	17,800	13,100	15.0	12.5	625	7517721
	CSCF3036N6D*+TXV	G*VC960803BNA*	17,800	13,100	15.0	12.5	620	7517722
	CSCF3036N6D*+TXV	G*VM970603BNA*	17,800	13,100	15.0	12.5	625	7517723
	CSCF3036N6D*+TXV	G*VM970804CNA*	17,800	13,100	15.0	12.5	620	7517724
	CSCF3642N6D*+TXV	A*EC960302BNA*	17,800	13,100	15.0	12.5	575	7517725
CSCF3642N6D*+TXV	A*EC960402BNA*	17,800	13,100	15.0	12.5	575	7517726	
CSCF3642N6D*+TXV	A*EC960603BNA*	17,800	13,100	15.0	12.5	500	7517727	
CSCF3642N6D*+TXV	A*EC960803BNA*	17,800	13,100	15.0	12.5	540	7517728	
CSCF3642N6D*+TXV	G*EC960302BNA*	17,800	13,100	15.0	12.5	575	7517729	
CSCF3642N6D*+TXV	G*EC960402BNA*	17,800	13,100	15.0	12.5	575	7517730	
CSCF3642N6D*+TXV	G*EC960603BNA*	17,800	13,100	15.0	12.5	500	7517731	
CSCF3642N6D*+TXV	G*EC960803BNA*	17,800	13,100	15.0	12.5	540	7517732	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0241A*	ARUF29B14A*		23,600	17,100	14.0	11.5	860	7984203
	ARUF31B14A*		23,600	17,100	14.0	11.5	870	7984204
	ASPT24B14A*		23,000	16,700	14.0	11.5	810	7517733
	ASPT25B14A*		23,000	16,700	14.5	12.0	800	8242097
	ASPT29B14A*		23,600	17,100	15.0	12.5	790	8242098
	ASPT30C14A*		23,600	17,100	14.5	12.0	845	7517734
	AVPTC24B14A*		23,000	16,700	14.0	11.5	795	7517735
	AVPTC30C14A*		23,600	17,100	14.5	12.0	780	7517736
	AWUF25XX16A*		22,000	15,900	14.0	11.5	750	8033011
	AWUF31XX16A*		23,000	16,700	14.5	11.5	800	7517737
	AWUF32XX16A*		23,000	16,700	14.5	11.5	800	7517738
	CA*F3636*6D*	A*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517768
	CA*F3636*6D*	A*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517769
	CA*F3636*6D*	A*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517770
	CA*F3636*6D*	A*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517771
	CA*F3636*6D*	A*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517772
	CA*F3636*6D*	A*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517773
	CA*F3636*6D*	A*VC960403BNA*	23,600	17,100	14.5	11.5	805	7517774
	CA*F3636*6D*	A*VC960603BNA*	23,600	17,100	14.5	11.5	820	7517775
	CA*F3636*6D*	A*VC960803BNA*	23,600	17,100	14.5	11.5	820	7517776
	CA*F3636*6D*	A*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517777
	CA*F3636*6D*	A*VM970603BNA*	23,600	17,100	14.5	11.5	820	7517778
	CA*F3636*6D*	A*VM970803BNA*	23,600	17,100	14.5	11.5	800	7517779
	CA*F3636*6D*	A*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517780
	CA*F3636*6D*	G*E80603B*B*	23,600	17,100	14.5	11.5	725	7517781
	CA*F3636*6D*	G*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517782
	CA*F3636*6D*	G*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517783
	CA*F3636*6D*	G*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517784
	CA*F3636*6D*	G*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517785
	CA*F3636*6D*	G*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517786
	CA*F3636*6D*	G*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517787
	CA*F3636*6D*	G*VC960403BNA*	23,600	17,100	14.5	11.5	805	7517788
	CA*F3636*6D*	G*VC960603BNA*	23,600	17,100	14.5	11.5	820	7517789
	CA*F3636*6D*	G*VC960803BNA*	23,600	17,100	14.5	11.5	820	7517790
	CA*F3636*6D*	G*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517791
	CA*F3636*6D*	G*VM970603BNA*	23,600	17,100	14.5	11.5	820	7517792
	CA*F3636*6D*	G*VM970803BNA*	23,600	17,100	14.5	11.5	800	7517793
	CA*F3636*6D*	G*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517794
	CA*F3636*6D*+EEP		23,600	17,100	14.0	11.5	725	7517739
	CA*F3636*6D*+EEP+TXV		23,600	17,100	14.0	11.5	725	7517740
	CA*F3636*6D*+MBVC1200**-1A*		23,600	17,100	14.5	12.0	725	7520357
	CA*F3636*6D*+TXV	A*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517741
CA*F3636*6D*+TXV	A*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517742	
CA*F3636*6D*+TXV	A*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517743	
CA*F3636*6D*+TXV	A*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517744	
CA*F3636*6D*+TXV	A*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517745	
CA*F3636*6D*+TXV	A*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517746	
CA*F3636*6D*+TXV	A*VC960403BNA*	23,600	17,100	14.5	11.5	805	7517747	
CA*F3636*6D*+TXV	A*VC960603BNA*	23,600	17,100	14.5	11.5	820	7517748	
CA*F3636*6D*+TXV	A*VC960803BNA*	23,600	17,100	14.5	11.5	800	7517749	
CA*F3636*6D*+TXV	A*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517750	
CA*F3636*6D*+TXV	A*VM970603BNA*	23,600	17,100	14.5	11.5	820	7517751	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
	CA*F3636*6D*+TXV	A*VM970803BNA*	23,600	17,100	14.5	11.5	800	7517752
	CA*F3636*6D*+TXV	A*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517753
	CA*F3636*6D*+TXV	G*E80603B*B*	23,600	17,100	14.5	11.5	725	7517754
	CA*F3636*6D*+TXV	G*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517755
	CA*F3636*6D*+TXV	G*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517756
	CA*F3636*6D*+TXV	G*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517757
	CA*F3636*6D*+TXV	G*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517758
	CA*F3636*6D*+TXV	G*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517759
	CA*F3636*6D*+TXV	G*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517760
	CA*F3636*6D*+TXV	G*VC960403BNA*	23,600	17,100	14.5	11.5	805	7517761
	CA*F3636*6D*+TXV	G*VC960603BNA*	23,600	17,100	14.5	11.5	820	7517762
	CA*F3636*6D*+TXV	G*VC960803BNA*	23,600	17,100	14.5	11.5	800	7517763
	CA*F3636*6D*+TXV	G*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517764
	CA*F3636*6D*+TXV	G*VM970603BNA*	23,600	17,100	14.5	11.5	820	7517765
	CA*F3636*6D*+TXV	G*VM970803BNA*	23,600	17,100	14.5	11.5	800	7517766
	CA*F3636*6D*+TXV	G*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517767
	CA*F3642*6D*+EEP		23,600	17,100	14.0	11.5	725	7517795
	CA*F3743*6D*+EEP		23,600	17,100	14.0	11.5	725	7517796
	CA*F3743*6D*+EEP+TXV		23,600	17,100	14.5	12.0	725	7517797
	CAPT3743*4A*	A*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517800
	CAPT3743*4A*	A*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517801
	CAPT3743*4A*	A*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517802
	CAPT3743*4A*	A*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517803
	CAPT3743*4A*	A*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517804
	CAPT3743*4A*	A*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517805
	CAPT3743*4A*	A*VC960403BNA*	23,400	16,900	14.5	11.5	805	7517806
	CAPT3743*4A*	A*VC960603BNA*	23,400	16,900	14.5	11.5	820	7517807
	CAPT3743*4A*	A*VC960803BNA*	23,400	16,900	14.5	11.5	800	7517808
	CAPT3743*4A*	A*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517809
	CAPT3743*4A*	A*VM970603BNA*	23,400	16,900	14.5	11.5	820	7517810
	CAPT3743*4A*	A*VM970803BNA*	23,400	16,900	14.5	11.5	800	7517811
	CAPT3743*4A*	A*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517812
	CAPT3743*4A*	G*E80603B*B*	23,600	17,100	14.5	11.5	725	7517813
	CAPT3743*4A*	G*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517814
	CAPT3743*4A*	G*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517815
	CAPT3743*4A*	G*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517816
	CAPT3743*4A*	G*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517817
	CAPT3743*4A*	G*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517818
	CAPT3743*4A*	G*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517819
	CAPT3743*4A*	G*VC960403BNA*	23,400	16,900	14.5	11.5	805	7517820
	CAPT3743*4A*	G*VC960603BNA*	23,400	16,900	14.5	11.5	820	7517821
	CAPT3743*4A*	G*VC960803BNA*	23,400	16,900	14.5	11.5	800	7517822
	CAPT3743*4A*	G*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517823
	CAPT3743*4A*	G*VM970603BNA*	23,400	16,900	14.5	11.5	820	7517824
	CAPT3743*4A*	G*VM970803BNA*	23,400	16,900	14.5	11.5	800	7517825
	CAPT3743*4A*	G*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517826
	CAPT3743*4A*+EEP		23,000	16,700	14.0	11.5	725	7517798
	CAPT3743*4A*+MBVC1200**-1A*		23,600	17,100	14.5	12.0	760	7517799
	CHPF3636B6C*	A*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517851
	CHPF3636B6C*	A*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517852
	CHPF3636B6C*	A*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517853
	CHPF3636B6C*	A*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517854
	CHPF3636B6C*	A*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517855
	CHPF3636B6C*	A*VC960403BNA*	23,600	17,100	14.5	11.5	805	7517856
	CHPF3636B6C*	A*VC960603BNA*	23,600	17,100	14.5	11.5	820	7517857

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
	CHPF3636B6C*	A*VC960803BNA*	23,600	17,100	14.5	11.5	800	7517858
	CHPF3636B6C*	A*VM970603BNA*	23,600	17,100	14.5	11.5	820	7517859
	CHPF3636B6C*	A*VM970803BNA*	23,600	17,100	14.5	11.5	800	7517860
	CHPF3636B6C*	G*E80603B*B*	23,600	17,100	14.5	11.5	725	7517861
	CHPF3636B6C*	G*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517862
	CHPF3636B6C*	G*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517863
	CHPF3636B6C*	G*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517864
	CHPF3636B6C*	G*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517865
	CHPF3636B6C*	G*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517866
	CHPF3636B6C*	G*VC960403BNA*	23,600	17,100	14.5	11.5	805	7517867
	CHPF3636B6C*	G*VC960603BNA*	23,600	17,100	14.5	11.5	820	7517868
	CHPF3636B6C*	G*VC960803BNA*	23,600	17,100	14.5	11.5	800	7517869
	CHPF3636B6C*	G*VM970603BNA*	23,600	17,100	14.5	11.5	820	7517870
	CHPF3636B6C*	G*VM970803BNA*	23,600	17,100	14.5	11.5	800	7517871
	CHPF3636B6C*+EEP		23,600	17,100	14.0	11.5	725	7517827
	CHPF3636B6C*+EEP+TXV		23,600	17,100	14.5	11.5	725	7517828
	CHPF3636B6C*+MBVC1200**,-1A*		23,600	17,100	14.5	12.0	725	7517829
	CHPF3636B6C*+TXV	A*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517830
	CHPF3636B6C*+TXV	A*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517831
	CHPF3636B6C*+TXV	A*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517832
	CHPF3636B6C*+TXV	A*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517833
	CHPF3636B6C*+TXV	A*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517834
	CHPF3636B6C*+TXV	A*VC960403BNA*	23,600	17,100	14.5	11.5	805	7517835
	CHPF3636B6C*+TXV	A*VC960603BNA*	23,600	17,100	14.5	11.5	820	7517836
	CHPF3636B6C*+TXV	A*VC960803BNA*	23,600	17,100	14.5	11.5	800	7517837
	CHPF3636B6C*+TXV	A*VM970603BNA*	23,600	17,100	14.5	11.5	820	7517838
	CHPF3636B6C*+TXV	A*VM970803BNA*	23,600	17,100	14.5	11.5	800	7517839
	CHPF3636B6C*+TXV	G*E80603B*B*	23,600	17,100	14.5	11.5	725	7517840
	CHPF3636B6C*+TXV	G*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517841
	CHPF3636B6C*+TXV	G*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517842
	CHPF3636B6C*+TXV	G*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517843
	CHPF3636B6C*+TXV	G*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517844
	CHPF3636B6C*+TXV	G*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517845
	CHPF3636B6C*+TXV	G*VC960403BNA*	23,600	17,100	14.5	11.5	805	7517846
	CHPF3636B6C*+TXV	G*VC960603BNA*	23,600	17,100	14.5	11.5	820	7517847
	CHPF3636B6C*+TXV	G*VC960803BNA*	23,600	17,100	14.5	11.5	800	7517848
	CHPF3636B6C*+TXV	G*VM970603BNA*	23,600	17,100	14.5	11.5	820	7517849
	CHPF3636B6C*+TXV	G*VM970803BNA*	23,600	17,100	14.5	11.5	800	7517850
	CHPF3642C6C*	A*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517880
	CHPF3642C6C*	A*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517881
	CHPF3642C6C*	A*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517882
	CHPF3642C6C*	G*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517883
	CHPF3642C6C*	G*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517884
	CHPF3642C6C*	G*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517885
	CHPF3642C6C*+EEP		23,600	17,100	14.0	11.5	725	7517872
	CHPF3642C6C*+EEP+TXV		23,600	17,100	14.5	11.5	725	7517873
	CHPF3642C6C*+TXV	A*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517874
	CHPF3642C6C*+TXV	A*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517875
	CHPF3642C6C*+TXV	A*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517876
	CHPF3642C6C*+TXV	G*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517877
	CHPF3642C6C*+TXV	G*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517878
	CHPF3642C6C*+TXV	G*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517879
	CSCF3036N6D*	A*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517914

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0241A* (cont.)	CSCF3036N6D*	A*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517915
	CSCF3036N6D*	A*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517916
	CSCF3036N6D*	A*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517917
	CSCF3036N6D*	A*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517918
	CSCF3036N6D*	A*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517919
	CSCF3036N6D*	A*VC960403BNA*	23,600	17,100	14.5	11.5	805	7517920
	CSCF3036N6D*	A*VC960603BNA*	23,600	17,100	14.5	11.5	820	7517921
	CSCF3036N6D*	A*VC960803BNA*	23,600	17,100	14.5	11.5	800	7517922
	CSCF3036N6D*	A*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517923
	CSCF3036N6D*	A*VM970603BNA*	23,600	17,100	14.5	11.5	820	7517924
	CSCF3036N6D*	A*VM970803BNA*	23,600	17,100	14.5	11.5	800	7517925
	CSCF3036N6D*	A*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517926
	CSCF3036N6D*	G*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517927
	CSCF3036N6D*	G*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517928
	CSCF3036N6D*	G*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517929
	CSCF3036N6D*	G*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517930
	CSCF3036N6D*	G*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517931
	CSCF3036N6D*	G*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517932
	CSCF3036N6D*	G*VC960403BNA*	23,600	17,100	14.5	11.5	805	7517933
	CSCF3036N6D*	G*VC960603BNA*	23,600	17,100	14.5	11.5	820	7517934
	CSCF3036N6D*	G*VC960803BNA*	23,600	17,100	14.5	11.5	800	7517935
	CSCF3036N6D*	G*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517936
	CSCF3036N6D*	G*VM970603BNA*	23,600	17,100	14.5	11.5	820	7517937
	CSCF3036N6D*	G*VM970803BNA*	23,600	17,100	14.5	11.5	800	7517938
	CSCF3036N6D*	G*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517939
	CSCF3036N6D*+EEP		23,600	17,100	14.0	11.5	800	7517886
	CSCF3036N6D*+EEP+TXV		23,600	17,100	14.0	11.5	800	7517887
	CSCF3036N6D*+TXV	A*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517888
	CSCF3036N6D*+TXV	A*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517889
	CSCF3036N6D*+TXV	A*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517890
	CSCF3036N6D*+TXV	A*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517891
	CSCF3036N6D*+TXV	A*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517892
	CSCF3036N6D*+TXV	A*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517893
	CSCF3036N6D*+TXV	A*VC960403BNA*	23,600	17,100	14.5	11.5	805	7517894
	CSCF3036N6D*+TXV	A*VC960603BNA*	23,600	17,100	14.5	11.5	820	7517895
	CSCF3036N6D*+TXV	A*VC960803BNA*	23,600	17,100	14.5	11.5	800	7517896
	CSCF3036N6D*+TXV	A*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517897
	CSCF3036N6D*+TXV	A*VM970603BNA*	23,600	17,100	14.5	11.5	820	7517898
	CSCF3036N6D*+TXV	A*VM970803BNA*	23,600	17,100	14.5	11.5	800	7517899
	CSCF3036N6D*+TXV	A*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517900
	CSCF3036N6D*+TXV	G*EC960302BNA*	23,400	16,900	14.5	11.5	750	7517901
	CSCF3036N6D*+TXV	G*EC960402BNA*	23,400	16,900	14.5	11.5	775	7517902
	CSCF3036N6D*+TXV	G*EC960603BNA*	23,400	16,900	14.5	11.5	725	7517903
	CSCF3036N6D*+TXV	G*EC960803BNA*	23,400	16,900	14.5	11.5	750	7517904
	CSCF3036N6D*+TXV	G*VC80604B*B*	23,600	17,100	14.5	11.5	750	7517905
	CSCF3036N6D*+TXV	G*VC80805C*B*	23,600	17,100	14.5	11.5	730	7517906
	CSCF3036N6D*+TXV	G*VC960403BNA*	23,600	17,100	14.5	11.5	805	7517907
CSCF3036N6D*+TXV	G*VC960603BNA*	23,600	17,100	14.5	11.5	820	7517908	
CSCF3036N6D*+TXV	G*VC960803BNA*	23,600	17,100	14.5	11.5	800	7517909	
CSCF3036N6D*+TXV	G*VC960804CNA*	23,600	17,100	14.5	11.5	810	7517910	
CSCF3036N6D*+TXV	G*VM970603BNA*	23,600	17,100	14.5	11.5	820	7517911	
CSCF3036N6D*+TXV	G*VM970803BNA*	23,600	17,100	14.5	11.5	800	7517912	
CSCF3036N6D*+TXV	G*VM970804CNA*	23,600	17,100	14.5	11.5	810	7517913	
CSCF3642N6D*+EEP		23,600	17,100	14.0	11.5	725	7517940	
CSCF3642N6D*+EEP+TXV		23,600	17,100	14.0	11.5	725	7517941	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0251A*	ARUF29B14A*		23,600	16,900	14.0	12.2	860	7984205
	ARUF31B14A*		23,600	16,900	14.0	12.2	870	7984206
	ASPT24B14A*		23,000	16,500	14.0	12.2	810	7517942
	ASPT25B14A*		23,600	16,900	14.5	12.2	800	8242099
	ASPT29B14A*		24,000	17,200	15.0	12.5	790	8242100
	ASPT30C14A*		23,600	16,900	15.0	12.5	845	7517943
	AVPTC24B14A*		23,000	16,500	14.0	12.2	795	7517944
	AVPTC30C14A*		23,600	16,900	15.0	12.5	780	7517945
	AWUF25XX16A*		22,000	15,800	14.0	12.2	750	8033012
	AWUF31XX16A*		23,000	16,500	14.5	12.2	800	7517946
	AWUF32XX16A*		23,000	16,500	14.5	12.2	800	7517947
	CA*F3636*6D*	A*EC960302BNA*	23,400	16,800	14.5	12.2	750	7517978
	CA*F3636*6D*	A*EC960402BNA*	23,400	16,800	14.5	12.2	775	7517979
	CA*F3636*6D*	A*EC960603BNA*	23,400	16,800	14.5	12.2	775	7517980
	CA*F3636*6D*	A*EC960803BNA*	23,400	16,800	14.5	12.2	750	7517981
	CA*F3636*6D*	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	7517982
	CA*F3636*6D*	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	7517983
	CA*F3636*6D*	A*VC960403BNA*	23,600	16,900	15.0	12.5	805	7517984
	CA*F3636*6D*	A*VC960603BNA*	23,600	16,900	15.0	12.5	820	7517985
	CA*F3636*6D*	A*VC960803BNA*	23,600	16,900	15.0	12.5	820	7517986
	CA*F3636*6D*	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	7517987
	CA*F3636*6D*	A*VM970603BNA*	23,600	16,900	15.0	12.5	820	7517988
	CA*F3636*6D*	A*VM970803BNA*	23,600	16,900	15.0	12.5	800	7517989
	CA*F3636*6D*	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	7517990
	CA*F3636*6D*	G*E80603B*B*	23,600	16,900	15.0	12.5	725	7517991
	CA*F3636*6D*	G*EC960302BNA*	23,400	16,800	14.5	12.2	750	7517992
	CA*F3636*6D*	G*EC960402BNA*	23,400	16,800	14.5	12.2	775	7517993
	CA*F3636*6D*	G*EC960603BNA*	23,400	16,800	14.5	12.2	775	7517994
	CA*F3636*6D*	G*EC960803BNA*	23,400	16,800	14.5	12.2	750	7517995
	CA*F3636*6D*	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	7517996
	CA*F3636*6D*	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	7517997
	CA*F3636*6D*	G*VC960403BNA*	23,600	16,900	15.0	12.5	805	7517998
	CA*F3636*6D*	G*VC960603BNA*	23,600	16,900	15.0	12.5	820	7517999
	CA*F3636*6D*	G*VC960803BNA*	23,600	16,900	15.0	12.5	820	7518000
	CA*F3636*6D*	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	7518001
	CA*F3636*6D*	G*VM970603BNA*	23,600	16,900	15.0	12.5	820	7518002
	CA*F3636*6D*	G*VM970803BNA*	23,600	16,900	15.0	12.5	800	7518003
	CA*F3636*6D*	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	7518004
	CA*F3636*6D*+EEP		23,600	16,900	14.0	12.2	725	7517948
	CA*F3636*6D*+EEP+TXV		23,600	16,900	14.0	12.2	725	7517949
	CA*F3636*6D*+MBVC1200**-1A*		23,600	16,900	15.0	12.5	775	7517950
	CA*F3636*6D*+TXV	A*EC960302BNA*	23,400	16,800	15.0	12.5	750	7517951
CA*F3636*6D*+TXV	A*EC960402BNA*	23,400	16,800	15.0	12.5	775	7517952	
CA*F3636*6D*+TXV	A*EC960603BNA*	23,400	16,800	15.0	12.5	775	7517953	
CA*F3636*6D*+TXV	A*EC960803BNA*	23,400	16,800	15.0	12.5	750	7517954	
CA*F3636*6D*+TXV	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	7517955	
CA*F3636*6D*+TXV	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	7517956	
CA*F3636*6D*+TXV	A*VC960403BNA*	23,600	16,900	15.0	12.5	805	7517957	
CA*F3636*6D*+TXV	A*VC960603BNA*	23,600	16,900	15.0	12.5	820	7517958	
CA*F3636*6D*+TXV	A*VC960803BNA*	23,600	16,900	15.0	12.5	800	7517959	
CA*F3636*6D*+TXV	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	7517960	
CA*F3636*6D*+TXV	A*VM970603BNA*	23,600	16,900	15.0	12.5	820	7517961	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0251A* (cont.)	CA*F3636*6D*+TXV	A*VM970803BNA*	23,600	16,900	15.0	12.5	800	7517962
	CA*F3636*6D*+TXV	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	7517963
	CA*F3636*6D*+TXV	G*E80603B*B*	23,600	16,900	15.0	12.5	725	7517964
	CA*F3636*6D*+TXV	G*EC960302BNA*	23,400	16,800	15.0	12.5	750	7517965
	CA*F3636*6D*+TXV	G*EC960402BNA*	23,400	16,800	15.0	12.5	775	7517966
	CA*F3636*6D*+TXV	G*EC960603BNA*	23,400	16,800	15.0	12.5	775	7517967
	CA*F3636*6D*+TXV	G*EC960803BNA*	23,400	16,800	15.0	12.5	750	7517968
	CA*F3636*6D*+TXV	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	7517969
	CA*F3636*6D*+TXV	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	7517970
	CA*F3636*6D*+TXV	G*VC960403BNA*	23,600	16,900	15.0	12.5	805	7517971
	CA*F3636*6D*+TXV	G*VC960603BNA*	23,600	16,900	15.0	12.5	820	7517972
	CA*F3636*6D*+TXV	G*VC960803BNA*	23,600	16,900	15.0	12.5	800	7517973
	CA*F3636*6D*+TXV	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	7517974
	CA*F3636*6D*+TXV	G*VM970603BNA*	23,600	16,900	15.0	12.5	820	7517975
	CA*F3636*6D*+TXV	G*VM970803BNA*	23,600	16,900	15.0	12.5	800	7517976
	CA*F3636*6D*+TXV	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	7517977
	CA*F3743*6D*+EEP		23,800	17,000	14.0	12.2	725	7518005
	CA*F3743*6D*+EEP+TXV		23,800	17,000	14.5	12.2	725	7518006
	CAPT3743*4A*	A*EC960302BNA*	23,400	16,800	14.5	12.2	750	7518009
	CAPT3743*4A*	A*EC960402BNA*	23,400	16,800	14.5	12.2	775	7518010
	CAPT3743*4A*	A*EC960603BNA*	23,400	16,800	14.5	12.2	725	7518011
	CAPT3743*4A*	A*EC960803BNA*	23,400	16,800	14.5	12.2	750	7518012
	CAPT3743*4A*	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	7518013
	CAPT3743*4A*	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	7518014
	CAPT3743*4A*	A*VC960403BNA*	23,400	16,800	15.0	12.5	805	7518015
	CAPT3743*4A*	A*VC960603BNA*	23,400	16,800	15.0	12.5	820	7518016
	CAPT3743*4A*	A*VC960803BNA*	23,400	16,800	15.0	12.5	800	7518017
	CAPT3743*4A*	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	7518018
	CAPT3743*4A*	A*VM970603BNA*	23,400	16,800	15.0	12.5	820	7518019
	CAPT3743*4A*	A*VM970803BNA*	23,400	16,800	15.0	12.5	800	7518020
	CAPT3743*4A*	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	7518021
	CAPT3743*4A*	G*E80603B*B*	23,600	16,900	15.0	12.5	725	7518022
	CAPT3743*4A*	G*EC960302BNA*	23,400	16,800	14.5	12.2	750	7518023
	CAPT3743*4A*	G*EC960402BNA*	23,400	16,800	14.5	12.2	775	7518024
	CAPT3743*4A*	G*EC960603BNA*	23,400	16,800	14.5	12.2	725	7518025
	CAPT3743*4A*	G*EC960803BNA*	23,400	16,800	14.5	12.2	750	7518026
	CAPT3743*4A*	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	7518027
	CAPT3743*4A*	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	7518028
	CAPT3743*4A*	G*VC960403BNA*	23,400	16,800	15.0	12.5	805	7518029
	CAPT3743*4A*	G*VC960603BNA*	23,400	16,800	15.0	12.5	820	7518030
	CAPT3743*4A*	G*VC960803BNA*	23,400	16,800	15.0	12.5	800	7518031
	CAPT3743*4A*	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	7518032
	CAPT3743*4A*	G*VM970603BNA*	23,400	16,800	15.0	12.5	820	7518033
	CAPT3743*4A*	G*VM970803BNA*	23,400	16,800	15.0	12.5	800	7518034
	CAPT3743*4A*	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	7518035
	CAPT3743*4A*+EEP		23,600	16,900	14.0	12.2	725	7518007
	CAPT3743*4A*+MBVC1200**-1A*		23,600	16,900	14.5	12.2	775	7518008
	CHPF3636B6C*	A*EC960302BNA*	23,400	16,800	14.5	12.2	750	7518060
CHPF3636B6C*	A*EC960402BNA*	23,400	16,800	14.5	12.2	775	7518061	
CHPF3636B6C*	A*EC960603BNA*	23,400	16,800	14.5	12.2	725	7518062	
CHPF3636B6C*	A*EC960803BNA*	23,400	16,800	14.5	12.2	750	7518063	
CHPF3636B6C*	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	7518064	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
	CHPF3636B6C*	A*VC960403BNA*	23,600	16,900	15.0	12.5	805	7518065
	CHPF3636B6C*	A*VC960603BNA*	23,600	16,900	15.0	12.5	820	7518066
	CHPF3636B6C*	A*VC960803BNA*	23,600	16,900	15.0	12.5	800	7518067
	CHPF3636B6C*	A*VM970603BNA*	23,600	16,900	15.0	12.5	820	7518068
	CHPF3636B6C*	A*VM970803BNA*	23,600	16,900	15.0	12.5	800	7518069
	CHPF3636B6C*	G*E80603B*B*	23,600	16,900	15.0	12.5	725	7518070
	CHPF3636B6C*	G*EC960302BNA*	23,400	16,800	14.5	12.2	750	7518071
	CHPF3636B6C*	G*EC960402BNA*	23,400	16,800	14.5	12.2	775	7518072
	CHPF3636B6C*	G*EC960603BNA*	23,400	16,800	14.5	12.2	725	7518073
	CHPF3636B6C*	G*EC960803BNA*	23,400	16,800	14.5	12.2	750	7518074
	CHPF3636B6C*	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	7518075
	CHPF3636B6C*	G*VC960403BNA*	23,600	16,900	15.0	12.5	805	7518076
	CHPF3636B6C*	G*VC960603BNA*	23,600	16,900	15.0	12.5	820	7518077
	CHPF3636B6C*	G*VC960803BNA*	23,600	16,900	15.0	12.5	800	7518078
	CHPF3636B6C*	G*VM970603BNA*	23,600	16,900	15.0	12.5	820	7518079
	CHPF3636B6C*	G*VM970803BNA*	23,600	16,900	15.0	12.5	800	7518080
	CHPF3636B6C*+EEP		23,600	16,900	14.0	12.2	725	7518036
	CHPF3636B6C*+EEP+TXV		23,600	16,900	14.5	12.2	725	7518037
	CHPF3636B6C*+MBVC1200**-1A*		23,600	16,900	15.0	12.5	775	7518038
	CHPF3636B6C*+TXV	A*EC960302BNA*	23,400	16,800	14.5	12.2	750	7518039
	CHPF3636B6C*+TXV	A*EC960402BNA*	23,400	16,800	14.5	12.2	775	7518040
	CHPF3636B6C*+TXV	A*EC960603BNA*	23,400	16,800	14.5	12.2	725	7518041
	CHPF3636B6C*+TXV	A*EC960803BNA*	23,400	16,800	14.5	12.2	750	7518042
	CHPF3636B6C*+TXV	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	7518043
	CHPF3636B6C*+TXV	A*VC960403BNA*	23,600	16,900	15.0	12.5	805	7518044
	CHPF3636B6C*+TXV	A*VC960603BNA*	23,600	16,900	15.0	12.5	820	7518045
	CHPF3636B6C*+TXV	A*VC960803BNA*	23,600	16,900	15.0	12.5	800	7518046
	CHPF3636B6C*+TXV	A*VM970603BNA*	23,600	16,900	15.0	12.5	820	7518047
	CHPF3636B6C*+TXV	A*VM970803BNA*	23,600	16,900	15.0	12.5	800	7518048
	CHPF3636B6C*+TXV	G*E80603B*B*	23,600	16,900	15.0	12.5	725	7518049
	CHPF3636B6C*+TXV	G*EC960302BNA*	23,400	16,800	14.5	12.2	750	7518050
	CHPF3636B6C*+TXV	G*EC960402BNA*	23,400	16,800	14.5	12.2	775	7518051
	CHPF3636B6C*+TXV	G*EC960603BNA*	23,400	16,800	14.5	12.2	725	7518052
	CHPF3636B6C*+TXV	G*EC960803BNA*	23,400	16,800	14.5	12.2	750	7518053
	CHPF3636B6C*+TXV	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	7518054
	CHPF3636B6C*+TXV	G*VC960403BNA*	23,600	16,900	15.0	12.5	805	7518055
	CHPF3636B6C*+TXV	G*VC960603BNA*	23,600	16,900	15.0	12.5	820	7518056
	CHPF3636B6C*+TXV	G*VC960803BNA*	23,600	16,900	15.0	12.5	800	7518057
	CHPF3636B6C*+TXV	G*VM970603BNA*	23,600	16,900	15.0	12.5	820	7518058
	CHPF3636B6C*+TXV	G*VM970803BNA*	23,600	16,900	15.0	12.5	800	7518059
	CHPF3642C6C*	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	7518087
	CHPF3642C6C*	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	7518088
	CHPF3642C6C*	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	7518089
	CHPF3642C6C*	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	7518090
	CHPF3642C6C*	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	7518091
	CHPF3642C6C*	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	7518092
	CHPF3642C6C*+TXV	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	7518081
	CHPF3642C6C*+TXV	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	7518082
	CHPF3642C6C*+TXV	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	7518083
	CHPF3642C6C*+TXV	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	7518084
	CHPF3642C6C*+TXV	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	7518085
	CHPF3642C6C*+TXV	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	7518086
	CSCF3036N6D*	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	7518113

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
	CSCF3036N6D*	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	7518114
	CSCF3036N6D*	A*VC960403BNA*	23,600	16,900	15.0	12.5	805	7518115
	CSCF3036N6D*	A*VC960603BNA*	23,600	16,900	15.0	12.5	820	7518116
	CSCF3036N6D*	A*VC960803BNA*	23,600	16,900	15.0	12.5	800	7518117
	CSCF3036N6D*	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	7518118
	CSCF3036N6D*	A*VM970603BNA*	23,600	16,900	15.0	12.5	820	7518119
	CSCF3036N6D*	A*VM970803BNA*	23,600	16,900	15.0	12.5	800	7518120
	CSCF3036N6D*	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	7518121
	CSCF3036N6D*	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	7518122
	CSCF3036N6D*	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	7518123
	CSCF3036N6D*	G*VC960403BNA*	23,600	16,900	15.0	12.5	805	7518124
	CSCF3036N6D*	G*VC960603BNA*	23,600	16,900	15.0	12.5	820	7518125
	CSCF3036N6D*	G*VC960803BNA*	23,600	16,900	15.0	12.5	800	7518126
	CSCF3036N6D*	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	7518127
	CSCF3036N6D*	G*VM970603BNA*	23,600	16,900	15.0	12.5	820	7518128
	CSCF3036N6D*	G*VM970803BNA*	23,600	16,900	15.0	12.5	800	7518129
	CSCF3036N6D*	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	7518130
	CSCF3036N6D*+EEP		23,200	16,600	14.0	12.2	800	7518093
	CSCF3036N6D*+EEP+TXV		23,200	16,600	14.0	12.2	800	7518094
	CSCF3036N6D*+TXV	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	7518095
	CSCF3036N6D*+TXV	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	7518096
	CSCF3036N6D*+TXV	A*VC960403BNA*	23,600	16,900	15.0	12.5	805	7518097
	CSCF3036N6D*+TXV	A*VC960603BNA*	23,600	16,900	15.0	12.5	820	7518098
	CSCF3036N6D*+TXV	A*VC960803BNA*	23,600	16,900	15.0	12.5	800	7518099
	CSCF3036N6D*+TXV	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	7518100
	CSCF3036N6D*+TXV	A*VM970603BNA*	23,600	16,900	15.0	12.5	820	7518101
	CSCF3036N6D*+TXV	A*VM970803BNA*	23,600	16,900	15.0	12.5	800	7518102
	CSCF3036N6D*+TXV	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	7518103
	CSCF3036N6D*+TXV	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	7518104
	CSCF3036N6D*+TXV	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	7518105
	CSCF3036N6D*+TXV	G*VC960403BNA*	23,600	16,900	15.0	12.5	805	7518106
	CSCF3036N6D*+TXV	G*VC960603BNA*	23,600	16,900	15.0	12.5	820	7518107
	CSCF3036N6D*+TXV	G*VC960803BNA*	23,600	16,900	15.0	12.5	800	7518108
	CSCF3036N6D*+TXV	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	7518109
	CSCF3036N6D*+TXV	G*VM970603BNA*	23,600	16,900	15.0	12.5	820	7518110
	CSCF3036N6D*+TXV	G*VM970803BNA*	23,600	16,900	15.0	12.5	800	7518111
	CSCF3036N6D*+TXV	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	7518112
	CSCF3642N6D*	A*EC960302BNA*	23,400	16,800	14.5	12.2	750	7518139
	CSCF3642N6D*	A*EC960402BNA*	23,400	16,800	14.5	12.2	775	7518140
	CSCF3642N6D*	A*EC960603BNA*	23,400	16,800	14.5	12.2	725	7518141
	CSCF3642N6D*	A*EC960803BNA*	23,400	16,800	14.5	12.2	750	7518142
	CSCF3642N6D*	G*EC960302BNA*	23,400	16,800	14.5	12.2	750	7518143
	CSCF3642N6D*	G*EC960402BNA*	23,400	16,800	14.5	12.2	775	7518144
	CSCF3642N6D*	G*EC960603BNA*	23,400	16,800	14.5	12.2	725	7518145
	CSCF3642N6D*	G*EC960803BNA*	23,400	16,800	14.5	12.2	750	7518146
	CSCF3642N6D*+TXV	A*EC960302BNA*	23,400	16,800	14.5	12.2	750	7518131
	CSCF3642N6D*+TXV	A*EC960402BNA*	23,400	16,800	14.5	12.2	775	7518132
	CSCF3642N6D*+TXV	A*EC960603BNA*	23,400	16,800	14.5	12.2	725	7518133
	CSCF3642N6D*+TXV	A*EC960803BNA*	23,400	16,800	14.5	12.2	750	7518134
	CSCF3642N6D*+TXV	G*EC960302BNA*	23,400	16,800	14.5	12.2	750	7518135
	CSCF3642N6D*+TXV	G*EC960402BNA*	23,400	16,800	14.5	12.2	775	7518136
	CSCF3642N6D*+TXV	G*EC960603BNA*	23,400	16,800	14.5	12.2	725	7518137
	CSCF3642N6D*+TXV	G*EC960803BNA*	23,400	16,800	14.5	12.2	750	7518138

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0301A*	ARUF31B14A*		28,200	21,000	14.0	11.5	870	7984207
	ASPT36C14A*		29,000	21,400	14.5	12.0	1,010	7518147
	ASPT37B14A*		29,000	21,400	14.5	12.0	945	8242101
	ASPT37C14A*		29,000	21,400	15.0	12.5	1,045	8242102
	AVPTC36C14A*		29,000	21,400	14.5	12.0	1,085	7518148
	AWUF31XX16A*		28,000	20,800	14.0	11.5	950	7518149
	AWUF31XX16A*+TXV		28,400	21,000	14.5	11.5	1,000	7518150
	AWUF32XX16A*		28,000	20,800	14.0	11.5	950	7518151
	AWUF32XX16A*+TXV		28,400	21,000	14.5	11.5	1,000	7518152
	AWUF37XX16B*		28,400	21,000	14.0	11.5	1,000	7518153
	AWUF37XX16B*+TXV		28,600	21,200	14.5	11.5	1,000	7518154
	CA*F3137*6A*+EEP		28,800	21,400	14.0	11.5	1,000	8187509
	CA*F3137*6A*+EEP+TXV		28,800	21,400	14.0	11.5	1,000	8187510
	CA*F3137*6A*+MBVC1200**-1A*		28,800	21,400	14.5	11.5	950	8187511
	CA*F3137*6A*+MBVC1200**-1A*+TXV		28,800	21,400	14.5	12.0	950	8187512
	CA*F3137*6A*+TXV	G*E80603B*B*	28,800	21,400	14.5	11.5	1,000	8187513
	CA*F3137*6A*+TXV	G*VC80604B*B*	28,400	21,000	14.5	11.5	1,000	8187514
	CA*F3137*6A*+TXV	G*VC960403BNA*	28,600	21,200	14.5	11.5	1,000	8187515
	CA*F3137*6A*+TXV	G*VC960603BNA*	28,800	21,400	14.5	11.5	1,000	8187516
	CA*F3137*6A*+TXV	G*VC960803BNA*	28,600	21,200	14.5	11.5	950	8187517
	CA*F3137*6A*+TXV	G*VM970603BNA*	28,600	21,200	14.5	11.5	1,000	8187518
	CA*F3137*6A*+TXV	G*EC960302BNA*	28,200	21,000	14.5	11.5	940	8187519
	CA*F3137*6A*+TXV	G*EC960402BNA*	28,200	21,000	14.5	11.5	925	8187520
	CA*F3137*6A*+TXV	G*EC960603BNA*	28,200	21,000	14.5	11.5	965	8187521
	CA*F3137*6A*+TXV	G*EC960803BNA*	28,200	21,000	14.5	11.5	950	8187522
	CA*F3137*6A*+TXV	A*EH800603B*A*	28,800	21,400	14.5	11.5	1,000	8187534
	CA*F3137*6A*+TXV	A*VC80604B*B*	28,400	21,000	14.5	11.5	1,000	8187535
	CA*F3137*6A*+TXV	A*VC960403BNA*	28,600	21,200	14.5	11.5	1,000	8187536
	CA*F3137*6A*+TXV	A*VC960603BNA*	28,800	21,400	14.5	11.5	1,000	8187537
	CA*F3137*6A*+TXV	A*VC960803BNA*	28,600	21,200	14.5	11.5	950	8187538
	CA*F3137*6A*+TXV	A*VM970603BNA*	28,600	21,200	14.5	11.5	1,000	8187539
	CA*F3137*6A*+TXV	A*EC960302BNA*	28,200	21,000	14.5	11.5	940	8187540
	CA*F3137*6A*+TXV	A*EC960402BNA*	28,200	21,000	14.5	11.5	925	8187541
	CA*F3137*6A*+TXV	A*EC960603BNA*	28,200	21,000	14.5	11.5	965	8187542
	CA*F3137*6A*+TXV	A*EC960803BNA*	28,200	21,000	14.5	11.5	950	8187543
	CA*F3642*6D*	A*VC960804CNA*	28,600	21,200	14.5	11.5	1,000	7518191
	CA*F3642*6D*	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518192
	CA*F3642*6D*	G*VC960804CNA*	28,600	21,200	14.5	11.5	1,000	7518193
	CA*F3642*6D*	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518194
	CA*F3642*6D*+EEP		28,800	21,400	14.0	11.5	1,000	7518155
	CA*F3642*6D*+EEP+TXV		28,800	21,400	14.0	11.5	1,000	7518156
	CA*F3642*6D*+MBVC1200**-1A*		28,800	21,400	14.5	11.5	980	7519540
	CA*F3642*6D*+MBVC1200**-1A*+TXV		28,800	21,400	14.5	12.0	980	7518157
	CA*F3642*6D*+MBVC1600**-1A*		28,800	21,400	14.5	11.5	1,000	7518158
	CA*F3642*6D*+MBVC1600**-1A*+TXV		28,800	21,400	14.5	12.0	1,000	7518159
CA*F3642*6D*+TXV	A*EC960302BNA*	28,200	21,000	14.5	11.5	940	7518160	
CA*F3642*6D*+TXV	A*EC960402BNA*	28,200	21,000	14.5	11.5	925	7518161	
CA*F3642*6D*+TXV	A*EC960603BNA*	28,200	21,000	14.5	11.5	965	7518162	
CA*F3642*6D*+TXV	A*EC960803BNA*	28,200	21,000	14.5	11.5	950	7518163	
CA*F3642*6D*+TXV	A*EC961004CNA*	28,600	21,200	14.5	11.5	1,025	7518164	
CA*F3642*6D*+TXV	A*VC80604B*B*	28,400	21,000	14.5	11.5	1,000	7518165	
CA*F3642*6D*+TXV	A*VC80805C*B*	28,400	21,000	14.5	11.5	990	7518166	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0301A* (cont.)	CA*F3642*6D*+TXV	A*VC81005C*B*	28,400	21,000	14.5	11.5	1,000	7518167
	CA*F3642*6D*+TXV	A*VC960403BNA*	28,600	21,200	14.5	11.5	1,000	7518168
	CA*F3642*6D*+TXV	A*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7518169
	CA*F3642*6D*+TXV	A*VC960803BNA*	28,600	21,200	14.5	11.5	975	7518170
	CA*F3642*6D*+TXV	A*VC960804CNA*	28,600	21,200	14.5	11.5	1,000	7518171
	CA*F3642*6D*+TXV	A*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7518172
	CA*F3642*6D*+TXV	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518173
	CA*F3642*6D*+TXV	G*E80603B*B*	28,800	21,400	14.5	11.5	1,050	7518174
	CA*F3642*6D*+TXV	G*E80805C*B*	28,800	21,400	14.5	11.5	1,060	7518175
	CA*F3642*6D*+TXV	G*E81005C*B*	28,800	21,400	14.5	11.5	1,080	7518176
	CA*F3642*6D*+TXV	G*EC960302BNA*	28,200	21,000	14.5	11.5	940	7518177
	CA*F3642*6D*+TXV	G*EC960402BNA*	28,200	21,000	14.5	11.5	925	7518178
	CA*F3642*6D*+TXV	G*EC960603BNA*	28,200	21,000	14.5	11.5	965	7518179
	CA*F3642*6D*+TXV	G*EC960803BNA*	28,200	21,000	14.5	11.5	950	7518180
	CA*F3642*6D*+TXV	G*EC961004CNA*	28,600	21,200	14.5	11.5	1,025	7518181
	CA*F3642*6D*+TXV	G*VC80604B*B*	28,400	21,000	14.5	11.5	1,000	7518182
	CA*F3642*6D*+TXV	G*VC80805C*B*	28,400	21,000	14.5	11.5	990	7518183
	CA*F3642*6D*+TXV	G*VC81005C*B*	28,400	21,000	14.5	11.5	1,000	7518184
	CA*F3642*6D*+TXV	G*VC960403BNA*	28,600	21,200	14.5	11.5	1,000	7518185
	CA*F3642*6D*+TXV	G*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7518186
	CA*F3642*6D*+TXV	G*VC960803BNA*	28,600	21,200	14.5	11.5	975	7518187
	CA*F3642*6D*+TXV	G*VC960804CNA*	28,600	21,200	14.5	11.5	1,000	7518188
	CA*F3642*6D*+TXV	G*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7518189
	CA*F3642*6D*+TXV	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518190
	CA*F3743*6D*	A*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7518228
	CA*F3743*6D*	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518229
	CA*F3743*6D*	G*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7518230
	CA*F3743*6D*	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518231
	CA*F3743*6D*+EEP		28,800	21,400	14.0	11.5	1,000	7518195
	CA*F3743*6D*+EEP+TXV		28,800	21,400	14.0	11.5	1,000	7518196
	CA*F3743*6D*+TXV	A*EC960302BNA*	28,400	21,000	14.5	11.5	940	7518197
	CA*F3743*6D*+TXV	A*EC960402BNA*	28,400	21,000	14.5	11.5	925	7518198
	CA*F3743*6D*+TXV	A*EC960603BNA*	28,400	21,000	14.5	11.5	965	7518199
	CA*F3743*6D*+TXV	A*EC960803BNA*	28,400	21,000	14.5	11.5	950	7518200
	CA*F3743*6D*+TXV	A*EC961004CNA*	28,800	21,400	14.5	11.5	1,025	7518201
	CA*F3743*6D*+TXV	A*VC80604B*B*	28,600	21,200	14.5	11.5	1,000	7518202
	CA*F3743*6D*+TXV	A*VC80805C*B*	28,600	21,200	14.5	11.5	990	7518203
	CA*F3743*6D*+TXV	A*VC81005C*B*	28,600	21,200	14.5	11.5	1,000	7518204
	CA*F3743*6D*+TXV	A*VC960403BNA*	28,800	21,400	14.5	11.5	1,000	7518205
	CA*F3743*6D*+TXV	A*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7518206
	CA*F3743*6D*+TXV	A*VC960803BNA*	28,600	21,200	14.5	11.5	975	7518207
	CA*F3743*6D*+TXV	A*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7518208
	CA*F3743*6D*+TXV	A*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7518209
	CA*F3743*6D*+TXV	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518210
	CA*F3743*6D*+TXV	G*E80603B*B*	28,800	21,400	14.5	12.0	1,050	7518211
	CA*F3743*6D*+TXV	G*E80805C*B*	28,800	21,400	14.5	12.0	1,060	7518212
	CA*F3743*6D*+TXV	G*E81005C*B*	28,800	21,400	14.5	11.5	1,080	7518213
	CA*F3743*6D*+TXV	G*EC960302BNA*	28,400	21,000	14.5	11.5	940	7518214
CA*F3743*6D*+TXV	G*EC960402BNA*	28,400	21,000	14.5	11.5	925	7518215	
CA*F3743*6D*+TXV	G*EC960603BNA*	28,400	21,000	14.5	11.5	965	7518216	
CA*F3743*6D*+TXV	G*EC960803BNA*	28,400	21,000	14.5	11.5	950	7518217	
CA*F3743*6D*+TXV	G*EC961004CNA*	28,800	21,400	14.5	11.5	1,025	7518218	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0301A* (cont.)	CA*F3743*6D*+TXV	G*VC80604B*B*	28,600	21,200	14.5	11.5	1,000	7518219
	CA*F3743*6D*+TXV	G*VC80805C*B*	28,600	21,200	14.5	11.5	990	7518220
	CA*F3743*6D*+TXV	G*VC81005C*B*	28,600	21,200	14.5	11.5	1,000	7518221
	CA*F3743*6D*+TXV	G*VC960403BNA*	28,800	21,400	14.5	11.5	1,000	7518222
	CA*F3743*6D*+TXV	G*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7518223
	CA*F3743*6D*+TXV	G*VC960803BNA*	28,600	21,200	14.5	11.5	975	7518224
	CA*F3743*6D*+TXV	G*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7518225
	CA*F3743*6D*+TXV	G*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7518226
	CA*F3743*6D*+TXV	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518227
	CAPT3743*4A*	A*EC960302BNA*	28,200	21,000	14.5	11.5	940	7518235
	CAPT3743*4A*	A*EC960402BNA*	28,200	21,000	14.5	11.5	925	7518236
	CAPT3743*4A*	A*EC960603BNA*	28,200	21,000	14.5	11.5	965	7518237
	CAPT3743*4A*	A*EC960803BNA*	28,200	21,000	14.5	11.5	950	7518238
	CAPT3743*4A*	A*EC961004CNA*	28,600	21,200	14.5	11.5	1,025	7518239
	CAPT3743*4A*	A*VC80604B*B*	28,400	21,000	14.5	11.5	1,000	7518240
	CAPT3743*4A*	A*VC80805C*B*	28,400	21,000	14.5	11.5	990	7518241
	CAPT3743*4A*	A*VC81005C*B*	28,400	21,000	14.5	11.5	1,000	7518242
	CAPT3743*4A*	A*VC960403BNA*	28,600	21,200	14.5	11.5	1,000	7518243
	CAPT3743*4A*	A*VC960603BNA*	28,600	21,200	14.5	11.5	1,040	7518244
	CAPT3743*4A*	A*VC960803BNA*	28,400	21,000	14.5	11.5	975	7518245
	CAPT3743*4A*	A*VC960804CNA*	28,600	21,200	14.5	11.5	1,000	7518246
	CAPT3743*4A*	A*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7518247
	CAPT3743*4A*	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518248
	CAPT3743*4A*	G*E80603B*B*	28,800	21,400	14.5	11.5	1,050	7518249
	CAPT3743*4A*	G*E80805C*B*	28,800	21,400	14.5	11.5	1,060	7518250
	CAPT3743*4A*	G*E81005C*B*	28,800	21,400	14.5	11.5	1,080	7518251
	CAPT3743*4A*	G*EC960302BNA*	28,200	21,000	14.5	11.5	940	7518252
	CAPT3743*4A*	G*EC960402BNA*	28,200	21,000	14.5	11.5	925	7518253
	CAPT3743*4A*	G*EC960603BNA*	28,200	21,000	14.5	11.5	965	7518254
	CAPT3743*4A*	G*EC960803BNA*	28,200	21,000	14.5	11.5	950	7518255
	CAPT3743*4A*	G*EC961004CNA*	28,600	21,200	14.5	11.5	1,025	7518256
	CAPT3743*4A*	G*VC80604B*B*	28,400	21,000	14.5	11.5	1,000	7518257
	CAPT3743*4A*	G*VC80805C*B*	28,400	21,000	14.5	11.5	990	7518258
	CAPT3743*4A*	G*VC81005C*B*	28,400	21,000	14.5	11.5	1,000	7518259
	CAPT3743*4A*	G*VC960403BNA*	28,600	21,200	14.5	11.5	1,000	7518260
	CAPT3743*4A*	G*VC960603BNA*	28,600	21,200	14.5	11.5	1,040	7518261
	CAPT3743*4A*	G*VC960803BNA*	28,400	21,000	14.5	11.5	975	7518262
	CAPT3743*4A*	G*VC960804CNA*	28,600	21,200	14.5	11.5	1,000	7518263
	CAPT3743*4A*	G*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7518264
	CAPT3743*4A*	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518265
	CAPT3743*4A*+EEP		28,800	21,400	14.5	11.5	1,000	7518232
	CAPT3743*4A*+MBVC1200**-1A*		28,800	21,400	14.5	12.0	980	7518233
	CAPT3743*4A*+MBVC1600**-1A*		28,800	21,400	14.5	12.0	1,000	7518234
	CHPF3636B6C*+TXV	A*VC960403BNA*	28,800	21,400	14.5	11.5	1,000	7518266
	CHPF3636B6C*+TXV	A*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7518267
	CHPF3636B6C*+TXV	A*VC960803BNA*	28,600	21,200	14.5	11.5	975	7518268
	CHPF3636B6C*+TXV	A*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7518269
	CHPF3636B6C*+TXV	G*VC960403BNA*	28,800	21,400	14.5	11.5	1,000	7518270
CHPF3636B6C*+TXV	G*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7518271	
CHPF3636B6C*+TXV	G*VC960803BNA*	28,600	21,200	14.5	11.5	975	7518272	
CHPF3636B6C*+TXV	G*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7518273	
CHPF3642C6C*	A*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7518302	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0301A* (cont.)	CHPF3642C6C*	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518303
	CHPF3642C6C*	G*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7518304
	CHPF3642C6C*	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518305
	CHPF3642C6C*+EEP		28,800	21,400	14.0	11.5	1,000	7518274
	CHPF3642C6C*+EEP+TXV		28,800	21,400	14.0	11.5	1,000	7518275
	CHPF3642C6C*+MBVC1200**-1A*		28,800	21,400	14.5	12.0	1,000	7519541
	CHPF3642C6C*+MBVC1200**-1A*+TXV		28,800	21,400	14.5	12.0	1,000	7518276
	CHPF3642C6C*+MBVC1600**-1A*		28,800	21,400	14.5	12.0	1,000	7518277
	CHPF3642C6C*+MBVC1600**-1A*+TXV		28,800	21,400	14.5	12.0	1,000	7518278
	CHPF3642C6C*+TXV	A*EC960302BNA*	28,400	21,000	14.5	11.5	940	7518279
	CHPF3642C6C*+TXV	A*EC960402BNA*	28,400	21,000	14.5	11.5	925	7518280
	CHPF3642C6C*+TXV	A*EC960603BNA*	28,400	21,000	14.5	11.5	965	7518281
	CHPF3642C6C*+TXV	A*EC960803BNA*	28,400	21,000	14.5	11.5	950	7518282
	CHPF3642C6C*+TXV	A*EC961004CNA*	28,800	21,400	14.5	11.5	1,025	7518283
	CHPF3642C6C*+TXV	A*VC80604B*B*	28,600	21,200	14.5	11.5	1,000	7518284
	CHPF3642C6C*+TXV	A*VC80805C*B*	28,600	21,200	14.5	11.5	990	7518285
	CHPF3642C6C*+TXV	A*VC81005C*B*	28,600	21,200	14.5	11.5	1,000	7518286
	CHPF3642C6C*+TXV	A*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7518287
	CHPF3642C6C*+TXV	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518288
	CHPF3642C6C*+TXV	G*E80603B*B*	28,800	21,400	14.5	11.5	1,050	7518289
	CHPF3642C6C*+TXV	G*E80805C*B*	28,800	21,400	14.5	11.5	1,000	7518290
	CHPF3642C6C*+TXV	G*E81005C*B*	28,800	21,400	14.5	11.5	1,080	7518291
	CHPF3642C6C*+TXV	G*EC960302BNA*	28,400	21,000	14.5	11.5	940	7518292
	CHPF3642C6C*+TXV	G*EC960402BNA*	28,400	21,000	14.5	11.5	925	7518293
	CHPF3642C6C*+TXV	G*EC960603BNA*	28,400	21,000	14.5	11.5	965	7518294
	CHPF3642C6C*+TXV	G*EC960803BNA*	28,400	21,000	14.5	11.5	950	7518295
	CHPF3642C6C*+TXV	G*EC961004CNA*	28,800	21,400	14.5	11.5	1,025	7518296
	CHPF3642C6C*+TXV	G*VC80604B*B*	28,600	21,200	14.5	11.5	1,000	7518297
	CHPF3642C6C*+TXV	G*VC80805C*B*	28,600	21,200	14.5	11.5	990	7518298
	CHPF3642C6C*+TXV	G*VC81005C*B*	28,600	21,200	14.5	11.5	1,000	7518299
	CHPF3642C6C*+TXV	G*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7518300
	CHPF3642C6C*+TXV	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518301
	CHPF3743C6B*+EEP		28,800	21,400	14.0	11.5	1,000	7518306
	CHPF3743C6B*+EEP+TXV		28,800	21,400	14.0	11.5	1,000	7518307
	CHPF3743D6B*+EEP		28,800	21,400	14.0	11.5	1,000	7518308
	CHPF3743D6B*+EEP+TXV		28,800	21,400	14.0	11.5	1,000	7518309
	CSCF3642N6D*	A*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7518342
	CSCF3642N6D*	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518343
	CSCF3642N6D*	G*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7518344
	CSCF3642N6D*	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518345
	CSCF3642N6D*+EEP		28,600	21,200	14.0	11.5	1,000	7518310
	CSCF3642N6D*+EEP+TXV		28,600	21,200	14.0	11.5	1,000	7518311
	CSCF3642N6D*+TXV	A*EC960302BNA*	28,200	21,000	14.5	11.5	940	7518312
	CSCF3642N6D*+TXV	A*EC960402BNA*	28,200	21,000	14.5	11.5	925	7518313
	CSCF3642N6D*+TXV	A*EC960603BNA*	28,200	21,000	14.5	11.5	965	7518314
	CSCF3642N6D*+TXV	A*EC960803BNA*	28,400	21,000	14.5	11.5	950	7518315
	CSCF3642N6D*+TXV	A*EC961004CNA*	28,400	21,000	14.5	11.5	1,025	7518316
	CSCF3642N6D*+TXV	A*VC80604B*B*	28,600	21,200	14.5	11.5	1,000	7518317
CSCF3642N6D*+TXV	A*VC80805C*B*	28,600	21,200	14.5	11.5	990	7518318	
CSCF3642N6D*+TXV	A*VC81005C*B*	28,600	21,200	14.5	11.5	1,000	7518319	
CSCF3642N6D*+TXV	A*VC960403BNA*	28,800	21,400	14.5	11.5	1,000	7518320	
CSCF3642N6D*+TXV	A*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7518321	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0301A* (cont.)	CSCF3642N6D*+TXV	A*VC960803BNA*	28,600	21,200	14.5	11.5	975	7518322
	CSCF3642N6D*+TXV	A*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7518323
	CSCF3642N6D*+TXV	A*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7518324
	CSCF3642N6D*+TXV	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518325
	CSCF3642N6D*+TXV	G*E80603B*B*	28,800	21,400	14.5	11.5	1,050	7518326
	CSCF3642N6D*+TXV	G*E80805C*B*	28,800	21,400	14.5	11.5	1,060	7518327
	CSCF3642N6D*+TXV	G*EC960302BNA*	28,200	21,000	14.5	11.5	940	7518328
	CSCF3642N6D*+TXV	G*EC960402BNA*	28,200	21,000	14.5	11.5	925	7518329
	CSCF3642N6D*+TXV	G*EC960603BNA*	28,200	21,000	14.5	11.5	965	7518330
	CSCF3642N6D*+TXV	G*EC960803BNA*	28,400	21,000	14.5	11.5	950	7518331
	CSCF3642N6D*+TXV	G*EC961004CNA*	28,400	21,000	14.5	11.5	1,025	7518332
	CSCF3642N6D*+TXV	G*VC80604B*B*	28,600	21,200	14.5	11.5	1,000	7518333
	CSCF3642N6D*+TXV	G*VC80805C*B*	28,600	21,200	14.5	11.5	990	7518334
	CSCF3642N6D*+TXV	G*VC81005C*B*	28,600	21,200	14.5	11.5	1,000	7518335
	CSCF3642N6D*+TXV	G*VC960403BNA*	28,800	21,400	14.5	11.5	1,000	7518336
	CSCF3642N6D*+TXV	G*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7518337
	CSCF3642N6D*+TXV	G*VC960803BNA*	28,600	21,200	14.5	11.5	975	7518338
	CSCF3642N6D*+TXV	G*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7518339
	CSCF3642N6D*+TXV	G*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7518340
	CSCF3642N6D*+TXV	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7518341
CSCF3642N6D*+TXV	G*E81005C*B*	28,600	21,200	14.5	11.5	1,070	7520358	
VSX14 0311A*	ARUF31B14A*		28,200	22,200	14.0	12.2	870	7984208
	ARUF37C14A*		28,400	22,400	14.0	12.2	1,050	7984209
	ASPT36C14A*		28,000	22,000	15.0	12.5	1,010	7518346
	ASPT37B14A*		29,000	22,800	14.5	12.2	945	8242103
	ASPT37C14A*		29,000	22,800	15.0	12.5	1,045	8242104
	AVPTC36C14A*		28,000	22,000	15.0	12.5	1,000	7518347
	AWUF31XX16A*		28,000	22,000	14.0	12.2	1,000	7518348
	AWUF31XX16A*+TXV		28,000	22,000	14.5	12.2	1,000	7518349
	AWUF32XX16A*		28,000	22,000	14.0	12.2	950	7518350
	AWUF32XX16A*+TXV		28,000	22,000	14.5	12.2	950	7518351
	AWUF37XX16B*		28,000	22,000	14.0	12.2	950	7518352
	AWUF37XX16B*+TXV		28,000	22,000	14.5	12.2	950	7518353
	CA*F3137*6A*	A*EC960302BNA*	28,200	22,200	15.0	12.5	940	7520359
	CA*F3137*6A*	A*EC960402BNA*	28,200	22,200	15.0	12.5	925	7520360
	CA*F3137*6A*	A*EC960603BNA*	28,200	22,200	15.0	12.5	965	7520361
	CA*F3137*6A*	A*EC960803BNA*	28,200	22,200	15.0	12.5	950	7520362
	CA*F3137*6A*	A*VC80604B*B*	28,400	22,400	15.0	12.5	1,000	7520364
	CA*F3137*6A*	A*VC960403BNA*	28,600	22,600	15.0	12.5	1,000	7520367
	CA*F3137*6A*	A*VC960603BNA*	28,600	22,600	15.0	12.5	1,040	7520368
	CA*F3137*6A*	A*VC960803BNA*	28,400	22,400	15.0	12.5	975	7520369
	CA*F3137*6A*	A*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7520370
	CA*F3137*6A*	G*E80603B*B*	28,400	22,400	14.5	12.2	1,050	7520371
	CA*F3137*6A*	G*EC960302BNA*	28,200	22,200	15.0	12.5	940	7520374
	CA*F3137*6A*	G*EC960402BNA*	28,200	22,200	15.0	12.5	925	7520375
	CA*F3137*6A*	G*EC960603BNA*	28,200	22,200	15.0	12.5	965	7520376
	CA*F3137*6A*	G*EC960803BNA*	28,200	22,200	15.0	12.5	950	7520377
	CA*F3137*6A*	G*VC80604B*B*	28,400	22,400	15.0	12.5	1,000	7520379
	CA*F3137*6A*	G*VC960403BNA*	28,600	22,600	15.0	12.5	1,000	7520382
CA*F3137*6A*	G*VC960603BNA*	28,600	22,600	15.0	12.5	1,040	7520383	
CA*F3137*6A*	G*VC960803BNA*	28,400	22,400	15.0	12.5	975	7520384	
CA*F3137*6A*	G*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7520385	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0311A* (cont.)	CA*F3137*6A*+EEP		28,600	22,600	14.0	12.2	1,000	7518358
	CA*F3137*6A*+EEP+TXV		28,600	22,600	14.0	12.2	1,000	7518359
	CA*F3743*6D*	A*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7518397
	CA*F3743*6D*	A*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7518398
	CA*F3743*6D*	G*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7518399
	CA*F3743*6D*	G*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7518400
	CA*F3743*6D*+TXV	A*EC960302BNA*	28,400	22,400	15.0	12.5	940	7518366
	CA*F3743*6D*+TXV	A*EC960402BNA*	28,400	22,400	15.0	12.5	925	7518367
	CA*F3743*6D*+TXV	A*EC960603BNA*	28,400	22,400	15.0	12.5	965	7518368
	CA*F3743*6D*+TXV	A*EC960803BNA*	28,400	22,400	15.0	12.5	950	7518369
	CA*F3743*6D*+TXV	A*EC961004CNA*	28,800	22,600	15.0	12.5	1,025	7518370
	CA*F3743*6D*+TXV	A*VC80604B*B*	28,600	22,600	15.0	12.5	1,000	7518371
	CA*F3743*6D*+TXV	A*VC80805C*B*	28,600	22,600	15.0	12.5	990	7518372
	CA*F3743*6D*+TXV	A*VC81005C*B*	28,600	22,600	15.0	12.5	1,000	7518373
	CA*F3743*6D*+TXV	A*VC960403BNA*	28,800	22,600	15.0	12.5	1,000	7518374
	CA*F3743*6D*+TXV	A*VC960603BNA*	28,600	22,600	15.0	12.5	1,040	7518375
	CA*F3743*6D*+TXV	A*VC960803BNA*	28,400	22,400	15.0	12.5	975	7518376
	CA*F3743*6D*+TXV	A*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7518377
	CA*F3743*6D*+TXV	A*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7518378
	CA*F3743*6D*+TXV	A*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7518379
	CA*F3743*6D*+TXV	G*E80603B*B*	28,400	22,400	15.0	12.5	1,050	7518380
	CA*F3743*6D*+TXV	G*E80805C*B*	28,600	22,600	15.0	12.5	1,000	7518381
	CA*F3743*6D*+TXV	G*E81005C*B*	28,400	22,400	15.0	12.5	1,000	7518382
	CA*F3743*6D*+TXV	G*EC960302BNA*	28,400	22,400	15.0	12.5	940	7518383
	CA*F3743*6D*+TXV	G*EC960402BNA*	28,400	22,400	15.0	12.5	925	7518384
	CA*F3743*6D*+TXV	G*EC960603BNA*	28,400	22,400	15.0	12.5	965	7518385
	CA*F3743*6D*+TXV	G*EC960803BNA*	28,400	22,400	15.0	12.5	950	7518386
	CA*F3743*6D*+TXV	G*EC961004CNA*	28,800	22,600	15.0	12.5	1,025	7518387
	CA*F3743*6D*+TXV	G*VC80604B*B*	28,600	22,600	15.0	12.5	1,000	7518388
	CA*F3743*6D*+TXV	G*VC80805C*B*	28,600	22,600	15.0	12.5	990	7518389
	CA*F3743*6D*+TXV	G*VC81005C*B*	28,600	22,600	15.0	12.5	1,000	7518390
	CA*F3743*6D*+TXV	G*VC960403BNA*	28,800	22,600	15.0	12.5	1,000	7518391
	CA*F3743*6D*+TXV	G*VC960603BNA*	28,600	22,600	15.0	12.5	1,040	7518392
	CA*F3743*6D*+TXV	G*VC960803BNA*	28,400	22,400	15.0	12.5	975	7518393
	CA*F3743*6D*+TXV	G*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7518394
	CA*F3743*6D*+TXV	G*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7518395
	CA*F3743*6D*+TXV	G*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7518396
	CAPT3743*4A*	A*EC960302BNA*	28,200	22,200	14.5	12.2	940	7518404
	CAPT3743*4A*	A*EC960402BNA*	28,200	22,200	14.5	12.2	925	7518405
	CAPT3743*4A*	A*EC960803BNA*	28,200	22,200	14.5	12.2	950	7518407
	CAPT3743*4A*	A*EC961004CNA*	28,600	22,600	14.5	12.2	1,025	7518408
	CAPT3743*4A*	A*VC80604B*B*	28,400	22,400	14.5	12.2	1,000	7518409
CAPT3743*4A*	A*VC81005C*B*	28,400	22,400	14.5	12.2	1,000	7518411	
CAPT3743*4A*	A*VC960403BNA*	28,400	22,400	14.5	12.2	1,000	7518412	
CAPT3743*4A*	A*VC960603BNA*	28,400	22,400	14.5	12.2	1,040	7518413	
CAPT3743*4A*	A*VC960803BNA*	27,800	21,800	15.0	12.5	975	7518414	
CAPT3743*4A*	A*VC960804CNA*	28,400	22,400	14.5	12.2	1,000	7518415	
CAPT3743*4A*	A*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7518416	
CAPT3743*4A*	A*VM970804CNA*	28,400	22,400	14.5	12.2	1,000	7518417	
CAPT3743*4A*	G*E80603B*B*	28,400	22,400	14.5	12.2	1,050	7518418	
CAPT3743*4A*	G*E80805C*B*	28,400	22,400	14.5	12.2	1,000	7518419	
CAPT3743*4A*	G*EC960302BNA*	28,200	22,200	14.5	12.2	940	7518421	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0311A* (cont.)	CAPT3743*4A*	G*EC960402BNA*	28,200	22,200	14.5	12.2	925	7518422
	CAPT3743*4A*	G*EC960803BNA*	28,200	22,200	14.5	12.2	950	7518424
	CAPT3743*4A*	G*EC961004CNA*	28,600	22,600	14.5	12.2	1,025	7518425
	CAPT3743*4A*	G*VC80604B*B*	28,400	22,400	14.5	12.2	1,000	7518426
	CAPT3743*4A*	G*VC81005C*B*	28,400	22,400	14.5	12.2	1,000	7518428
	CAPT3743*4A*	G*VC960403BNA*	28,400	22,400	14.5	12.2	1,000	7518429
	CAPT3743*4A*	G*VC960603BNA*	28,400	22,400	14.5	12.2	1,040	7518430
	CAPT3743*4A*	G*VC960803BNA*	27,800	21,800	15.0	12.5	975	7518431
	CAPT3743*4A*	G*VC960804CNA*	28,400	22,400	14.5	12.2	1,000	7518432
	CAPT3743*4A*	G*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7518433
	CAPT3743*4A*	G*VM970804CNA*	28,400	22,400	14.5	12.2	1,000	7518434
	CAPT3743*4A*+EEP		28,000	22,000	14.5	12.2	1,000	7518401
	CAPT3743*4A*+MBVC1200**-1A*		28,600	22,600	15.0	12.5	1,000	7518402
	CAPT3743*4A*+MBVC1600**-1A*		28,600	22,600	15.0	12.5	1,000	7518403
	CHPF3636B6C*+TXV	A*VC960403BNA*	28,000	22,000	14.5	12.5	1,000	7518435
	CHPF3636B6C*+TXV	A*VC960603BNA*	28,000	22,000	14.5	12.2	1,040	7518436
	CHPF3636B6C*+TXV	A*VC960803BNA*	28,000	22,000	14.5	12.2	975	7518437
	CHPF3636B6C*+TXV	A*VM970603BNA*	28,000	22,000	14.5	12.2	1,040	7518438
	CHPF3636B6C*+TXV	G*VC960403BNA*	28,000	22,000	14.5	12.5	1,000	7518439
	CHPF3636B6C*+TXV	G*VC960603BNA*	28,000	22,000	14.5	12.2	1,040	7518440
	CHPF3636B6C*+TXV	G*VC960803BNA*	28,000	22,000	14.5	12.2	975	7518441
	CHPF3636B6C*+TXV	G*VM970603BNA*	28,000	22,000	14.5	12.2	1,040	7518442
	CHPF3642C6C*+EEP		28,600	22,600	14.0	12.2	1,000	7518443
	CHPF3642C6C*+EEP+TXV		28,000	22,000	14.5	12.2	1,000	7518444
	CHPF3642C6C*+MBVC1200**-1A*		28,000	22,000	14.5	12.2	1,000	7519542
	CHPF3642C6C*+MBVC1200**-1A*+TXV		28,000	22,000	14.5	12.2	1,000	7518445
	CHPF3642C6C*+MBVC1600**-1A*		28,000	22,000	14.5	12.2	1,000	7518446
	CHPF3642C6C*+MBVC1600**-1A*+TXV		28,400	22,400	15.0	12.5	1,000	7518447
	CHPF3642C6C*+TXV	A*EC960302BNA*	28,400	22,400	14.5	12.2	940	7518448
	CHPF3642C6C*+TXV	A*EC960402BNA*	28,400	22,400	15.0	12.5	925	7518449
	CHPF3642C6C*+TXV	A*EC960603BNA*	28,400	22,400	14.5	12.2	965	7518450
	CHPF3642C6C*+TXV	A*EC960803BNA*	28,400	22,400	14.5	12.2	950	7518451
	CHPF3642C6C*+TXV	A*VC80604B*B*	28,000	22,000	14.5	12.2	1,000	7518452
	CHPF3642C6C*+TXV	G*E80603B*B*	28,000	22,000	14.5	12.2	1,050	7518453
	CHPF3642C6C*+TXV	G*EC960302BNA*	28,400	22,400	14.5	12.2	940	7518454
	CHPF3642C6C*+TXV	G*EC960402BNA*	28,400	22,400	15.0	12.5	925	7518455
	CHPF3642C6C*+TXV	G*EC960603BNA*	28,400	22,400	14.5	12.2	965	7518456
	CHPF3642C6C*+TXV	G*EC960803BNA*	28,400	22,400	14.5	12.2	950	7518457
	CHPF3642C6C*+TXV	G*VC80604B*B*	28,000	22,000	14.5	12.2	1,000	7518458
	CHPF3642D6C*	A*VC960804CNA*	28,600	22,600	14.5	12.2	1,000	7518471
	CHPF3642D6C*	A*VM970804CNA*	28,600	22,600	14.5	12.2	1,000	7518472
	CHPF3642D6C*	G*VC960804CNA*	28,600	22,600	14.5	12.2	1,000	7518473
CHPF3642D6C*	G*VM970804CNA*	28,600	22,600	14.5	12.2	1,000	7518474	
CHPF3642D6C*+TXV	A*EC961004CNA*	28,800	22,600	15.0	12.5	1,025	7518459	
CHPF3642D6C*+TXV	A*VC80805C*B*	28,600	22,600	15.0	12.5	990	7518460	
CHPF3642D6C*+TXV	A*VC81005C*B*	28,600	22,600	14.5	12.2	1,000	7518461	
CHPF3642D6C*+TXV	A*VC960804CNA*	28,600	22,600	14.5	12.2	1,000	7518462	
CHPF3642D6C*+TXV	A*VM970804CNA*	28,600	22,600	14.5	12.2	1,000	7518463	
CHPF3642D6C*+TXV	G*E80805C*B*	28,000	22,000	15.0	12.5	1,000	7518464	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0311A* (cont.)	CHPF3642D6C*+TXV	G*E81005C*B*	28,600	22,600	15.0	12.5	1,000	7518465
	CHPF3642D6C*+TXV	G*EC961004CNA*	28,800	22,600	15.0	12.5	1,025	7518466
	CHPF3642D6C*+TXV	G*VC80805C*B*	28,600	22,600	15.0	12.5	990	7518467
	CHPF3642D6C*+TXV	G*VC81005C*B*	28,600	22,600	14.5	12.2	1,000	7518468
	CHPF3642D6C*+TXV	G*VC960804CNA*	28,600	22,600	14.5	12.2	1,000	7518469
	CHPF3642D6C*+TXV	G*VM970804CNA*	28,600	22,600	14.5	12.2	1,000	7518470
	CSCF3642N6D*	A*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7518508
	CSCF3642N6D*	A*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7518509
	CSCF3642N6D*	G*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7518510
	CSCF3642N6D*	G*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7518511
	CSCF3642N6D*+EEP		28,400	22,400	14.0	12.2	1,000	7518475
	CSCF3642N6D*+EEP+TXV		28,400	22,400	14.5	12.2	1,000	7518476
	CSCF3642N6D*+TXV	A*EC960302BNA*	28,400	22,400	14.5	12.2	940	7518477
	CSCF3642N6D*+TXV	A*EC960402BNA*	28,400	22,400	14.5	12.2	925	7518478
	CSCF3642N6D*+TXV	A*EC960603BNA*	28,400	22,400	14.5	12.2	965	7518479
	CSCF3642N6D*+TXV	A*EC960803BNA*	28,400	22,400	14.5	12.2	950	7518480
	CSCF3642N6D*+TXV	A*EC961004CNA*	28,400	22,400	14.5	12.2	1,025	7518481
	CSCF3642N6D*+TXV	A*VC80604B*B*	28,600	22,600	15.0	12.5	1,000	7518482
	CSCF3642N6D*+TXV	A*VC80805C*B*	28,400	22,400	15.0	12.5	990	7518483
	CSCF3642N6D*+TXV	A*VC81005C*B*	28,600	22,600	15.0	12.5	1,000	7518484
	CSCF3642N6D*+TXV	A*VC960403BNA*	28,600	22,600	15.0	12.5	1,000	7518485
	CSCF3642N6D*+TXV	A*VC960603BNA*	28,400	22,400	15.0	12.5	1,040	7518486
	CSCF3642N6D*+TXV	A*VC960803BNA*	28,400	22,400	15.0	12.5	975	7518487
	CSCF3642N6D*+TXV	A*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7518488
	CSCF3642N6D*+TXV	A*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7518489
	CSCF3642N6D*+TXV	A*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7518490
	CSCF3642N6D*+TXV	G*E80603B*B*	28,600	22,600	15.0	12.5	1,050	7518491
	CSCF3642N6D*+TXV	G*E80805C*B*	28,400	22,400	15.0	12.5	1,000	7518492
	CSCF3642N6D*+TXV	G*E81005C*B*	28,400	22,400	15.0	12.5	1,000	7518493
	CSCF3642N6D*+TXV	G*EC960302BNA*	28,400	22,400	14.5	12.2	940	7518494
	CSCF3642N6D*+TXV	G*EC960402BNA*	28,400	22,400	14.5	12.2	925	7518495
	CSCF3642N6D*+TXV	G*EC960603BNA*	28,400	22,400	14.5	12.2	965	7518496
	CSCF3642N6D*+TXV	G*EC960803BNA*	28,400	22,400	14.5	12.2	950	7518497
	CSCF3642N6D*+TXV	G*EC961004CNA*	28,400	22,400	14.5	12.2	1,025	7518498
	CSCF3642N6D*+TXV	G*VC80604B*B*	28,600	22,600	15.0	12.5	1,000	7518499
	CSCF3642N6D*+TXV	G*VC80805C*B*	28,400	22,400	15.0	12.5	990	7518500
	CSCF3642N6D*+TXV	G*VC81005C*B*	28,600	22,600	15.0	12.5	1,000	7518501
	CSCF3642N6D*+TXV	G*VC960403BNA*	28,600	22,600	15.0	12.5	1,000	7518502
	CSCF3642N6D*+TXV	G*VC960603BNA*	28,400	22,400	15.0	12.5	1,040	7518503
	CSCF3642N6D*+TXV	G*VC960803BNA*	28,400	22,400	15.0	12.5	975	7518504
	CSCF3642N6D*+TXV	G*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7518505
	CSCF3642N6D*+TXV	G*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7518506
CSCF3642N6D*+TXV	G*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7518507	

¹ BTU/h

² Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F

³ Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- When matching the outdoor unit to the indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Goodman Gas Furnace contains the EEP cooling time delay

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0361A*	ARUF37C14A*		33,600	25,000	14.0	11.5	1,050	7984210
	ARUF37D14A*		33,600	25,000	14.0	11.5	1,240	8171727
	ASPT36C14A*		34,200	25,400	14.5	11.5	1,210	7518512
	ASPT37C14A*		34,200	25,400	14.5	12.0	1,120	8242105
	ASPT42D14A*		34,800	25,800	14.5	12.0	1,280	7518513
	ASPT47C14A*		34,200	25,400	14.5	12.0	1,120	8242106
	ASPT47D14A*		34,600	25,600	15.0	12.5	1,205	8242107
	AVPTC36C14A*		34,200	25,400	14.5	11.5	1,100	7518514
	AVPTC42D14A*		34,800	25,800	14.5	12.0	1,120	7518515
	AWUF37XX16B*+TXV		33,000	24,400	14.5	11.5	1,050	7518516
	CA*F3137*6A*+EEP		34,000	25,200	14.0	11.5	1,200	8187523
	CA*F3137*6A*+EEP+TXV		34,000	25,200	14.0	11.5	1,200	8187524
	CA*F3137*6A*+TXV	G*E80603B*B*	33,400	24,800	14.0	11.5	1,100	8187525
	CA*F3137*6A*+TXV	G*VC80604B*B*	33,600	25,000	14.0	11.5	1,240	8187526
	CA*F3137*6A*+TXV	G*VC960403BNA*	34,200	25,400	14.0	11.5	1,200	8187527
	CA*F3137*6A*+TXV	G*VC960603BNA*	34,400	25,400	14.0	11.5	1,200	8187528
	CA*F3137*6A*+TXV	G*VC960803BNA*	34,400	25,400	14.0	11.5	1,150	8187529
	CA*F3137*6A*+TXV	G*VM970603BNA*	34,400	25,400	14.0	11.5	1,200	8187530
	CA*F3137*6A*+TXV	G*VM970803BNA*	34,400	25,400	14.0	11.5	1,150	8187531
	CA*F3137*6A*+TXV	G*EC960603BNA*	34,200	25,400	14.0	11.5	1,100	8187532
	CA*F3137*6A*+TXV	G*EC960803BNA*	34,200	25,400	14.0	11.5	1,100	8187533
	CA*F3137*6A*+TXV	A*EH800603B*A*	33,400	24,800	14.0	11.5	1,100	8187544
	CA*F3137*6A*+TXV	A*VC80604B*B*	33,600	25,000	14.0	11.5	1,240	8187545
	CA*F3137*6A*+TXV	A*VC960403BNA*	34,200	25,400	14.0	11.5	1,200	8187546
	CA*F3137*6A*+TXV	A*VC960603BNA*	34,400	25,400	14.0	11.5	1,200	8187547
	CA*F3137*6A*+TXV	A*VC960803BNA*	34,400	25,400	14.0	11.5	1,150	8187548
	CA*F3137*6A*+TXV	A*VM970603BNA*	34,400	25,400	14.0	11.5	1,200	8187549
	CA*F3137*6A*+TXV	A*VM970803BNA*	34,400	25,400	14.0	11.5	1,150	8187550
	CA*F3137*6A*+TXV	A*EC960603BNA*	34,200	25,400	14.0	11.5	1,100	8187551
	CA*F3137*6A*+TXV	A*EC960803BNA*	34,200	25,400	14.0	11.5	1,100	8187552
	CA*F3642*6D*+EEP		34,000	25,200	14.0	11.5	1,200	7518517
	CA*F3642*6D*+EEP+TXV		34,000	25,200	14.0	11.5	1,200	7518518
	CA*F3642*6D*+MBVC1600**-1A*		34,000	25,200	14.5	11.5	1,200	7518519
	CA*F3642*6D*+MBVC2000**-1A*		34,000	25,200	14.5	12.0	1,200	7518520
	CA*F3743*6D*	A*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7518564
	CA*F3743*6D*	A*EC961205DNA*	34,000	25,200	14.5	11.5	1,075	7518565
	CA*F3743*6D*	A*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7518566
	CA*F3743*6D*	A*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7518567
	CA*F3743*6D*	A*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7518568
	CA*F3743*6D*	A*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7518569
	CA*F3743*6D*	A*VC961205DNA*	34,600	25,600	14.5	11.5	1,200	7518570
	CA*F3743*6D*	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518571
	CA*F3743*6D*	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7518572
	CA*F3743*6D*	A*VM971205DNA*	34,600	25,600	14.5	11.5	1,200	7518573
	CA*F3743*6D*	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7518574
CA*F3743*6D*	G*E81005C*B*	34,000	25,200	14.5	11.5	1,230	7518575	
CA*F3743*6D*	G*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7518576	
CA*F3743*6D*	G*EC961205DNA*	34,000	25,200	14.5	11.5	1,075	7518577	
CA*F3743*6D*	G*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7518578	
CA*F3743*6D*	G*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7518579	
CA*F3743*6D*	G*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7518580	
CA*F3743*6D*	G*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7518581	

See Notes on Page 50.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0361A* (cont.)	CA*F3743*6D*	G*VC961205DNA*	34,600	25,600	14.5	11.5	1,200	7518582
	CA*F3743*6D*	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518583
	CA*F3743*6D*	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7518584
	CA*F3743*6D*	G*VM971205DNA*	34,600	25,600	14.5	11.5	1,200	7518585
	CA*F3743*6D*+EEP		34,600	25,600	14.0	11.5	1,200	7518521
	CA*F3743*6D*+EEP+TXV		34,600	25,600	14.5	11.5	1,200	7518522
	CA*F3743*6D*+MBVC1600** -1A*		35,000	26,000	14.5	11.5	1,200	7518523
	CA*F3743*6D*+MBVC2000** -1A*		35,000	26,000	14.5	11.5	1,200	7518524
	CA*F3743*6D*+TXV	A*EC960603BNA*	34,200	25,400	14.5	11.5	1,150	7518525
	CA*F3743*6D*+TXV	A*EC960803BNA*	34,200	25,400	14.5	11.5	1,150	7518526
	CA*F3743*6D*+TXV	A*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7518527
	CA*F3743*6D*+TXV	A*EC961205DNA*	34,000	25,200	14.5	12.0	1,075	7518528
	CA*F3743*6D*+TXV	A*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7518529
	CA*F3743*6D*+TXV	A*VC80805C*B*	33,600	25,000	14.5	12.0	1,200	7518530
	CA*F3743*6D*+TXV	A*VC81005C*B*	33,400	24,800	14.5	12.0	1,200	7518531
	CA*F3743*6D*+TXV	A*VC960403BNA*	34,200	25,400	14.5	11.5	1,200	7518532
	CA*F3743*6D*+TXV	A*VC960603BNA*	34,400	25,400	14.5	11.5	1,250	7518533
	CA*F3743*6D*+TXV	A*VC960803BNA*	34,400	25,400	14.5	11.5	1,250	7518534
	CA*F3743*6D*+TXV	A*VC960804CNA*	34,600	25,600	14.5	12.0	1,190	7518535
	CA*F3743*6D*+TXV	A*VC961005CNA*	34,600	25,600	14.5	12.0	1,175	7518536
	CA*F3743*6D*+TXV	A*VC961205DNA*	34,600	25,600	14.5	12.0	1,200	7518537
	CA*F3743*6D*+TXV	A*VM970603BNA*	34,400	25,400	14.5	11.5	1,250	7518538
	CA*F3743*6D*+TXV	A*VM970803BNA*	34,400	25,400	14.5	11.5	1,250	7518539
	CA*F3743*6D*+TXV	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518540
	CA*F3743*6D*+TXV	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7518541
	CA*F3743*6D*+TXV	A*VM971205DNA*	34,600	25,600	14.5	12.0	1,200	7518542
	CA*F3743*6D*+TXV	G*E80603B*B*	33,400	24,800	14.5	11.5	1,250	7518543
	CA*F3743*6D*+TXV	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7518544
	CA*F3743*6D*+TXV	G*E81005C*B*	34,000	25,200	14.5	11.5	1,230	7518545
	CA*F3743*6D*+TXV	G*EC960603BNA*	34,200	25,400	14.5	11.5	1,150	7518546
	CA*F3743*6D*+TXV	G*EC960803BNA*	34,200	25,400	14.5	11.5	1,150	7518547
	CA*F3743*6D*+TXV	G*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7518548
	CA*F3743*6D*+TXV	G*EC961205DNA*	34,000	25,200	14.5	12.0	1,075	7518549
	CA*F3743*6D*+TXV	G*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7518550
	CA*F3743*6D*+TXV	G*VC80805C*B*	33,600	25,000	14.5	12.0	1,200	7518551
	CA*F3743*6D*+TXV	G*VC81005C*B*	33,400	24,800	14.5	12.0	1,200	7518552
	CA*F3743*6D*+TXV	G*VC960403BNA*	34,200	25,400	14.5	11.5	1,200	7518553
	CA*F3743*6D*+TXV	G*VC960603BNA*	34,400	25,400	14.5	11.5	1,250	7518554
	CA*F3743*6D*+TXV	G*VC960803BNA*	34,400	25,400	14.5	11.5	1,250	7518555
	CA*F3743*6D*+TXV	G*VC960804CNA*	34,600	25,600	14.5	12.0	1,190	7518556
	CA*F3743*6D*+TXV	G*VC961005CNA*	34,600	25,600	14.5	12.0	1,175	7518557
	CA*F3743*6D*+TXV	G*VC961205DNA*	34,600	25,600	14.5	12.0	1,200	7518558
	CA*F3743*6D*+TXV	G*VM970603BNA*	34,400	25,400	14.5	11.5	1,250	7518559
	CA*F3743*6D*+TXV	G*VM970803BNA*	34,400	25,400	14.5	11.5	1,250	7518560
	CA*F3743*6D*+TXV	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518561
	CA*F3743*6D*+TXV	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7518562
	CA*F3743*6D*+TXV	G*VM971205DNA*	34,600	25,600	14.5	12.0	1,200	7518563
CA*F4860*6D*+EEP		34,800	25,800	14.0	11.5	1,200	7518586	
CA*F4860*6D*+EEP+TXV		34,800	25,800	14.0	11.5	1,200	7518587	
CAPT3743*4A*	A*EC960803BNA*	34,200	25,400	14.0	11.5	1,150	7518589	
CAPT3743*4A*	A*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7518590	
CAPT3743*4A*	A*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7518591	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0361A* (cont.)	CAPT3743*4A*	A*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7518592
	CAPT3743*4A*	A*VC960403BNA*	34,000	25,200	14.5	11.5	1,200	7518593
	CAPT3743*4A*	A*VC960603BNA*	34,200	25,400	14.5	11.5	1,250	7518594
	CAPT3743*4A*	A*VC960803BNA*	34,200	25,400	14.5	11.5	1,250	7518595
	CAPT3743*4A*	A*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7518596
	CAPT3743*4A*	A*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7518597
	CAPT3743*4A*	A*VC961205DNA*	34,400	25,400	14.5	11.5	1,200	7518598
	CAPT3743*4A*	A*VM970603BNA*	34,200	25,400	14.5	11.5	1,250	7518599
	CAPT3743*4A*	A*VM970803BNA*	34,200	25,400	14.5	11.5	1,250	7518600
	CAPT3743*4A*	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518601
	CAPT3743*4A*	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7518602
	CAPT3743*4A*	A*VM971205DNA*	34,400	25,400	14.5	11.5	1,200	7518603
	CAPT3743*4A*	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7518604
	CAPT3743*4A*	G*E81005C*B*	34,000	25,200	14.5	11.5	1,230	7518605
	CAPT3743*4A*	G*EC960803BNA*	34,200	25,400	14.0	11.5	1,150	7518606
	CAPT3743*4A*	G*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7518607
	CAPT3743*4A*	G*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7518608
	CAPT3743*4A*	G*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7518609
	CAPT3743*4A*	G*VC960403BNA*	34,000	25,200	14.5	11.5	1,200	7518610
	CAPT3743*4A*	G*VC960603BNA*	34,200	25,400	14.5	11.5	1,250	7518611
	CAPT3743*4A*	G*VC960803BNA*	34,200	25,400	14.5	11.5	1,250	7518612
	CAPT3743*4A*	G*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7518613
	CAPT3743*4A*	G*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7518614
	CAPT3743*4A*	G*VC961205DNA*	34,400	25,400	14.5	11.5	1,200	7518615
	CAPT3743*4A*	G*VM970603BNA*	34,200	25,400	14.5	11.5	1,250	7518616
	CAPT3743*4A*	G*VM970803BNA*	34,200	25,400	14.5	11.5	1,250	7518617
	CAPT3743*4A*	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518618
	CAPT3743*4A*	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7518619
	CAPT3743*4A*	G*VM971205DNA*	34,400	25,400	14.5	11.5	1,200	7518620
	CAPT3743*4A*	A*EC960603BNA*	34,200	25,400	14.0	11.5	1,150	7518623
	CAPT3743*4A*	A*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7518624
	CAPT3743*4A*	A*EC961205DNA*	34,000	25,200	14.5	11.5	1,075	7518625
	CAPT3743*4A*	G*EC960603BNA*	34,200	25,400	14.0	11.5	1,150	7518626
	CAPT3743*4A*	G*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7518627
	CAPT3743*4A*	G*EC961205DNA*	34,000	25,200	14.5	11.5	1,075	7518628
	CAPT3743*4A*+EEP		34,600	25,600	14.5	11.5	1,200	7518588
	CAPT3743*4A*+MBVC1600**-1A*		34,000	25,200	14.5	11.5	1,205	7518621
	CAPT3743*4A*+MBVC2000**-1A*		34,000	25,200	14.5	11.5	1,205	7518622
	CHPF3642C6C*	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7518637
	CHPF3642C6C*	G*E81005C*B*	34,000	25,200	14.5	11.5	1,230	7518638
	CHPF3642C6C*+EEP		34,600	25,600	14.0	11.5	1,200	7518629
	CHPF3642C6C*+EEP+TXV		34,600	25,600	14.0	11.5	1,200	7518630
	CHPF3642C6C*+MBVC1600**-1A*		35,000	26,000	14.5	11.5	1,200	7518639
	CHPF3642C6C*+TXV	A*EC960603BNA*	34,200	25,400	14.5	11.5	1,150	7518631
	CHPF3642C6C*+TXV	A*EC960803BNA*	34,200	25,400	14.5	11.5	1,150	7518632
	CHPF3642C6C*+TXV	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7518633
	CHPF3642C6C*+TXV	G*E81005C*B*	34,000	25,200	14.5	12.0	1,230	7518634
	CHPF3642C6C*+TXV	G*EC960603BNA*	34,200	25,400	14.5	11.5	1,150	7518635
CHPF3642C6C*+TXV	G*EC960803BNA*	34,200	25,400	14.5	11.5	1,150	7518636	
CHPF3642C6C*+TXV	G*E80603B*B*	33,400	24,800	14.5	11.5	1,250	7518640	
CHPF3743C6B*	A*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7518667	
CHPF3743C6B*	A*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7518668	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
	CHPF3743C6B*	A*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7518669
	CHPF3743C6B*	A*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7518670
	CHPF3743C6B*	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518671
	CHPF3743C6B*	G*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7518672
	CHPF3743C6B*	G*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7518673
	CHPF3743C6B*	G*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7518674
	CHPF3743C6B*	G*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7518675
	CHPF3743C6B*	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518676
	CHPF3743C6B*	A*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7518680
	CHPF3743C6B*	G*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7518681
	CHPF3743C6B*	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7520386
	CHPF3743C6B*	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7520387
	CHPF3743C6B*+EEP		34,000	25,200	14.0	11.5	1,150	7518641
	CHPF3743C6B*+EEP+TXV		34,000	25,200	14.5	11.5	1,150	7518642
	CHPF3743C6B*+MBVC1600**-1A*		35,000	26,000	14.5	11.5	1,200	7518677
	CHPF3743C6B*+TXV	A*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7518643
	CHPF3743C6B*+TXV	A*VC80805C*B*	33,600	25,000	14.5	12.0	1,200	7518644
	CHPF3743C6B*+TXV	A*VC81005C*B*	33,400	24,800	14.5	12.0	1,200	7518645
	CHPF3743C6B*+TXV	A*VC960403BNA*	34,200	25,400	14.5	11.5	1,200	7518646
	CHPF3743C6B*+TXV	A*VC960603BNA*	34,400	25,400	14.5	11.5	1,250	7518647
	CHPF3743C6B*+TXV	A*VC960803BNA*	34,400	25,400	14.5	11.5	1,250	7518648
	CHPF3743C6B*+TXV	A*VC960804CNA*	34,600	25,600	14.5	12.0	1,190	7518649
	CHPF3743C6B*+TXV	A*VC961005CNA*	34,600	25,600	14.5	12.0	1,175	7518650
	CHPF3743C6B*+TXV	A*VM970603BNA*	34,400	25,400	14.5	11.5	1,250	7518651
	CHPF3743C6B*+TXV	A*VM970803BNA*	34,400	25,400	14.5	11.5	1,250	7518652
	CHPF3743C6B*+TXV	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518653
	CHPF3743C6B*+TXV	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7518654
	CHPF3743C6B*+TXV	G*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7518655
	CHPF3743C6B*+TXV	G*VC80805C*B*	33,600	25,000	14.5	12.0	1,200	7518656
	CHPF3743C6B*+TXV	G*VC81005C*B*	33,400	24,800	14.5	12.0	1,200	7518657
	CHPF3743C6B*+TXV	G*VC960403BNA*	34,200	25,400	14.5	11.5	1,200	7518658
	CHPF3743C6B*+TXV	G*VC960603BNA*	34,400	25,400	14.5	11.5	1,250	7518659
	CHPF3743C6B*+TXV	G*VC960803BNA*	34,400	25,400	14.5	11.5	1,250	7518660
	CHPF3743C6B*+TXV	G*VC960804CNA*	34,600	25,600	14.5	12.0	1,190	7518661
	CHPF3743C6B*+TXV	G*VC961005CNA*	34,600	25,600	14.5	12.0	1,175	7518662
	CHPF3743C6B*+TXV	G*VM970603BNA*	34,400	25,400	14.5	11.5	1,250	7518663
	CHPF3743C6B*+TXV	G*VM970803BNA*	34,400	25,400	14.5	11.5	1,250	7518664
	CHPF3743C6B*+TXV	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518665
	CHPF3743C6B*+TXV	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7518666
	CHPF3743C6B*+TXV	A*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7518678
	CHPF3743C6B*+TXV	G*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7518679
	CHPF3743D6B*	A*VC961205DNA*	34,600	25,600	14.5	11.5	1,200	7518690
	CHPF3743D6B*	A*VM971205DNA*	34,600	25,600	14.5	11.5	1,200	7518691
	CHPF3743D6B*	G*VC961205DNA*	34,600	25,600	14.5	11.5	1,200	7518692
	CHPF3743D6B*	G*VM971205DNA*	34,600	25,600	14.5	11.5	1,200	7518693
	CHPF3743D6B*	A*EC961205DNA*	34,000	25,200	14.5	11.5	1,075	7518694
	CHPF3743D6B*	G*EC961205DNA*	34,000	25,200	14.5	11.5	1,075	7518695
	CHPF3743D6B*+EEP		34,600	25,600	14.5	11.5	1,150	7518682
	CHPF3743D6B*+EEP+TXV		34,600	25,600	14.5	12.0	1,150	7518683
	CHPF3743D6B*+TXV	A*EC961205DNA*	34,000	25,200	14.5	12.0	1,075	7518684
	CHPF3743D6B*+TXV	A*VC961205DNA*	34,600	25,600	14.5	12.0	1,200	7518685
	CHPF3743D6B*+TXV	A*VM971205DNA*	34,600	25,600	14.5	12.0	1,200	7518686
	CHPF3743D6B*+TXV	G*EC961205DNA*	34,000	25,200	14.5	12.0	1,075	7518687

VSX14
0361A*
(cont.)

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0361A* (cont.)	CHPF3743D6B*+TXV	G*VC961205DNA*	34,600	25,600	14.5	12.0	1,200	7518688
	CHPF3743D6B*+TXV	G*VM971205DNA*	34,600	25,600	14.5	12.0	1,200	7518689
	CSCF4860N6D*	A*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7518728
	CSCF4860N6D*	A*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7518729
	CSCF4860N6D*	A*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7518730
	CSCF4860N6D*	A*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7518731
	CSCF4860N6D*	A*VC961205DNA*	34,600	25,600	14.5	11.5	1,200	7518732
	CSCF4860N6D*	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518733
	CSCF4860N6D*	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7518734
	CSCF4860N6D*	A*VM971205DNA*	34,600	25,600	14.5	11.5	1,200	7518735
	CSCF4860N6D*	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7518736
	CSCF4860N6D*	G*E81005C*B*	34,000	25,200	14.5	11.5	1,230	7518737
	CSCF4860N6D*	G*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7518738
	CSCF4860N6D*	G*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7518739
	CSCF4860N6D*	G*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7518740
	CSCF4860N6D*	G*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7518741
	CSCF4860N6D*	G*VC961205DNA*	34,600	25,600	14.5	11.5	1,200	7518742
	CSCF4860N6D*	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518743
	CSCF4860N6D*	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7518744
	CSCF4860N6D*	G*VM971205DNA*	34,600	25,600	14.5	11.5	1,200	7518745
	CSCF4860N6D*+EEP		34,600	25,600	14.0	11.5	1,200	7518696
	CSCF4860N6D*+EEP+TXV		34,600	25,600	14.0	11.5	1,200	7518697
	CSCF4860N6D*+TXV	A*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7518698
	CSCF4860N6D*+TXV	A*VC80805C*B*	33,600	25,000	14.5	12.0	1,200	7518699
	CSCF4860N6D*+TXV	A*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7518700
	CSCF4860N6D*+TXV	A*VC960403BNA*	34,200	25,400	14.5	11.5	1,200	7518701
	CSCF4860N6D*+TXV	A*VC960603BNA*	34,400	25,400	14.5	11.5	1,250	7518702
	CSCF4860N6D*+TXV	A*VC960803BNA*	34,400	25,400	14.5	11.5	1,250	7518703
	CSCF4860N6D*+TXV	A*VC960804CNA*	34,600	25,600	14.5	12.0	1,190	7518704
	CSCF4860N6D*+TXV	A*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7518705
	CSCF4860N6D*+TXV	A*VC961205DNA*	34,600	25,600	14.5	12.0	1,200	7518706
	CSCF4860N6D*+TXV	A*VM970603BNA*	34,400	25,400	14.5	11.5	1,250	7518707
	CSCF4860N6D*+TXV	A*VM970803BNA*	34,400	25,400	14.5	11.5	1,250	7518708
	CSCF4860N6D*+TXV	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518709
	CSCF4860N6D*+TXV	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7518710
	CSCF4860N6D*+TXV	A*VM971205DNA*	34,600	25,600	14.5	12.0	1,200	7518711
	CSCF4860N6D*+TXV	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7518712
	CSCF4860N6D*+TXV	G*E81005C*B*	34,000	25,200	14.5	12.0	1,230	7518713
	CSCF4860N6D*+TXV	G*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7518714
	CSCF4860N6D*+TXV	G*VC80805C*B*	33,600	25,000	14.5	12.0	1,200	7518715
	CSCF4860N6D*+TXV	G*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7518716
	CSCF4860N6D*+TXV	G*VC960403BNA*	34,200	25,400	14.5	11.5	1,200	7518717
	CSCF4860N6D*+TXV	G*VC960603BNA*	34,400	25,400	14.5	11.5	1,250	7518718
	CSCF4860N6D*+TXV	G*VC960803BNA*	34,400	25,400	14.5	11.5	1,250	7518719
	CSCF4860N6D*+TXV	G*VC960804CNA*	34,600	25,600	14.5	12.0	1,190	7518720
	CSCF4860N6D*+TXV	G*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7518721
	CSCF4860N6D*+TXV	G*VC961205DNA*	34,600	25,600	14.5	12.0	1,200	7518722
	CSCF4860N6D*+TXV	G*VM970603BNA*	34,400	25,400	14.5	11.5	1,250	7518723
CSCF4860N6D*+TXV	G*VM970803BNA*	34,400	25,400	14.5	11.5	1,250	7518724	
CSCF4860N6D*+TXV	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7518725	
CSCF4860N6D*+TXV	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7518726	
CSCF4860N6D*+TXV	G*VM971205DNA*	34,600	25,600	14.5	12.0	1,200	7518727	
CSCF4860N6D*+TXV	G*E80603B*B*	33,400	24,800	14.5	11.5	1,250	7518746	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0371A*	ARUF37C14A*+TXV		33,400	25,200	14.0	12.2	1,050	7984211
	ARUF37D14A*		34,200	25,800	14.0	12.2	1,240	8171728
	ARUF49C14A*		34,000	25,800	14.0	12.2	1,220	7984212
	ASPT36C14A*		34,200	25,800	14.5	12.5	1,210	7518747
	ASPT37C14A*		34,200	25,800	14.5	12.2	1,120	8242108
	ASPT42D14A*		34,200	25,800	15.0	12.5	1,280	7518748
	ASPT47C14A*		34,200	25,800	14.5	12.2	1,120	8242109
	ASPT47D14A*		34,600	26,200	15.0	12.5	1,205	8242110
	AVPTC36C14A*		34,000	25,800	14.5	12.2	1,100	7518749
	AVPTC42D14A*		34,800	26,400	15.0	12.5	1,120	7518750
	AWUF37XX16B*+TXV		33,000	25,000	14.5	12.2	355	7518751
	CA*F3137*6A*	A*VC80604B*B*	33,600	25,400	15.0	12.5	1,220	7520388
	CA*F3137*6A*	A*VC960403BNA*	34,000	25,800	15.0	12.5	1,200	7520389
	CA*F3137*6A*	A*VC960603BNA*	34,000	25,800	15.0	12.5	1,250	7520390
	CA*F3137*6A*	A*VC960803BNA*	34,000	25,800	15.0	12.5	1,250	7520391
	CA*F3137*6A*	A*VM970603BNA*	34,000	25,800	15.0	12.5	1,250	7520392
	CA*F3137*6A*	A*VM970803BNA*	34,000	25,800	15.0	12.5	1,250	7520393
	CA*F3137*6A*	G*E80603B*B*	33,400	25,200	14.5	12.2	1,225	7520394
	CA*F3137*6A*	G*VC80604B*B*	33,600	25,400	15.0	12.5	1,220	7520395
	CA*F3137*6A*	G*VC960403BNA*	34,000	25,800	15.0	12.5	1,200	7520396
	CA*F3137*6A*	G*VC960603BNA*	34,000	25,800	15.0	12.5	1,250	7520397
	CA*F3137*6A*	G*VC960803BNA*	34,000	25,800	15.0	12.5	1,250	7520398
	CA*F3137*6A*	G*VM970603BNA*	34,000	25,800	15.0	12.5	1,250	7520399
	CA*F3137*6A*	G*VM970803BNA*	34,000	25,800	15.0	12.5	1,250	7520400
	CA*F3137*6A*+EEP		34,000	25,800	14.0	12.2	1,200	7518774
	CA*F3137*6A*+EEP+TXV		34,000	25,800	14.0	12.2	1,200	7518775
	CA*F3743*6D*	A*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7518838
	CA*F3743*6D*	A*EC961205DNA*	34,400	26,000	15.0	12.5	1,075	7518839
	CA*F3743*6D*	A*VC80805C*B*	33,600	25,400	14.5	12.2	1,200	7518840
	CA*F3743*6D*	A*VC81005C*B*	33,400	25,200	14.5	12.2	1,200	7518841
	CA*F3743*6D*	A*VC960804CNA*	34,600	26,200	14.5	12.2	1,190	7518842
	CA*F3743*6D*	A*VC961005CNA*	34,600	26,200	14.5	12.2	1,175	7518843
	CA*F3743*6D*	A*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7518844
	CA*F3743*6D*	A*VM970804CNA*	34,600	26,200	14.5	12.2	1,190	7518845
	CA*F3743*6D*	A*VM971005CNA*	34,600	26,200	14.5	12.2	1,175	7518846
	CA*F3743*6D*	A*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7518847
	CA*F3743*6D*	G*E80805C*B*	33,600	25,400	14.5	12.2	1,210	7518848
	CA*F3743*6D*	G*E81005C*B*	34,000	25,800	14.5	12.2	1,200	7518849
	CA*F3743*6D*	G*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7518850
	CA*F3743*6D*	G*EC961205DNA*	34,400	26,000	15.0	12.5	1,075	7518851
	CA*F3743*6D*	G*VC80805C*B*	33,600	25,400	14.5	12.2	1,200	7518852
	CA*F3743*6D*	G*VC81005C*B*	33,400	25,200	14.5	12.2	1,200	7518853
	CA*F3743*6D*	G*VC960804CNA*	34,600	26,200	14.5	12.2	1,190	7518854
	CA*F3743*6D*	G*VC961005CNA*	34,600	26,200	14.5	12.2	1,175	7518855
	CA*F3743*6D*	G*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7518856
	CA*F3743*6D*	G*VM970804CNA*	34,600	26,200	14.5	12.2	1,190	7518857
CA*F3743*6D*	G*VM971005CNA*	34,600	26,200	14.5	12.2	1,175	7518858	
CA*F3743*6D*	G*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7518859	
CA*F3743*6D*+EEP		34,000	25,800	14.0	12.2	1,200	7518797	
CA*F3743*6D*+EEP+TXV		34,000	25,800	14.5	12.2	1,200	7518798	
CA*F3743*6D*+MBVC1600**-1A*		34,600	26,200	14.5	12.2	1,200	7518799	
CA*F3743*6D*+MBVC1600**-1A*+TXV		34,600	26,200	14.5	12.2	1,200	7518800	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0371A* (cont.)	CA*F3743*6D*+MBVC2000**-1A*		34,600	26,200	15.0	12.5	1,200	7518801
	CA*F3743*6D*+MBVC2000**-1A*+TXV		34,600	26,200	15.0	12.5	1,200	7518802
	CA*F3743*6D*+TXV	A*EC961004CNA*	34,600	26,200	15.0	12.5	1,250	7518803
	CA*F3743*6D*+TXV	A*EC961205DNA*	34,400	26,000	15.0	12.5	1,075	7518804
	CA*F3743*6D*+TXV	A*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7518805
	CA*F3743*6D*+TXV	A*VC80805C*B*	33,600	25,400	15.0	12.5	1,200	7518806
	CA*F3743*6D*+TXV	A*VC81005C*B*	33,400	25,200	15.0	12.5	1,200	7518807
	CA*F3743*6D*+TXV	A*VC960403BNA*	34,000	25,800	14.5	12.2	1,200	7518808
	CA*F3743*6D*+TXV	A*VC960603BNA*	34,400	26,000	14.5	12.2	1,250	7518809
	CA*F3743*6D*+TXV	A*VC960803BNA*	34,400	26,000	14.5	12.2	1,250	7518810
	CA*F3743*6D*+TXV	A*VC960804CNA*	34,600	26,200	15.0	12.5	1,190	7518811
	CA*F3743*6D*+TXV	A*VC961005CNA*	34,600	26,200	15.0	12.5	1,175	7518812
	CA*F3743*6D*+TXV	A*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7518813
	CA*F3743*6D*+TXV	A*VM970603BNA*	34,200	25,800	14.5	12.2	1,250	7518814
	CA*F3743*6D*+TXV	A*VM970803BNA*	34,400	26,000	14.5	12.2	1,250	7518815
	CA*F3743*6D*+TXV	A*VM970804CNA*	34,600	26,200	15.0	12.5	1,190	7518816
	CA*F3743*6D*+TXV	A*VM971005CNA*	34,600	26,200	15.0	12.5	1,175	7518817
	CA*F3743*6D*+TXV	A*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7518818
	CA*F3743*6D*+TXV	G*E80603B*B*	33,400	25,200	14.5	12.2	1,225	7518819
	CA*F3743*6D*+TXV	G*E80805C*B*	33,600	25,400	15.0	12.5	1,210	7518820
	CA*F3743*6D*+TXV	G*E81005C*B*	34,000	25,800	15.0	12.5	1,200	7518821
	CA*F3743*6D*+TXV	G*EC961004CNA*	34,600	26,200	15.0	12.5	1,250	7518822
	CA*F3743*6D*+TXV	G*EC961205DNA*	34,400	26,000	15.0	12.5	1,075	7518823
	CA*F3743*6D*+TXV	G*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7518824
	CA*F3743*6D*+TXV	G*VC80805C*B*	33,600	25,400	15.0	12.5	1,200	7518825
	CA*F3743*6D*+TXV	G*VC81005C*B*	33,400	25,200	15.0	12.5	1,200	7518826
	CA*F3743*6D*+TXV	G*VC960403BNA*	34,000	25,800	14.5	12.2	1,200	7518827
	CA*F3743*6D*+TXV	G*VC960603BNA*	34,400	26,000	14.5	12.2	1,250	7518828
	CA*F3743*6D*+TXV	G*VC960803BNA*	34,400	26,000	14.5	12.2	1,250	7518829
	CA*F3743*6D*+TXV	G*VC960804CNA*	34,600	26,200	15.0	12.5	1,190	7518830
	CA*F3743*6D*+TXV	G*VC961005CNA*	34,600	26,200	15.0	12.5	1,175	7518831
	CA*F3743*6D*+TXV	G*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7518832
	CA*F3743*6D*+TXV	G*VM970603BNA*	34,200	25,800	14.5	12.2	1,250	7518833
	CA*F3743*6D*+TXV	G*VM970803BNA*	34,400	26,000	14.5	12.2	1,250	7518834
	CA*F3743*6D*+TXV	G*VM970804CNA*	34,600	26,200	15.0	12.5	1,190	7518835
	CA*F3743*6D*+TXV	G*VM971005CNA*	34,600	26,200	15.0	12.5	1,175	7518836
	CA*F3743*6D*+TXV	G*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7518837
	CAPT3743*4A*	A*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7518863
	CAPT3743*4A*	A*EC961205DNA*	34,400	26,000	15.0	12.5	1,075	7518864
	CAPT3743*4A*	A*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7518865
	CAPT3743*4A*	A*VC80805C*B*	33,600	25,400	15.0	12.2	1,200	7518866
	CAPT3743*4A*	A*VC81005C*B*	33,400	25,200	15.0	12.2	1,200	7518867
CAPT3743*4A*	A*VC960403BNA*	34,000	25,800	14.5	12.2	1,200	7518868	
CAPT3743*4A*	A*VC960603BNA*	34,200	25,800	14.5	12.2	1,250	7518869	
CAPT3743*4A*	A*VC960803BNA*	34,200	25,800	14.5	12.2	1,250	7518870	
CAPT3743*4A*	A*VC960804CNA*	34,600	26,200	15.0	12.2	1,190	7518871	
CAPT3743*4A*	A*VC961005CNA*	34,600	26,200	15.0	12.2	1,175	7518872	
CAPT3743*4A*	A*VC961205DNA*	34,400	26,000	15.0	12.5	1,200	7518873	
CAPT3743*4A*	A*VM970603BNA*	34,200	25,800	14.5	12.2	1,250	7518874	
CAPT3743*4A*	A*VM970803BNA*	34,200	25,800	14.5	12.2	1,250	7518875	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0371A* (cont.)	CAPT3743*4A*	A*VM970804CNA*	34,600	26,200	15.0	12.2	1,190	7518876
	CAPT3743*4A*	A*VM971005CNA*	34,600	26,200	15.0	12.2	1,175	7518877
	CAPT3743*4A*	A*VM971205DNA*	34,400	26,000	15.0	12.5	1,200	7518878
	CAPT3743*4A*	G*E80805C*B*	33,600	25,400	14.5	12.2	1,210	7518879
	CAPT3743*4A*	G*E81005C*B*	34,000	25,800	14.5	12.2	1,200	7518880
	CAPT3743*4A*	G*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7518881
	CAPT3743*4A*	G*EC961205DNA*	34,400	26,000	15.0	12.5	1,075	7518882
	CAPT3743*4A*	G*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7518883
	CAPT3743*4A*	G*VC80805C*B*	33,600	25,400	15.0	12.2	1,200	7518884
	CAPT3743*4A*	G*VC81005C*B*	33,400	25,200	15.0	12.2	1,200	7518885
	CAPT3743*4A*	G*VC960403BNA*	34,000	25,800	14.5	12.2	1,200	7518886
	CAPT3743*4A*	G*VC960603BNA*	34,200	25,800	14.5	12.2	1,250	7518887
	CAPT3743*4A*	G*VC960803BNA*	34,200	25,800	14.5	12.2	1,250	7518888
	CAPT3743*4A*	G*VC960804CNA*	34,600	26,200	15.0	12.2	1,190	7518889
	CAPT3743*4A*	G*VC961005CNA*	34,600	26,200	15.0	12.2	1,175	7518890
	CAPT3743*4A*	G*VC961205DNA*	34,400	26,000	15.0	12.5	1,200	7518891
	CAPT3743*4A*	G*VM970603BNA*	34,200	25,800	14.5	12.2	1,250	7518892
	CAPT3743*4A*	G*VM970803BNA*	34,200	25,800	14.5	12.2	1,250	7518893
	CAPT3743*4A*	G*VM970804CNA*	34,600	26,200	15.0	12.2	1,190	7518894
	CAPT3743*4A*	G*VM971005CNA*	34,600	26,200	15.0	12.2	1,175	7518895
	CAPT3743*4A*	G*VM971205DNA*	34,400	26,000	15.0	12.5	1,200	7518896
	CAPT3743*4A*+EEP		34,000	25,800	14.5	12.2	1,200	7518860
	CAPT3743*4A*+MBVC1600**-1A*		34,200	25,800	14.5	12.2	1,200	7518861
	CAPT3743*4A*+MBVC1600**-1A*+TXV		34,200	25,800	14.5	12.2	1,200	7519543
	CAPT3743*4A*+MBVC2000**-1A*		34,200	25,800	14.5	12.2	1,200	7518862
	CAPT3743*4A*+MBVC2000**-1A*+TXV		34,200	25,800	14.5	12.2	1,200	7519544
	CHPF3642C6C*	G*E80805C*B*	33,600	25,400	14.5	12.2	1,210	7518904
	CHPF3642C6C*	G*E81005C*B*	34,000	25,800	14.5	12.2	1,200	7518905
	CHPF3642C6C*+EEP		34,000	25,800	14.0	12.2	1,150	7518897
	CHPF3642C6C*+EEP+TXV		34,000	25,800	14.0	12.2	1,150	7518898
	CHPF3642C6C*+MBVC1600**-1A*		34,000	25,800	14.5	12.2	1,200	7518899
	CHPF3642C6C*+MBVC1600**-1A*+TXV		34,000	25,800	15.0	12.5	1,200	7518900
	CHPF3642C6C*+TXV	G*E80603B*B*	33,400	25,200	14.5	12.2	1,225	7518901
	CHPF3642C6C*+TXV	G*E80805C*B*	33,600	25,400	15.0	12.5	1,210	7518902
	CHPF3642C6C*+TXV	G*E81005C*B*	34,000	25,800	15.0	12.5	1,200	7518903
	CHPF3743C6B*+MBVC1600**-1A*		34,600	26,200	14.5	12.2	1,200	7518918
	CHPF3743C6B*+MBVC1600**-1A*+TXV		34,600	26,200	15.0	12.5	1,200	7518919
	CHPF3743C6B*+TXV	A*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7518906
	CHPF3743C6B*+TXV	A*VC960403BNA*	34,200	25,800	14.5	12.2	1,200	7518907
	CHPF3743C6B*+TXV	A*VC960603BNA*	34,400	26,000	14.5	12.2	1,250	7518908
	CHPF3743C6B*+TXV	A*VC960803BNA*	34,400	26,000	14.5	12.2	1,250	7518909
	CHPF3743C6B*+TXV	A*VM970603BNA*	34,400	26,000	14.5	12.2	1,250	7518910
CHPF3743C6B*+TXV	A*VM970803BNA*	34,400	26,000	14.5	12.2	1,250	7518911	
CHPF3743C6B*+TXV	G*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7518912	
CHPF3743C6B*+TXV	G*VC960403BNA*	34,200	25,800	14.5	12.2	1,200	7518913	
CHPF3743C6B*+TXV	G*VC960603BNA*	34,400	26,000	14.5	12.2	1,250	7518914	
CHPF3743C6B*+TXV	G*VC960803BNA*	34,400	26,000	14.5	12.2	1,250	7518915	
CHPF3743C6B*+TXV	G*VM970603BNA*	34,400	26,000	14.5	12.2	1,250	7518916	
CHPF3743C6B*+TXV	G*VM970803BNA*	34,400	26,000	14.5	12.2	1,250	7518917	
CHPF3743D6B*	A*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7518944	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #	
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³			
VSX14 0371A* (cont.)	CHPF3743D6B*	A*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7518945	
	CHPF3743D6B*	A*VC80805C*B*	33,600	25,400	14.5	12.2	1,200	7518946	
	CHPF3743D6B*	A*VC81005C*B*	33,400	25,200	14.5	12.2	1,200	7518947	
	CHPF3743D6B*	A*VC960804CNA*	34,600	26,200	14.5	12.2	1,190	7518948	
	CHPF3743D6B*	A*VC961005CNA*	34,600	26,200	14.5	12.2	1,175	7518949	
	CHPF3743D6B*	A*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7518950	
	CHPF3743D6B*	A*VM970804CNA*	34,600	26,200	14.5	12.2	1,190	7518951	
	CHPF3743D6B*	A*VM971005CNA*	34,600	26,200	14.5	12.2	1,175	7518952	
	CHPF3743D6B*	A*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7518953	
	CHPF3743D6B*	G*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7518954	
	CHPF3743D6B*	G*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7518955	
	CHPF3743D6B*	G*VC80805C*B*	33,600	25,400	14.5	12.2	1,200	7518956	
	CHPF3743D6B*	G*VC81005C*B*	33,400	25,200	14.5	12.2	1,200	7518957	
	CHPF3743D6B*	G*VC960804CNA*	34,600	26,200	14.5	12.2	1,190	7518958	
	CHPF3743D6B*	G*VC961005CNA*	34,600	26,200	14.5	12.2	1,175	7518959	
	CHPF3743D6B*	G*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7518960	
	CHPF3743D6B*	G*VM970804CNA*	34,600	26,200	14.5	12.2	1,190	7518961	
	CHPF3743D6B*	G*VM971005CNA*	34,600	26,200	14.5	12.2	1,175	7518962	
	CHPF3743D6B*	G*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7518963	
	CHPF3743D6B*+EEP			34,600	26,200	14.5	12.2	1,150	7518921
	CHPF3743D6B*+EEP+TXV			34,600	26,200	15.0	12.5	1,150	7518922
	CHPF3743D6B*+TXV	A*EC961004CNA*		34,600	26,200	15.0	12.5	1,250	7518924
	CHPF3743D6B*+TXV	A*EC961205DNA*		34,200	25,800	15.0	12.5	1,075	7518925
	CHPF3743D6B*+TXV	A*VC80805C*B*		33,600	25,400	15.0	12.5	1,200	7518926
	CHPF3743D6B*+TXV	A*VC81005C*B*		33,400	25,200	15.0	12.5	1,200	7518927
	CHPF3743D6B*+TXV	A*VC960804CNA*		34,600	26,200	15.0	12.5	1,190	7518928
	CHPF3743D6B*+TXV	A*VC961005CNA*		34,600	26,200	15.0	12.5	1,175	7518929
	CHPF3743D6B*+TXV	A*VC961205DNA*		34,600	26,200	15.0	12.5	1,200	7518930
	CHPF3743D6B*+TXV	A*VM970804CNA*		34,600	26,200	15.0	12.5	1,190	7518931
	CHPF3743D6B*+TXV	A*VM971005CNA*		34,600	26,200	15.0	12.5	1,175	7518932
	CHPF3743D6B*+TXV	A*VM971205DNA*		34,600	26,200	15.0	12.5	1,200	7518933
	CHPF3743D6B*+TXV	G*EC961004CNA*		34,600	26,200	15.0	12.5	1,250	7518934
	CHPF3743D6B*+TXV	G*EC961205DNA*		34,200	25,800	15.0	12.5	1,075	7518935
	CHPF3743D6B*+TXV	G*VC80805C*B*		33,600	25,400	15.0	12.5	1,200	7518936
	CHPF3743D6B*+TXV	G*VC81005C*B*		33,400	25,200	15.0	12.5	1,200	7518937
	CHPF3743D6B*+TXV	G*VC960804CNA*		34,600	26,200	15.0	12.5	1,190	7518938
	CHPF3743D6B*+TXV	G*VC961005CNA*		34,600	26,200	15.0	12.5	1,175	7518939
	CHPF3743D6B*+TXV	G*VC961205DNA*		34,600	26,200	15.0	12.5	1,200	7518940
	CHPF3743D6B*+TXV	G*VM970804CNA*		34,600	26,200	15.0	12.5	1,190	7518941
	CHPF3743D6B*+TXV	G*VM971005CNA*		34,600	26,200	15.0	12.5	1,175	7518942
	CHPF3743D6B*+TXV	G*VM971205DNA*		34,600	26,200	15.0	12.5	1,200	7518943
	CSCF4860N6D*	A*EC961004CNA*		34,600	26,200	14.5	12.2	1,250	7519001
CSCF4860N6D*	A*EC961205DNA*		34,200	25,800	15.0	12.5	1,075	7519002	
CSCF4860N6D*	A*VC80805C*B*		33,600	25,400	14.5	12.2	1,200	7519003	
CSCF4860N6D*	A*VC81005C*B*		33,400	25,200	14.5	12.2	1,200	7519004	
CSCF4860N6D*	A*VC960804CNA*		34,600	26,200	14.5	12.2	1,190	7519005	
CSCF4860N6D*	A*VC961005CNA*		34,600	26,200	14.5	12.2	1,175	7519006	
CSCF4860N6D*	A*VC961205DNA*		34,600	26,200	15.0	12.5	1,200	7519007	
CSCF4860N6D*	A*VM970804CNA*		34,600	26,200	14.5	12.2	1,190	7519008	
CSCF4860N6D*	A*VM971005CNA*		34,600	26,200	14.5	12.2	1,175	7519009	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0371A* (cont.)	CSCF4860N6D*	A*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7519010
	CSCF4860N6D*	G*E80805C*B*	33,600	25,400	14.5	12.2	1,210	7519011
	CSCF4860N6D*	G*E81005C*B*	34,000	25,800	14.5	12.2	1,200	7519012
	CSCF4860N6D*	G*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7519013
	CSCF4860N6D*	G*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7519014
	CSCF4860N6D*	G*VC80805C*B*	33,600	25,400	14.5	12.2	1,200	7519015
	CSCF4860N6D*	G*VC81005C*B*	33,400	25,200	14.5	12.2	1,200	7519016
	CSCF4860N6D*	G*VC960804CNA*	34,600	26,200	14.5	12.2	1,190	7519017
	CSCF4860N6D*	G*VC961005CNA*	34,600	26,200	14.5	12.2	1,175	7519018
	CSCF4860N6D*	G*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7519019
	CSCF4860N6D*	G*VM970804CNA*	34,600	26,200	14.5	12.2	1,190	7519020
	CSCF4860N6D*	G*VM971005CNA*	34,600	26,200	14.5	12.2	1,175	7519021
	CSCF4860N6D*	G*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7519022
	CSCF4860N6D*+EEP		34,600	26,200	14.0	12.2	1,200	7518964
	CSCF4860N6D*+EEP+TXV		34,600	26,200	14.5	12.2	1,200	7518965
	CSCF4860N6D*+TXV	A*EC961004CNA*	34,600	26,200	15.0	12.5	1,250	7518966
	CSCF4860N6D*+TXV	A*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7518967
	CSCF4860N6D*+TXV	A*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7518968
	CSCF4860N6D*+TXV	A*VC80805C*B*	33,600	25,400	15.0	12.5	1,200	7518969
	CSCF4860N6D*+TXV	A*VC81005C*B*	33,400	25,200	15.0	12.5	1,200	7518970
	CSCF4860N6D*+TXV	A*VC960403BNA*	34,200	25,800	14.5	12.2	1,200	7518971
	CSCF4860N6D*+TXV	A*VC960603BNA*	34,400	26,000	14.5	12.2	1,250	7518972
	CSCF4860N6D*+TXV	A*VC960803BNA*	34,400	26,000	14.5	12.2	1,250	7518973
	CSCF4860N6D*+TXV	A*VC960804CNA*	34,600	26,200	15.0	12.5	1,190	7518974
	CSCF4860N6D*+TXV	A*VC961005CNA*	34,600	26,200	15.0	12.5	1,175	7518975
	CSCF4860N6D*+TXV	A*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7518976
	CSCF4860N6D*+TXV	A*VM970603BNA*	34,400	26,000	14.5	12.2	1,250	7518977
	CSCF4860N6D*+TXV	A*VM970803BNA*	34,400	26,000	14.5	12.2	1,250	7518978
	CSCF4860N6D*+TXV	A*VM970804CNA*	34,600	26,200	15.0	12.5	1,190	7518979
	CSCF4860N6D*+TXV	A*VM971005CNA*	34,600	26,200	15.0	12.5	1,175	7518980
	CSCF4860N6D*+TXV	A*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7518981
	CSCF4860N6D*+TXV	G*E80603B*B*	33,400	25,200	14.5	12.2	1,225	7518982
	CSCF4860N6D*+TXV	G*E80805C*B*	33,600	25,400	15.0	12.5	1,210	7518983
	CSCF4860N6D*+TXV	G*E81005C*B*	34,000	25,800	15.0	12.5	1,200	7518984
	CSCF4860N6D*+TXV	G*EC961004CNA*	34,600	26,200	15.0	12.5	1,250	7518985
	CSCF4860N6D*+TXV	G*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7518986
	CSCF4860N6D*+TXV	G*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7518987
	CSCF4860N6D*+TXV	G*VC80805C*B*	33,600	25,400	15.0	12.5	1,200	7518988
	CSCF4860N6D*+TXV	G*VC81005C*B*	33,400	25,200	15.0	12.5	1,200	7518989
	CSCF4860N6D*+TXV	G*VC960403BNA*	34,200	25,800	14.5	12.2	1,200	7518990
	CSCF4860N6D*+TXV	G*VC960603BNA*	34,400	26,000	14.5	12.2	1,250	7518991
	CSCF4860N6D*+TXV	G*VC960803BNA*	34,400	26,000	14.5	12.2	1,250	7518992
CSCF4860N6D*+TXV	G*VC960804CNA*	34,600	26,200	15.0	12.5	1,190	7518993	
CSCF4860N6D*+TXV	G*VC961005CNA*	34,600	26,200	15.0	12.5	1,175	7518994	
CSCF4860N6D*+TXV	G*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7518995	
CSCF4860N6D*+TXV	G*VM970603BNA*	34,400	26,000	14.5	12.2	1,250	7518996	
CSCF4860N6D*+TXV	G*VM970803BNA*	34,400	26,000	14.5	12.2	1,250	7518997	
CSCF4860N6D*+TXV	G*VM970804CNA*	34,600	26,200	15.0	12.5	1,190	7518998	
CSCF4860N6D*+TXV	G*VM971005CNA*	34,600	26,200	15.0	12.5	1,175	7518999	
CSCF4860N6D*+TXV	G*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7519000	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0421A*	ARUF43D14A*		37,400	29,600	14.0	11.5	1,270	8171729
	ARUF43D14A*+TXV		37,600	29,800	14.0	11.5	1,270	8171730
	ARUF47D14A*		37,600	29,800	14.0	11.5	1,375	7984213
	ASPT47D14A*		38,000	30,000	14.5	12.2	1,250	8242120
	ASPT48D14A*		38,000	30,000	15.0	12.5	1,385	7519023
	ASPT49D14A*		39,000	30,800	14.5	12.2	1,425	8242111
	ASPT59C14A*		38,000	30,000	14.0	12.0	1,260	8242112
	ASPT60D14A*		38,000	30,000	15.0	12.5	1,385	7519024
	AVPTC48D14A*		38,000	30,000	15.0	12.5	1,310	7519025
	CA*F4860*6D*	A*EC961004CNA*	38,000	30,000	14.0	11.5	1,275	7519049
	CA*F4860*6D*	A*EC961205DNA*	38,000	30,000	14.0	11.5	1,400	7519050
	CA*F4860*6D*	A*VC80805C*B*	38,000	30,000	14.0	11.5	1,400	7519051
	CA*F4860*6D*	A*VC81005C*B*	38,000	30,000	14.0	11.5	1,370	7519052
	CA*F4860*6D*	A*VC960804CNA*	38,000	30,000	14.0	11.5	1,385	7519053
	CA*F4860*6D*	A*VC961005CNA*	38,000	30,000	14.0	11.5	1,300	7519054
	CA*F4860*6D*	A*VM971005CNA*	38,000	30,000	14.0	11.5	1,300	7519055
	CA*F4860*6D*	A*VM971205DNA*	38,000	30,000	14.0	11.5	1,300	7519056
	CA*F4860*6D*	G*E80805C*B*	38,000	30,000	14.0	11.5	1,425	7519057
	CA*F4860*6D*	G*E80805D*A*	38,000	30,000	14.0	11.5	1,425	7519058
	CA*F4860*6D*	G*E81005C*B*	38,000	30,000	14.0	11.5	1,425	7519059
	CA*F4860*6D*	G*EC961004CNA*	38,000	30,000	14.0	11.5	1,275	7519060
	CA*F4860*6D*	G*EC961205DNA*	38,000	30,000	14.0	11.5	1,400	7519061
	CA*F4860*6D*	G*VC80805C*B*	38,000	30,000	14.0	11.5	1,400	7519062
	CA*F4860*6D*	G*VC81005C*B*	38,000	30,000	14.0	11.5	1,370	7519063
	CA*F4860*6D*	G*VC960804CNA*	38,000	30,000	14.0	11.5	1,385	7519064
	CA*F4860*6D*	G*VC961005CNA*	38,000	30,000	14.0	11.5	1,300	7519065
	CA*F4860*6D*	G*VM971005CNA*	38,000	30,000	14.0	11.5	1,300	7519066
	CA*F4860*6D*	G*VM971205DNA*	38,000	30,000	14.0	11.5	1,300	7519067
	CA*F4860*6D*	A*VC961205DNA*	38,000	30,000	14.0	11.5	1,425	7520405
	CA*F4860*6D*	A*VM970804CNA*	38,000	30,000	14.0	11.5	1,425	7520406
	CA*F4860*6D*	G*VC961205DNA*	38,000	30,000	14.0	11.5	1,425	7520407
	CA*F4860*6D*	G*VM970804CNA*	38,000	30,000	14.0	11.5	1,425	7520408
	CA*F4860*6D*+EEP		38,000	30,000	14.0	11.5	1,400	7519026
	CA*F4860*6D*+EEP+TXV		38,000	30,000	14.0	11.5	1,400	7519027
	CA*F4860*6D*+MBVC1600**-1A*		38,000	30,000	14.5	11.5	1,300	7519028
	CA*F4860*6D*+MBVC2000**-1A*		38,000	30,000	14.5	11.5	1,300	7519029
	CA*F4860*6D*+TXV	A*EC961004CNA*	38,000	30,000	14.5	11.5	1,275	7519030
	CA*F4860*6D*+TXV	A*EC961205DNA*	38,000	30,000	14.5	11.5	1,400	7519031
	CA*F4860*6D*+TXV	A*VC80805C*B*	38,000	30,000	14.5	11.5	1,400	7519032
	CA*F4860*6D*+TXV	A*VC81005C*B*	38,000	30,000	14.5	11.5	1,370	7519033
	CA*F4860*6D*+TXV	A*VC960804CNA*	38,000	30,000	14.5	11.5	1,385	7519034
	CA*F4860*6D*+TXV	A*VC961005CNA*	38,000	30,000	14.5	11.5	1,300	7519035
CA*F4860*6D*+TXV	A*VM971005CNA*	38,000	30,000	14.5	11.5	1,300	7519036	
CA*F4860*6D*+TXV	A*VM971205DNA*	38,000	30,000	14.5	11.5	1,300	7519037	
CA*F4860*6D*+TXV	G*E80805C*B*	38,000	30,000	14.5	11.5	1,425	7519038	
CA*F4860*6D*+TXV	G*E80805D*A*	38,000	30,000	14.5	11.5	1,425	7519039	
CA*F4860*6D*+TXV	G*E81005C*B*	38,000	30,000	14.5	11.5	1,425	7519040	
CA*F4860*6D*+TXV	G*EC961004CNA*	38,000	30,000	14.5	11.5	1,275	7519041	
CA*F4860*6D*+TXV	G*EC961205DNA*	38,000	30,000	14.5	11.5	1,400	7519042	
CA*F4860*6D*+TXV	G*VC80805C*B*	38,000	30,000	14.5	11.5	1,400	7519043	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0421A* (cont.)	CA*F4860*6D*+TXV	G*VC81005C*B*	38,000	30,000	14.5	11.5	1,370	7519044
	CA*F4860*6D*+TXV	G*VC960804CNA*	38,000	30,000	14.5	11.5	1,385	7519045
	CA*F4860*6D*+TXV	G*VC961005CNA*	38,000	30,000	14.5	11.5	1,300	7519046
	CA*F4860*6D*+TXV	G*VM971005CNA*	38,000	30,000	14.5	11.5	1,300	7519047
	CA*F4860*6D*+TXV	G*VM971205DNA*	38,000	30,000	14.5	11.5	1,300	7519048
	CA*F4860*6D*+TXV	A*VC961205DNA*	38,000	30,000	14.5	11.5	1,425	7520401
	CA*F4860*6D*+TXV	A*VM970804CNA*	38,000	30,000	14.5	11.5	1,425	7520402
	CA*F4860*6D*+TXV	G*VC961205DNA*	38,000	30,000	14.5	11.5	1,425	7520403
	CA*F4860*6D*+TXV	G*VM970804CNA*	38,000	30,000	14.5	11.5	1,425	7520404
	CA*F4961*6D*	A*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	7519095
	CA*F4961*6D*	A*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	7519096
	CA*F4961*6D*	A*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	7519097
	CA*F4961*6D*	A*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	7519098
	CA*F4961*6D*	A*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	7519099
	CA*F4961*6D*	A*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	7519100
	CA*F4961*6D*	A*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	7519101
	CA*F4961*6D*	A*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	7519102
	CA*F4961*6D*	A*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	7519103
	CA*F4961*6D*	A*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	7519104
	CA*F4961*6D*	G*E80805C*B*	39,000	30,800	14.5	12.2	1,425	7519105
	CA*F4961*6D*	G*E80805D*A*	39,000	30,800	14.5	12.2	1,425	7519106
	CA*F4961*6D*	G*E81005C*B*	39,000	30,800	14.5	12.2	1,425	7519107
	CA*F4961*6D*	G*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	7519108
	CA*F4961*6D*	G*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	7519109
	CA*F4961*6D*	G*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	7519110
	CA*F4961*6D*	G*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	7519111
	CA*F4961*6D*	G*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	7519112
	CA*F4961*6D*	G*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	7519113
	CA*F4961*6D*	G*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	7519114
	CA*F4961*6D*	G*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	7519115
	CA*F4961*6D*	G*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	7519116
	CA*F4961*6D*	G*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	7519117
	CA*F4961*6D*+EEP		39,000	30,800	14.0	12.2	1,400	7519068
	CA*F4961*6D*+EEP+TXV		39,000	30,800	14.0	12.2	1,400	7519069
	CA*F4961*6D*+MBVC1600**-1A*		39,000	30,800	14.5	12.2	1,300	7519070
	CA*F4961*6D*+MBVC2000**-1A*		39,000	30,800	14.5	12.2	1,300	7519071
	CA*F4961*6D*+TXV	A*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	7519072
	CA*F4961*6D*+TXV	A*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	7519073
	CA*F4961*6D*+TXV	A*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	7519074
	CA*F4961*6D*+TXV	A*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	7519075
	CA*F4961*6D*+TXV	A*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	7519076
	CA*F4961*6D*+TXV	A*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	7519077
CA*F4961*6D*+TXV	A*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	7519078	
CA*F4961*6D*+TXV	A*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	7519079	
CA*F4961*6D*+TXV	A*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	7519080	
CA*F4961*6D*+TXV	A*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	7519081	
CA*F4961*6D*+TXV	G*E80805C*B*	39,000	30,800	14.5	12.2	1,425	7519082	
CA*F4961*6D*+TXV	G*E80805D*A*	39,000	30,800	14.5	12.2	1,425	7519083	
CA*F4961*6D*+TXV	G*E81005C*B*	39,000	30,800	14.5	12.2	1,425	7519084	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0421A* (cont.)	CA*F4961*6D*+TXV	G*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	7519085
	CA*F4961*6D*+TXV	G*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	7519086
	CA*F4961*6D*+TXV	G*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	7519087
	CA*F4961*6D*+TXV	G*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	7519088
	CA*F4961*6D*+TXV	G*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	7519089
	CA*F4961*6D*+TXV	G*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	7519090
	CA*F4961*6D*+TXV	G*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	7519091
	CA*F4961*6D*+TXV	G*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	7519092
	CA*F4961*6D*+TXV	G*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	7519093
	CA*F4961*6D*+TXV	G*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	7519094
	CAPT4961*4A*	A*VC80805C*B*	39,000	30,800	14.5	11.5	1,425	7519121
	CAPT4961*4A*	A*VC81005C*B*	39,000	30,800	14.5	11.5	1,370	7519122
	CAPT4961*4A*	A*VC960804CNA*	39,000	30,800	14.5	11.5	1,385	7519123
	CAPT4961*4A*	A*VC961005CNA*	39,000	30,800	14.5	11.5	1,300	7519124
	CAPT4961*4A*	A*VC961205DNA*	39,000	30,800	14.5	11.5	1,450	7519125
	CAPT4961*4A*	A*VM970804CNA*	39,000	30,800	14.5	11.5	1,430	7519126
	CAPT4961*4A*	A*VM971005CNA*	39,000	30,800	14.5	11.5	1,300	7519127
	CAPT4961*4A*	A*VM971205DNA*	39,000	30,800	14.5	11.5	1,300	7519128
	CAPT4961*4A*	G*E80805C*B*	39,000	30,800	14.5	11.5	1,425	7519129
	CAPT4961*4A*	G*E81005C*B*	39,000	30,800	14.5	11.5	1,425	7519130
	CAPT4961*4A*	G*VC80805C*B*	39,000	30,800	14.5	11.5	1,425	7519131
	CAPT4961*4A*	G*VC81005C*B*	39,000	30,800	14.5	11.5	1,370	7519132
	CAPT4961*4A*	G*VC960804CNA*	39,000	30,800	14.5	11.5	1,385	7519133
	CAPT4961*4A*	G*VC961005CNA*	39,000	30,800	14.5	11.5	1,300	7519134
	CAPT4961*4A*	G*VC961205DNA*	39,000	30,800	14.5	11.5	1,450	7519135
	CAPT4961*4A*	G*VM970804CNA*	39,000	30,800	14.5	11.5	1,430	7519136
	CAPT4961*4A*	G*VM971005CNA*	39,000	30,800	14.5	11.5	1,300	7519137
	CAPT4961*4A*	G*VM971205DNA*	39,000	30,800	14.5	11.5	1,300	7519138
	CAPT4961*4A*+EEP		39,000	30,800	14.0	11.5	1,275	7519118
	CAPT4961*4A*+MBVC1600**-1A*		39,000	30,800	14.5	12.2	1,300	7519119
	CAPT4961*4A*+MBVC2000**-1A*		39,000	30,800	14.5	12.2	1,300	7519120
	CHPF4860D6D*	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7519160
	CHPF4860D6D*	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7519161
	CHPF4860D6D*	A*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	7519162
	CHPF4860D6D*	A*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	7519163
	CHPF4860D6D*	A*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	7519164
	CHPF4860D6D*	A*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	7519165
	CHPF4860D6D*	A*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	7519166
	CHPF4860D6D*	A*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	7519167
	CHPF4860D6D*	G*E80805C*B*	38,000	30,000	14.5	12.2	1,425	7519168
	CHPF4860D6D*	G*E80805D*A*	38,000	30,000	14.5	12.2	1,425	7519169
	CHPF4860D6D*	G*E81005C*B*	38,000	30,000	14.5	12.2	1,425	7519170
CHPF4860D6D*	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7519171	
CHPF4860D6D*	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7519172	
CHPF4860D6D*	G*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	7519173	
CHPF4860D6D*	G*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	7519174	
CHPF4860D6D*	G*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	7519175	
CHPF4860D6D*	G*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	7519176	
CHPF4860D6D*	G*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	7519177	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0421A* (cont.)	CHPF4860D6D*	G*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	7519178
	CHPF4860D6D*	A*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	7520415
	CHPF4860D6D*	A*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	7520416
	CHPF4860D6D*	G*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	7520417
	CHPF4860D6D*	G*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	7520418
	CHPF4860D6D*+EEP		38,000	30,000	14.0	12.0	1,425	7520409
	CHPF4860D6D*+EEP+TXV		38,000	30,000	14.0	12.2	1,425	7520410
	CHPF4860D6D*+MBVC1600**-1A*		38,000	30,000	14.5	12.2	1,400	7519139
	CHPF4860D6D*+MBVC2000**-1A*		38,000	30,000	14.5	12.2	1,400	7519140
	CHPF4860D6D*+TXV	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7519141
	CHPF4860D6D*+TXV	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7519142
	CHPF4860D6D*+TXV	A*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	7519143
	CHPF4860D6D*+TXV	A*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	7519144
	CHPF4860D6D*+TXV	A*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	7519145
	CHPF4860D6D*+TXV	A*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	7519146
	CHPF4860D6D*+TXV	A*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	7519147
	CHPF4860D6D*+TXV	A*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	7519148
	CHPF4860D6D*+TXV	G*E80805C*B*	38,000	30,000	14.5	12.2	1,425	7519149
	CHPF4860D6D*+TXV	G*E80805D*A*	38,000	30,000	14.5	12.2	1,425	7519150
	CHPF4860D6D*+TXV	G*E81005C*B*	38,000	30,000	14.5	12.2	1,425	7519151
	CHPF4860D6D*+TXV	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7519152
	CHPF4860D6D*+TXV	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7519153
	CHPF4860D6D*+TXV	G*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	7519154
	CHPF4860D6D*+TXV	G*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	7519155
	CHPF4860D6D*+TXV	G*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	7519156
	CHPF4860D6D*+TXV	G*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	7519157
	CHPF4860D6D*+TXV	G*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	7519158
	CHPF4860D6D*+TXV	G*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	7519159
	CHPF4860D6D*+TXV	A*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	7520411
	CHPF4860D6D*+TXV	A*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	7520412
	CHPF4860D6D*+TXV	G*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	7520413
	CHPF4860D6D*+TXV	G*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	7520414
	CSCF4860N6D*	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7519198
	CSCF4860N6D*	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7519199
	CSCF4860N6D*	A*VC80805C*B*	38,000	30,000	14.5	11.5	1,400	7519200
	CSCF4860N6D*	A*VC81005C*B*	38,000	30,000	14.5	11.5	1,370	7519201
	CSCF4860N6D*	A*VC960804CNA*	38,000	30,000	14.5	11.5	1,385	7519202
	CSCF4860N6D*	A*VC961005CNA*	38,000	30,000	14.5	11.5	1,300	7519203
	CSCF4860N6D*	A*VM971005CNA*	38,000	30,000	14.5	11.5	1,300	7519204
	CSCF4860N6D*	A*VM971205DNA*	38,000	30,000	14.5	11.5	1,300	7519205
CSCF4860N6D*	G*E80805C*B*	38,000	30,000	14.5	11.5	1,425	7519206	
CSCF4860N6D*	G*E80805D*A*	38,000	30,000	14.5	11.5	1,425	7519207	
CSCF4860N6D*	G*E81005C*B*	38,000	30,000	14.5	11.5	1,425	7519208	
CSCF4860N6D*	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7519209	
CSCF4860N6D*	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7519210	
CSCF4860N6D*	G*VC80805C*B*	38,000	30,000	14.5	11.5	1,400	7519211	
CSCF4860N6D*	G*VC81005C*B*	38,000	30,000	14.5	11.5	1,370	7519212	
CSCF4860N6D*	G*VC960804CNA*	38,000	30,000	14.5	11.5	1,385	7519213	
CSCF4860N6D*	G*VC961005CNA*	38,000	30,000	14.5	11.5	1,300	7519214	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0421A* (cont.)	CSCF4860N6D*	G*VM971005CNA*	38,000	30,000	14.5	11.5	1,300	7519215
	CSCF4860N6D*	G*VM971205DNA*	38,000	30,000	14.5	11.5	1,300	7519216
	CSCF4860N6D*	A*VC961205DNA*	38,000	30,000	14.5	11.5	1,425	7520425
	CSCF4860N6D*	A*VM970804CNA*	38,000	30,000	14.5	11.5	1,425	7520426
	CSCF4860N6D*	G*VC961205DNA*	38,000	30,000	14.5	11.5	1,425	7520427
	CSCF4860N6D*	G*VM970804CNA*	38,000	30,000	14.5	11.5	1,425	7520428
	CSCF4860N6D*+EEP		38,000	30,000	14.0	11.5	1,425	7520419
	CSCF4860N6D*+EEP+TXV		38,000	30,000	14.0	11.5	1,425	7520420
	CSCF4860N6D*+TXV	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7519179
	CSCF4860N6D*+TXV	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7519180
	CSCF4860N6D*+TXV	A*VC80805C*B*	38,000	30,000	14.5	11.5	1,400	7519181
	CSCF4860N6D*+TXV	A*VC81005C*B*	38,000	30,000	14.5	11.5	1,370	7519182
	CSCF4860N6D*+TXV	A*VC960804CNA*	38,000	30,000	14.5	11.5	1,385	7519183
	CSCF4860N6D*+TXV	A*VC961005CNA*	38,000	30,000	14.5	11.5	1,300	7519184
	CSCF4860N6D*+TXV	A*VM971005CNA*	38,000	30,000	14.5	11.5	1,300	7519185
	CSCF4860N6D*+TXV	A*VM971205DNA*	38,000	30,000	14.5	11.5	1,300	7519186
	CSCF4860N6D*+TXV	G*E80805C*B*	38,000	30,000	14.5	11.5	1,425	7519187
	CSCF4860N6D*+TXV	G*E80805D*A*	38,000	30,000	14.5	11.5	1,425	7519188
	CSCF4860N6D*+TXV	G*E81005C*B*	38,000	30,000	14.5	11.5	1,425	7519189
	CSCF4860N6D*+TXV	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7519190
	CSCF4860N6D*+TXV	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7519191
	CSCF4860N6D*+TXV	G*VC80805C*B*	38,000	30,000	14.5	11.5	1,400	7519192
	CSCF4860N6D*+TXV	G*VC81005C*B*	38,000	30,000	14.5	11.5	1,370	7519193
	CSCF4860N6D*+TXV	G*VC960804CNA*	38,000	30,000	14.5	11.5	1,385	7519194
	CSCF4860N6D*+TXV	G*VC961005CNA*	38,000	30,000	14.5	11.5	1,300	7519195
	CSCF4860N6D*+TXV	G*VM971005CNA*	38,000	30,000	14.5	11.5	1,300	7519196
	CSCF4860N6D*+TXV	G*VM971205DNA*	38,000	30,000	14.5	11.5	1,300	7519197
	CSCF4860N6D*+TXV	A*VC961205DNA*	38,000	30,000	14.5	11.5	1,425	7520421
CSCF4860N6D*+TXV	A*VM970804CNA*	38,000	30,000	14.5	11.5	1,425	7520422	
CSCF4860N6D*+TXV	G*VC961205DNA*	38,000	30,000	14.5	11.5	1,425	7520423	
CSCF4860N6D*+TXV	G*VM970804CNA*	38,000	30,000	14.5	11.5	1,425	7520424	
VSX14 0431A*	ASPT47D14A*		38,000	30,000	14.5	12.2	1,250	8242121
	ASPT48D14A*		38,000	30,000	15.0	12.5	1,385	8082510
	ASPT49D14A*		39,000	30,800	14.5	12.2	1,425	8242114
	ASPT59C14A*		38,000	30,000	14.0	12.0	1,260	8242113
	ASPT60D14A*		38,000	30,000	15.0	12.5	1,385	8082511
	AVPTC48D14A*		38,000	30,000	15.0	12.5	1,310	8082512
	CA*F4961*6D*	G*E80805C*B*	39,000	30,800	14.5	12.2	1,425	8082522
	CA*F4961*6D*	G*E80805D*A*	39,000	30,800	14.5	12.2	1,425	8082526
	CA*F4961*6D*	G*E81005C*B*	39,000	30,800	14.5	12.2	1,425	8082530
	CA*F4961*6D*	G*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	8082534
	CA*F4961*6D*	G*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	8082538
	CA*F4961*6D*	A*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	8082542
	CA*F4961*6D*	A*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	8082546
	CA*F4961*6D*	G*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	8082550
	CA*F4961*6D*	G*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	8082554
	CA*F4961*6D*	G*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	8082558
	CA*F4961*6D*	A*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	8082562
	CA*F4961*6D*	A*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	8082566

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0431A* (cont.)	CA*F4961*6D*	A*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	8082570
	CA*F4961*6D*	G*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	8082574
	CA*F4961*6D*	G*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	8082578
	CA*F4961*6D*	G*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	8082582
	CA*F4961*6D*	A*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	8082586
	CA*F4961*6D*	A*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	8082590
	CA*F4961*6D*	A*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	8082594
	CA*F4961*6D*	G*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	8082598
	CA*F4961*6D*	G*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	8082604
	CA*F4961*6D*	A*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	8082610
	CA*F4961*6D*	A*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	8082616
	CA*F4961*6D*+EEP		39,000	30,800	14.0	12.2	1,400	8082513
	CA*F4961*6D*+EEP+TXV		39,000	30,800	14.0	12.2	1,400	8082514
	CA*F4961*6D*+MBVC1600**-1A*		39,000	30,800	14.5	12.2	1,300	8082515
	CA*F4961*6D*+MBVC2000**-1A*		39,000	30,800	14.5	12.2	1,300	8082516
	CA*F4961*6D*+TXV	G*E80805C*B*	39,000	30,800	14.5	12.2	1,425	8082523
	CA*F4961*6D*+TXV	G*E80805D*A*	39,000	30,800	14.5	12.2	1,425	8082527
	CA*F4961*6D*+TXV	G*E81005C*B*	39,000	30,800	14.5	12.2	1,425	8082531
	CA*F4961*6D*+TXV	G*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	8082535
	CA*F4961*6D*+TXV	G*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	8082539
	CA*F4961*6D*+TXV	A*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	8082543
	CA*F4961*6D*+TXV	A*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	8082547
	CA*F4961*6D*+TXV	G*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	8082551
	CA*F4961*6D*+TXV	G*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	8082555
	CA*F4961*6D*+TXV	G*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	8082559
	CA*F4961*6D*+TXV	A*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	8082563
	CA*F4961*6D*+TXV	A*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	8082567
	CA*F4961*6D*+TXV	A*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	8082571
	CA*F4961*6D*+TXV	G*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	8082575
	CA*F4961*6D*+TXV	G*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	8082579
	CA*F4961*6D*+TXV	G*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	8082583
	CA*F4961*6D*+TXV	A*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	8082587
	CA*F4961*6D*+TXV	A*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	8082591
	CA*F4961*6D*+TXV	A*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	8082595
	CA*F4961*6D*+TXV	G*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	8082599
	CA*F4961*6D*+TXV	G*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	8082605
	CA*F4961*6D*+TXV	A*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	8082611
	CA*F4961*6D*+TXV	A*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	8082617
	CAPT4961*4A*+MBVC1600**-1A*		39,000	30,800	14.5	12.2	1,300	8082517
	CAPT4961*4A*+MBVC2000**-1A*		39,000	30,800	14.5	12.2	1,300	8082518
	CHPF4860D6D*	G*E80805C*B*	38,000	30,000	14.5	12.2	1,425	8082524
	CHPF4860D6D*	G*E80805D*A*	38,000	30,000	14.5	12.2	1,425	8082528
	CHPF4860D6D*	G*E81005C*B*	38,000	30,000	14.5	12.2	1,425	8082532
	CHPF4860D6D*	G*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	8082536
	CHPF4860D6D*	G*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	8082540
	CHPF4860D6D*	A*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	8082544
	CHPF4860D6D*	A*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	8082548
	CHPF4860D6D*	G*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	8082552
CHPF4860D6D*	G*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	8082556	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #	
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³			
VSX14 0431A* (cont.)	CHPF4860D6D*	G*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	8082560	
	CHPF4860D6D*	A*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	8082564	
	CHPF4860D6D*	A*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	8082568	
	CHPF4860D6D*	A*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	8082572	
	CHPF4860D6D*	G*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	8082576	
	CHPF4860D6D*	G*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	8082580	
	CHPF4860D6D*	G*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	8082584	
	CHPF4860D6D*	A*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	8082588	
	CHPF4860D6D*	A*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	8082592	
	CHPF4860D6D*	A*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	8082596	
	CHPF4860D6D*	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	8082600	
	CHPF4860D6D*	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	8082606	
	CHPF4860D6D*	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	8082612	
	CHPF4860D6D*	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	8082618	
	CHPF4860D6D*+EEP+TXV			38,000	30,000	14.0	12.2	1,425	8082519
	CHPF4860D6D*+MBVC1600**-1A*			38,000	30,000	14.5	12.2	1,400	8082520
	CHPF4860D6D*+MBVC2000**-1A*			38,000	30,000	14.5	12.2	1,400	8082521
	CHPF4860D6D*+TXV	G*E80805C*B*		38,000	30,000	14.5	12.2	1,425	8082525
	CHPF4860D6D*+TXV	G*E80805D*A*		38,000	30,000	14.5	12.2	1,425	8082529
	CHPF4860D6D*+TXV	G*E81005C*B*		38,000	30,000	14.5	12.2	1,425	8082533
	CHPF4860D6D*+TXV	G*VC80805C*B*		38,000	30,000	14.5	12.2	1,400	8082537
	CHPF4860D6D*+TXV	G*VC81005C*B*		38,000	30,000	14.5	12.2	1,370	8082541
	CHPF4860D6D*+TXV	A*VC80805C*B*		38,000	30,000	14.5	12.2	1,400	8082545
	CHPF4860D6D*+TXV	A*VC81005C*B*		38,000	30,000	14.5	12.2	1,370	8082549
	CHPF4860D6D*+TXV	G*VC960804CNA*		38,000	30,000	14.5	12.2	1,385	8082553
	CHPF4860D6D*+TXV	G*VC961005CNA*		38,000	30,000	14.5	12.2	1,300	8082557
	CHPF4860D6D*+TXV	G*VC961205DNA*		38,000	30,000	14.5	12.2	1,425	8082561
	CHPF4860D6D*+TXV	A*VC960804CNA*		38,000	30,000	14.5	12.2	1,385	8082565
	CHPF4860D6D*+TXV	A*VC961005CNA*		38,000	30,000	14.5	12.2	1,300	8082569
	CHPF4860D6D*+TXV	A*VC961205DNA*		38,000	30,000	14.5	12.2	1,425	8082573
	CHPF4860D6D*+TXV	G*VM970804CNA*		38,000	30,000	14.5	12.2	1,425	8082577
	CHPF4860D6D*+TXV	G*VM971005CNA*		38,000	30,000	14.5	12.2	1,300	8082581
	CHPF4860D6D*+TXV	G*VM971205DNA*		38,000	30,000	14.5	12.2	1,300	8082585
	CHPF4860D6D*+TXV	A*VM970804CNA*		38,000	30,000	14.5	12.2	1,425	8082589
	CHPF4860D6D*+TXV	A*VM971005CNA*		38,000	30,000	14.5	12.2	1,300	8082593
	CHPF4860D6D*+TXV	A*VM971205DNA*		38,000	30,000	14.5	12.2	1,300	8082597
	CHPF4860D6D*+TXV	G*EC961004CNA*		38,000	30,000	14.5	12.2	1,275	8082601
	CHPF4860D6D*+TXV	G*EC961205DNA*		38,000	30,000	14.5	12.2	1,400	8082607
	CHPF4860D6D*+TXV	A*EC961004CNA*		38,000	30,000	14.5	12.2	1,275	8082613
	CHPF4860D6D*+TXV	A*EC961205DNA*		38,000	30,000	14.5	12.2	1,400	8082619
	CSCF4860N6D*	G*EC961004CNA*		38,000	30,000	14.5	12.2	1,275	8082602
	CSCF4860N6D*	G*EC961205DNA*		38,000	30,000	14.5	12.2	1,400	8082608
CSCF4860N6D*	A*EC961004CNA*		38,000	30,000	14.5	12.2	1,275	8082614	
CSCF4860N6D*	A*EC961205DNA*		38,000	30,000	14.5	12.2	1,400	8082620	
CSCF4860N6D*+TXV	G*EC961004CNA*		38,000	30,000	14.5	12.2	1,275	8082603	
CSCF4860N6D*+TXV	G*EC961205DNA*		38,000	30,000	14.5	12.2	1,400	8082609	
CSCF4860N6D*+TXV	A*EC961004CNA*		38,000	30,000	14.5	12.2	1,275	8082615	
CSCF4860N6D*+TXV	A*EC961205DNA*		38,000	30,000	14.5	12.2	1,400	8082621	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0481A*	ARUF61D14A*		45,500	32,200	14.0	11.7	1,520	7984214
	ASPT48D14A*		46,000	32,600	14.5	11.7	1,600	7519217
	ASPT59C14A*		45,500	32,200	14.0	12.0	1,430	8242115
	ASPT60D14A*		46,000	32,600	14.5	11.7	1,600	7519218
	ASPT61D14A*		47,000	33,200	14.5	12.2	1,630	8242116
	AVPTC48D14A*		46,000	32,600	14.5	11.7	1,550	7519219
	AVPTC60D14A*		46,000	32,600	14.5	11.7	1,590	7519220
	CA*F4860*6D*	A*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7519246
	CA*F4860*6D*	A*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7519247
	CA*F4860*6D*	A*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7519248
	CA*F4860*6D*	A*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7519249
	CA*F4860*6D*	A*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7519250
	CA*F4860*6D*	A*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7519251
	CA*F4860*6D*	G*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7519252
	CA*F4860*6D*	G*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7519253
	CA*F4860*6D*	G*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7519254
	CA*F4860*6D*	G*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7519255
	CA*F4860*6D*	G*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7519256
	CA*F4860*6D*	G*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7519257
	CA*F4860*6D*+EEP		45,500	32,200	14.0	11.7	1,550	7519221
	CA*F4860*6D*+EEP+TXV		45,500	32,200	14.0	11.7	1,550	7519222
	CA*F4860*6D*+MBVC2000**-1A*+TXV		46,000	32,600	14.5	12.0	1,600	7519223
	CA*F4860*6D*+TXV	A*EC961004CNA*	45,000	31,800	14.5	11.7	1,525	7519224
	CA*F4860*6D*+TXV	A*EC961205DNA*	45,000	31,800	14.5	12.0	1,525	7519225
	CA*F4860*6D*+TXV	A*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7519226
	CA*F4860*6D*+TXV	A*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7519227
	CA*F4860*6D*+TXV	A*VC960804CNA*	45,000	31,800	14.5	12.0	1,385	7519228
	CA*F4860*6D*+TXV	A*VC961005CNA*	45,500	32,200	14.5	12.0	1,450	7519229
	CA*F4860*6D*+TXV	A*VC961205DNA*	45,500	32,200	14.5	12.0	1,450	7519230
	CA*F4860*6D*+TXV	A*VM970804CNA*	45,000	31,800	14.5	12.0	1,385	7519231
	CA*F4860*6D*+TXV	A*VM971005CNA*	45,500	32,200	14.5	12.0	1,450	7519232
	CA*F4860*6D*+TXV	A*VM971205DNA*	45,500	32,200	14.5	12.0	1,450	7519233
	CA*F4860*6D*+TXV	G*E80805C*B*	45,000	31,800	14.5	11.7	1,480	7519234
	CA*F4860*6D*+TXV	G*E81005C*B*	45,500	32,200	14.5	11.7	1,570	7519235
	CA*F4860*6D*+TXV	G*EC961004CNA*	45,000	31,800	14.5	11.7	1,525	7519236
	CA*F4860*6D*+TXV	G*EC961205DNA*	45,000	31,800	14.5	12.0	1,525	7519237
	CA*F4860*6D*+TXV	G*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7519238
	CA*F4860*6D*+TXV	G*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7519239
	CA*F4860*6D*+TXV	G*VC960804CNA*	45,000	31,800	14.5	12.0	1,385	7519240
	CA*F4860*6D*+TXV	G*VC961005CNA*	45,500	32,200	14.5	12.0	1,450	7519241
	CA*F4860*6D*+TXV	G*VC961205DNA*	45,500	32,200	14.5	12.0	1,450	7519242
	CA*F4860*6D*+TXV	G*VM970804CNA*	45,000	31,800	14.5	12.0	1,385	7519243
CA*F4860*6D*+TXV	G*VM971005CNA*	45,500	32,200	14.5	12.0	1,450	7519244	
CA*F4860*6D*+TXV	G*VM971205DNA*	45,500	32,200	14.5	12.0	1,450	7519245	
CA*F4961*6D*+EEP		46,000	32,600	14.0	11.7	1,550	7519258	
CA*F4961*6D*+EEP+TXV		46,000	32,600	14.0	11.7	1,550	7519259	
CA*F4961*6D*+MBVC2000**-1A*+TXV		46,000	32,600	14.5	12.0	1,600	7519260	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #	
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³			
VSX14 0481A* (cont.)	CAPT4961*4A*	A*EC961004CNA*	45,000	31,800	14.5	11.7	1,525	7519262	
	CAPT4961*4A*	A*EC961205DNA*	45,000	31,800	14.5	12.0	1,525	7519263	
	CAPT4961*4A*	A*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7519264	
	CAPT4961*4A*	A*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7519265	
	CAPT4961*4A*	A*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7519266	
	CAPT4961*4A*	A*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7519267	
	CAPT4961*4A*	A*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7519268	
	CAPT4961*4A*	A*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7519269	
	CAPT4961*4A*	A*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7519270	
	CAPT4961*4A*	A*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7519271	
	CAPT4961*4A*	G*E80805C*B*	45,000	31,800	14.5	11.7	1,480	7519272	
	CAPT4961*4A*	G*E81005C*B*	45,500	32,200	14.5	11.7	1,570	7519273	
	CAPT4961*4A*	G*EC961004CNA*	45,000	31,800	14.5	11.7	1,525	7519274	
	CAPT4961*4A*	G*EC961205DNA*	45,000	31,800	14.5	12.0	1,525	7519275	
	CAPT4961*4A*	G*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7519276	
	CAPT4961*4A*	G*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7519277	
	CAPT4961*4A*	G*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7519278	
	CAPT4961*4A*	G*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7519279	
	CAPT4961*4A*	G*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7519280	
	CAPT4961*4A*	G*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7519281	
	CAPT4961*4A*	G*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7519282	
	CAPT4961*4A*	G*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7519283	
	CAPT4961*4A*+EEP			46,000	32,600	14.0	11.7	1,550	7519261
	CAPT4961*4A*+MBVC2000**-1A*			45,000	31,800	14.5	11.7	1,595	7519284
	CHPF4860D6D*	A*VC960804CNA*		45,000	31,800	14.5	11.7	1,385	7519310
	CHPF4860D6D*	A*VC961005CNA*		45,500	32,200	14.5	11.7	1,450	7519311
	CHPF4860D6D*	A*VC961205DNA*		45,500	32,200	14.5	11.7	1,450	7519312
	CHPF4860D6D*	A*VM970804CNA*		45,000	31,800	14.5	11.7	1,385	7519313
	CHPF4860D6D*	A*VM971005CNA*		45,500	32,200	14.5	11.7	1,450	7519314
	CHPF4860D6D*	A*VM971205DNA*		45,500	32,200	14.5	11.7	1,450	7519315
	CHPF4860D6D*	G*VC960804CNA*		45,000	31,800	14.5	11.7	1,385	7519316
	CHPF4860D6D*	G*VC961005CNA*		45,500	32,200	14.5	11.7	1,450	7519317
	CHPF4860D6D*	G*VC961205DNA*		45,500	32,200	14.5	11.7	1,450	7519318
	CHPF4860D6D*	G*VM970804CNA*		45,000	31,800	14.5	11.7	1,385	7519319
	CHPF4860D6D*	G*VM971005CNA*		45,500	32,200	14.5	11.7	1,450	7519320
	CHPF4860D6D*	G*VM971205DNA*		45,500	32,200	14.5	11.7	1,450	7519321
	CHPF4860D6D*+EEP			46,000	32,600	14.0	11.7	1,550	7519285
	CHPF4860D6D*+EEP+TXV			46,000	32,600	14.0	11.7	1,550	7519286
	CHPF4860D6D*+MBVC2000**-1A*+TXV			46,000	32,600	14.5	12.0	1,600	7519287
	CHPF4860D6D*+TXV	A*EC961004CNA*		45,000	31,800	14.5	11.7	1,525	7519288
CHPF4860D6D*+TXV	A*EC961205DNA*		45,000	31,800	14.5	12.0	1,525	7519289	
CHPF4860D6D*+TXV	A*VC80805C*B*		45,500	32,200	14.5	11.7	1,510	7519290	
CHPF4860D6D*+TXV	A*VC81005C*B*		45,500	32,200	14.5	11.7	1,530	7519291	
CHPF4860D6D*+TXV	A*VC960804CNA*		45,000	31,800	14.5	12.0	1,385	7519292	
CHPF4860D6D*+TXV	A*VC961005CNA*		45,500	32,200	14.5	12.0	1,450	7519293	
CHPF4860D6D*+TXV	A*VC961205DNA*		45,500	32,200	14.5	12.0	1,450	7519294	
CHPF4860D6D*+TXV	A*VM970804CNA*		45,000	31,800	14.5	12.0	1,385	7519295	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0481A* (cont.)	CHPF4860D6D*+TXV	A*VM971005CNA*	45,500	32,200	14.5	12.0	1,450	7519296
	CHPF4860D6D*+TXV	A*VM971205DNA*	45,500	32,200	14.5	12.0	1,450	7519297
	CHPF4860D6D*+TXV	G*E80805C*B*	45,000	31,800	14.5	11.7	1,480	7519298
	CHPF4860D6D*+TXV	G*E81005C*B*	45,500	32,200	14.5	11.7	1,570	7519299
	CHPF4860D6D*+TXV	G*EC961004CNA*	45,000	31,800	14.5	11.7	1,525	7519300
	CHPF4860D6D*+TXV	G*EC961205DNA*	45,000	31,800	14.5	12.0	1,525	7519301
	CHPF4860D6D*+TXV	G*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7519302
	CHPF4860D6D*+TXV	G*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7519303
	CHPF4860D6D*+TXV	G*VC960804CNA*	45,000	31,800	14.5	12.0	1,385	7519304
	CHPF4860D6D*+TXV	G*VC961005CNA*	45,500	32,200	14.5	12.0	1,450	7519305
	CHPF4860D6D*+TXV	G*VC961205DNA*	45,500	32,200	14.5	12.0	1,450	7519306
	CHPF4860D6D*+TXV	G*VM970804CNA*	45,000	31,800	14.5	12.0	1,385	7519307
	CHPF4860D6D*+TXV	G*VM971005CNA*	45,500	32,200	14.5	12.0	1,450	7519308
	CHPF4860D6D*+TXV	G*VM971205DNA*	45,500	32,200	14.5	12.0	1,450	7519309
	CSCF4860N6D*	A*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7519342
	CSCF4860N6D*	A*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7519343
	CSCF4860N6D*	A*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7519344
	CSCF4860N6D*	A*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7519345
	CSCF4860N6D*	A*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7519346
	CSCF4860N6D*	A*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7519347
	CSCF4860N6D*	G*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7519348
	CSCF4860N6D*	G*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7519349
	CSCF4860N6D*	G*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7519350
	CSCF4860N6D*	G*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7519351
	CSCF4860N6D*	G*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7519352
	CSCF4860N6D*	G*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7519353
	CSCF4860N6D*+EEP		45,500	32,200	14.0	11.7	1,550	7519322
	CSCF4860N6D*+EEP+TXV		45,500	32,200	14.0	11.7	1,550	7519323
	CSCF4860N6D*+TXV	A*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7519324
	CSCF4860N6D*+TXV	A*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7519325
	CSCF4860N6D*+TXV	A*VC960804CNA*	45,000	31,800	14.5	12.0	1,385	7519326
	CSCF4860N6D*+TXV	A*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7519327
	CSCF4860N6D*+TXV	A*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7519328
	CSCF4860N6D*+TXV	A*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7519329
	CSCF4860N6D*+TXV	A*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7519330
	CSCF4860N6D*+TXV	A*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7519331
	CSCF4860N6D*+TXV	G*E80805C*B*	45,000	31,800	14.5	11.7	1,480	7519332
	CSCF4860N6D*+TXV	G*E81005C*B*	45,000	31,800	14.5	11.7	1,570	7519333
	CSCF4860N6D*+TXV	G*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7519334
	CSCF4860N6D*+TXV	G*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7519335
	CSCF4860N6D*+TXV	G*VC960804CNA*	45,000	31,800	14.5	12.0	1,385	7519336
	CSCF4860N6D*+TXV	G*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7519337
CSCF4860N6D*+TXV	G*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7519338	
CSCF4860N6D*+TXV	G*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7519339	
CSCF4860N6D*+TXV	G*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7519340	
CSCF4860N6D*+TXV	G*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7519341	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0601A*	ASPT60D14A*		57,000	40,000	14.0	11.7	1,620	7519354
	ASPT61D14A*		57,000	40,000	14.0	11.7	1,645	7984221
	AVPTC60D14A*		57,000	40,000	14.0	11.7	1,620	7519355
	CA*F4961*6D*	A*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7519375
	CA*F4961*6D*	A*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7519376
	CA*F4961*6D*	G*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7519377
	CA*F4961*6D*	G*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7519378
	CA*F4961*6D*+EEP+TXV		57,000	40,000	14.0	11.7	1,545	7519356
	CA*F4961*6D*+MBVC2000**-1A*+TXV		57,000	40,000	14.5	12.0	1,620	7519357
	CA*F4961*6D*+TXV	A*EC961205DNA*	57,000	40,000	14.0	11.7	1,525	7519358
	CA*F4961*6D*+TXV	A*VC80805C*B*	57,000	40,000	14.5	11.7	1,560	7519359
	CA*F4961*6D*+TXV	A*VC81005C*B*	57,000	40,000	14.5	11.7	1,525	7519360
	CA*F4961*6D*+TXV	A*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7519361
	CA*F4961*6D*+TXV	A*VC961205DNA*	57,000	40,000	14.5	12.0	1,575	7519362
	CA*F4961*6D*+TXV	A*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7519363
	CA*F4961*6D*+TXV	A*VM971205DNA*	57,000	40,000	14.5	12.0	1,575	7519364
	CA*F4961*6D*+TXV	G*E80805C*B*	57,000	40,000	14.5	11.7	1,525	7519365
	CA*F4961*6D*+TXV	G*E80805D*A*	57,000	40,000	14.5	12.0	1,500	7519366
	CA*F4961*6D*+TXV	G*E81005C*B*	57,000	40,000	14.5	11.7	1,600	7519367
	CA*F4961*6D*+TXV	G*EC961205DNA*	57,000	40,000	14.0	11.7	1,525	7519368
	CA*F4961*6D*+TXV	G*VC80805C*B*	57,000	40,000	14.5	11.7	1,560	7519369
	CA*F4961*6D*+TXV	G*VC81005C*B*	57,000	40,000	14.5	11.7	1,525	7519370
	CA*F4961*6D*+TXV	G*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7519371
	CA*F4961*6D*+TXV	G*VC961205DNA*	57,000	40,000	14.5	12.0	1,575	7519372
	CA*F4961*6D*+TXV	G*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7519373
	CA*F4961*6D*+TXV	G*VM971205DNA*	57,000	40,000	14.5	12.0	1,575	7519374
	CAPT4961*4A*	A*VC80805C*B*	57,000	40,000	14.0	11.7	1,560	7519380
	CAPT4961*4A*	A*VC81005C*B*	57,000	40,000	14.0	11.7	1,525	7519381
	CAPT4961*4A*	G*E80805C*B*	57,000	40,000	14.0	11.7	1,525	7519382
	CAPT4961*4A*	G*E80805D*A*	57,000	40,000	14.0	12.0	1,500	7519383
	CAPT4961*4A*	G*E81005C*B*	57,000	40,000	14.0	11.7	1,600	7519384
	CAPT4961*4A*	G*VC80805C*B*	57,000	40,000	14.0	11.7	1,560	7519385
	CAPT4961*4A*	G*VC81005C*B*	57,000	40,000	14.0	11.7	1,525	7519386
	CAPT4961*4A*	A*EC961205DNA*	56,500	40,000	14.0	11.7	1,525	7519387
	CAPT4961*4A*	A*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7519388
	CAPT4961*4A*	A*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7519389
	CAPT4961*4A*	A*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7519390
	CAPT4961*4A*	A*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7519391
	CAPT4961*4A*	G*EC961205DNA*	56,500	40,000	14.0	11.7	1,525	7519392
	CAPT4961*4A*	G*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7519393
	CAPT4961*4A*	G*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7519394
	CAPT4961*4A*	G*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7519395
	CAPT4961*4A*	G*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7519396
	CAPT4961*4A*+EEP		57,000	40,000	14.0	11.7	1,545	7519379
	CHPF4860D6D*	A*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7519416
	CHPF4860D6D*	A*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7519417
	CHPF4860D6D*	G*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7519418
	CHPF4860D6D*	G*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7519419
CHPF4860D6D*+EEP+TXV		57,000	40,000	14.0	11.7	1,545	7519397	
CHPF4860D6D*+MBVC2000**-1A*+TXV		57,000	40,000	14.5	12.0	1,620	7519398	

See Notes on Page 72.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
VSX14 0601A* (cont.)	CHPF4860D6D*+TXV	A*EC961205DNA*	57,000	40,000	14.0	11.7	1,525	7519399
	CHPF4860D6D*+TXV	A*VC80805C*B*	57,000	40,000	14.5	11.7	1,560	7519400
	CHPF4860D6D*+TXV	A*VC81005C*B*	57,000	40,000	14.5	11.7	1,525	7519401
	CHPF4860D6D*+TXV	A*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7519402
	CHPF4860D6D*+TXV	A*VC961205DNA*	57,000	40,000	14.5	12.0	1,575	7519403
	CHPF4860D6D*+TXV	A*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7519404
	CHPF4860D6D*+TXV	A*VM971205DNA*	57,000	40,000	14.5	12.0	1,575	7519405
	CHPF4860D6D*+TXV	G*E80805C*B*	57,000	40,000	14.5	11.7	1,525	7519406
	CHPF4860D6D*+TXV	G*E80805D*A*	57,000	40,000	14.5	12.0	1,500	7519407
	CHPF4860D6D*+TXV	G*E81005C*B*	57,000	40,000	14.5	11.7	1,600	7519408
	CHPF4860D6D*+TXV	G*EC961205DNA*	57,000	40,000	14.0	11.7	1,525	7519409
	CHPF4860D6D*+TXV	G*VC80805C*B*	57,000	40,000	14.5	11.7	1,560	7519410
	CHPF4860D6D*+TXV	G*VC81005C*B*	57,000	40,000	14.5	11.7	1,525	7519411
	CHPF4860D6D*+TXV	G*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7519412
	CHPF4860D6D*+TXV	G*VC961205DNA*	57,000	40,000	14.5	12.0	1,575	7519413
	CHPF4860D6D*+TXV	G*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7519414
	CHPF4860D6D*+TXV	G*VM971205DNA*	57,000	40,000	14.5	12.0	1,575	7519415
	CSCF4860N6D*	A*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7519439
	CSCF4860N6D*	A*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7519440
	CSCF4860N6D*	G*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7519441
	CSCF4860N6D*	G*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7519442
	CSCF4860N6D*+EEP+TXV		57,000	40,000	14.0	11.7	1,545	7519420
	CSCF4860N6D*+MBVC2000**-1A*+TXV		57,000	40,000	14.5	12.0	1,620	7519421
	CSCF4860N6D*+TXV	A*EC961205DNA*	57,000	40,000	14.0	11.7	1,525	7519422
	CSCF4860N6D*+TXV	A*VC80805C*B*	57,000	40,000	14.5	11.7	1,560	7519423
	CSCF4860N6D*+TXV	A*VC81005C*B*	57,000	40,000	14.5	11.7	1,525	7519424
	CSCF4860N6D*+TXV	A*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7519425
	CSCF4860N6D*+TXV	A*VC961205DNA*	57,000	40,000	14.5	12.0	1,575	7519426
	CSCF4860N6D*+TXV	A*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7519427
	CSCF4860N6D*+TXV	A*VM971205DNA*	57,000	40,000	14.5	12.0	1,575	7519428
	CSCF4860N6D*+TXV	G*E80805C*B*	57,000	40,000	14.5	11.7	1,525	7519429
	CSCF4860N6D*+TXV	G*E80805D*A*	57,000	40,000	14.5	12.0	1,500	7519430
	CSCF4860N6D*+TXV	G*E81005C*B*	57,000	40,000	14.5	11.7	1,600	7519431
	CSCF4860N6D*+TXV	G*EC961205DNA*	57,000	40,000	14.0	11.7	1,525	7519432
	CSCF4860N6D*+TXV	G*VC80805C*B*	57,000	40,000	14.5	11.7	1,560	7519433
	CSCF4860N6D*+TXV	G*VC81005C*B*	57,000	40,000	14.5	11.7	1,525	7519434
CSCF4860N6D*+TXV	G*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7519435	
CSCF4860N6D*+TXV	G*VC961205DNA*	57,000	40,000	14.5	12.0	1,575	7519436	
CSCF4860N6D*+TXV	G*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7519437	
CSCF4860N6D*+TXV	G*VM971205DNA*	57,000	40,000	14.5	12.0	1,575	7519438	


¹ BTU/h

² Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F

³ Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- When matching the outdoor unit to the indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The GMC brand gas furnace contains the EEP cooling time delay.

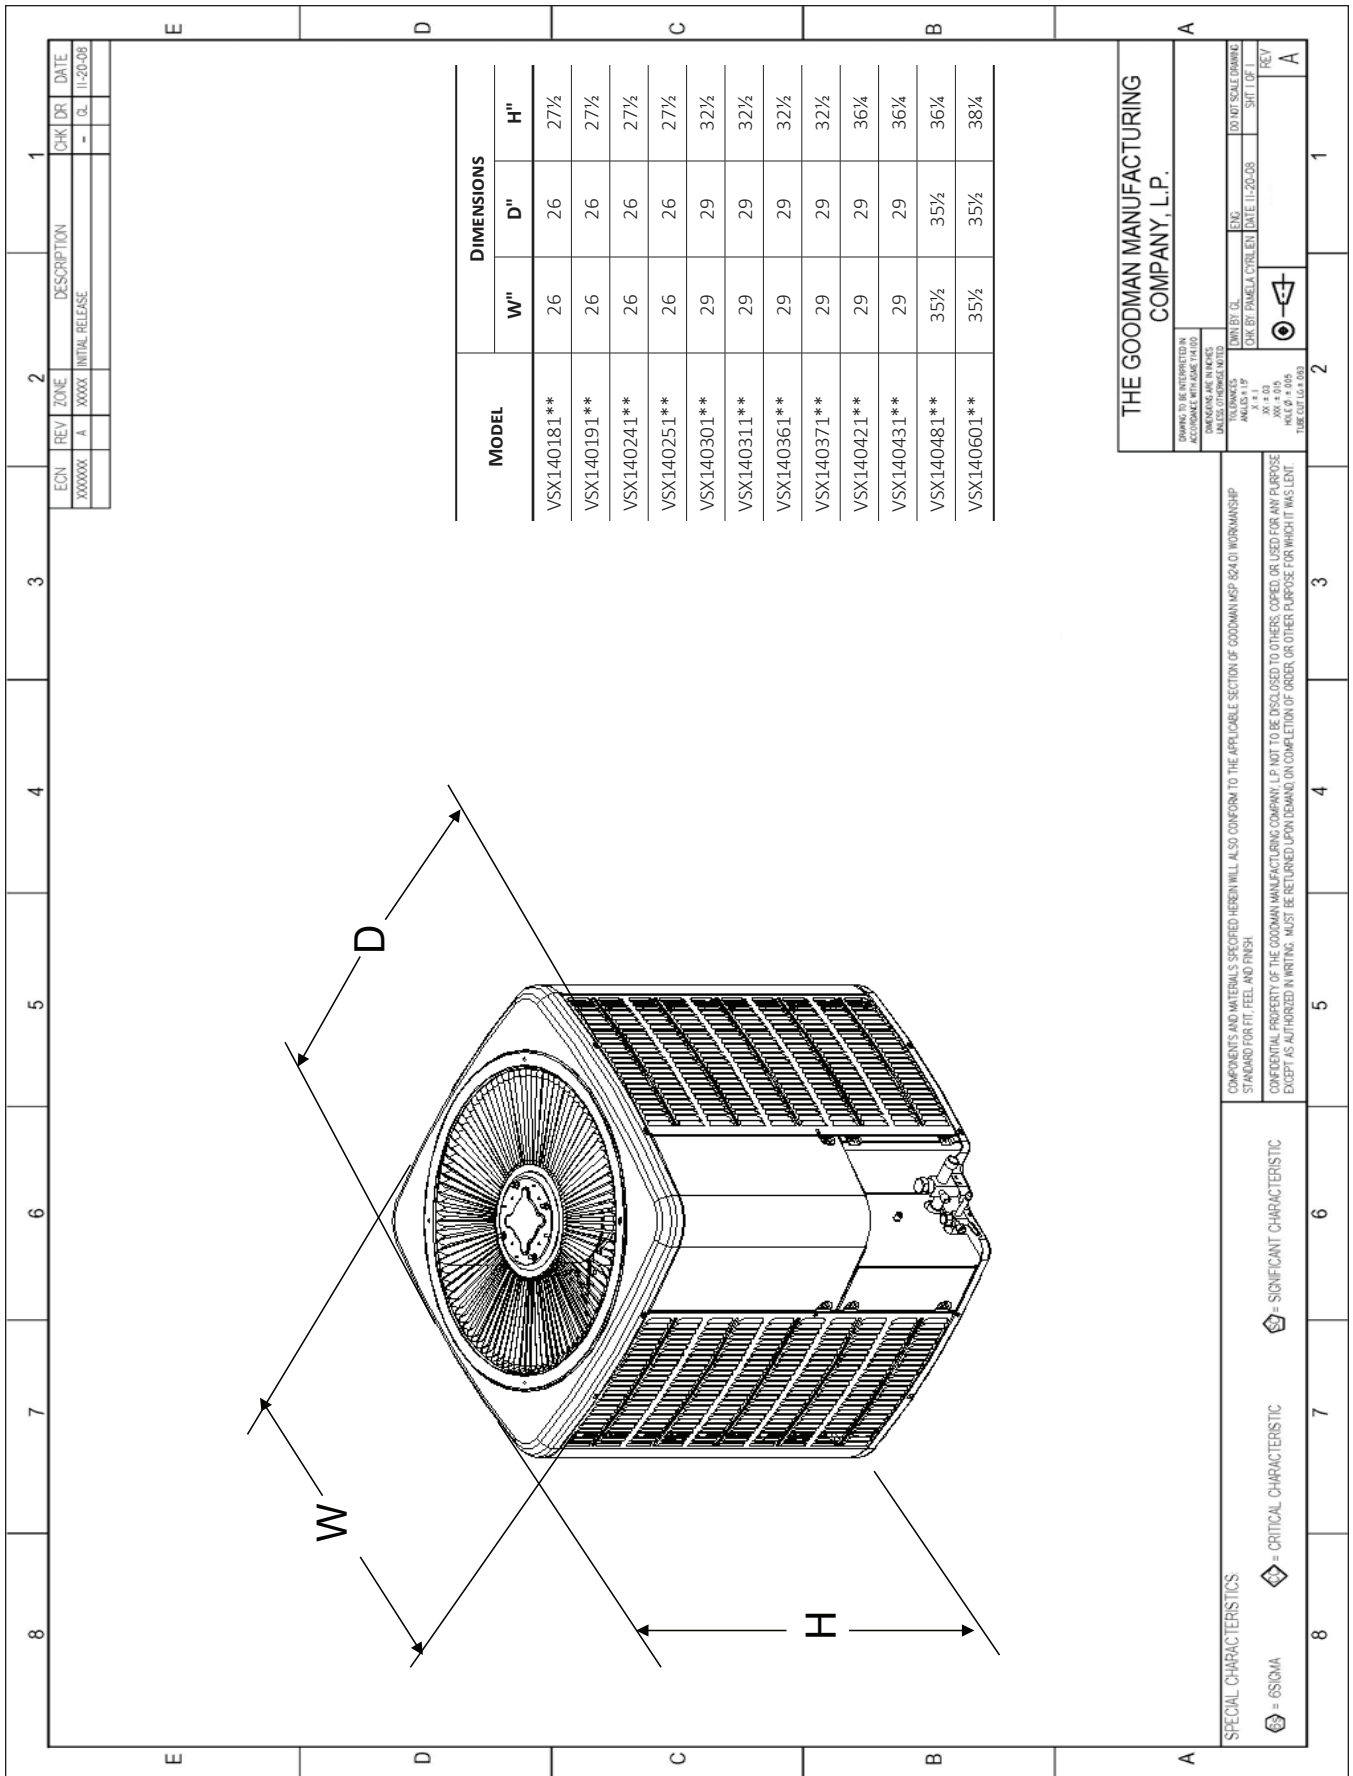

MODEL	DIMENSIONS	
	W"	H"
VSX140181**	26	27%
VSX140191**	26	27%
VSX140241**	26	27%
VSX140251**	26	27%
VSX140301**	29	32%
VSX140311**	29	32%
VSX140361**	29	32%
VSX140371**	29	32%
VSX140421**	29	36%
VSX140431**	29	36%
VSX140481**	35%	36%
VSX140601**	35%	38%

ECON	REV	ZONE	DESCRIPTION	CHK	DR	DATE
XXXXXX	A	XXXXX	INITIAL RELEASE	-	CL	11-20-09

THE GOODMAN MANUFACTURING COMPANY, L.P.

DRAWING TO BE INTERPRETED IN ACCORDANCE WITH ASME Y14.5 DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED

DESIGNED BY: FRANKLIN CHILLEN
 DRAWN BY: FRANKLIN CHILLEN
 DATE: 11-20-09

SCALE: AS SHOWN
 SHEET 1 OF 1


REV A

COMPONENTS AND MATERIALS SPECIFIED HEREIN WILL ALSO CONFORM TO THE APPLICABLE SECTION OF GOODMAN MSP 824(1) WORKMANSHIP STANDARD FOR FIT, FEEL AND FINISH.


CONFIDENTIAL PROPERTY OF THE GOODMAN MANUFACTURING COMPANY, L.P. NOT TO BE DISCLOSED TO OTHERS, COPIED, OR USED FOR ANY PURPOSE EXCEPT AS AUTHORIZED IN WRITING. MUST BE RETURNED UPON DEMAND, ON COMPLETION OF ORDER, OR OTHER PURPOSE FOR WHICH IT WAS LENT.

SPECIAL CHARACTERISTICS

⊕ = 6SIGMA ⊕ = CRITICAL CHARACTERISTIC ⊕ = SIGNIFICANT CHARACTERISTIC

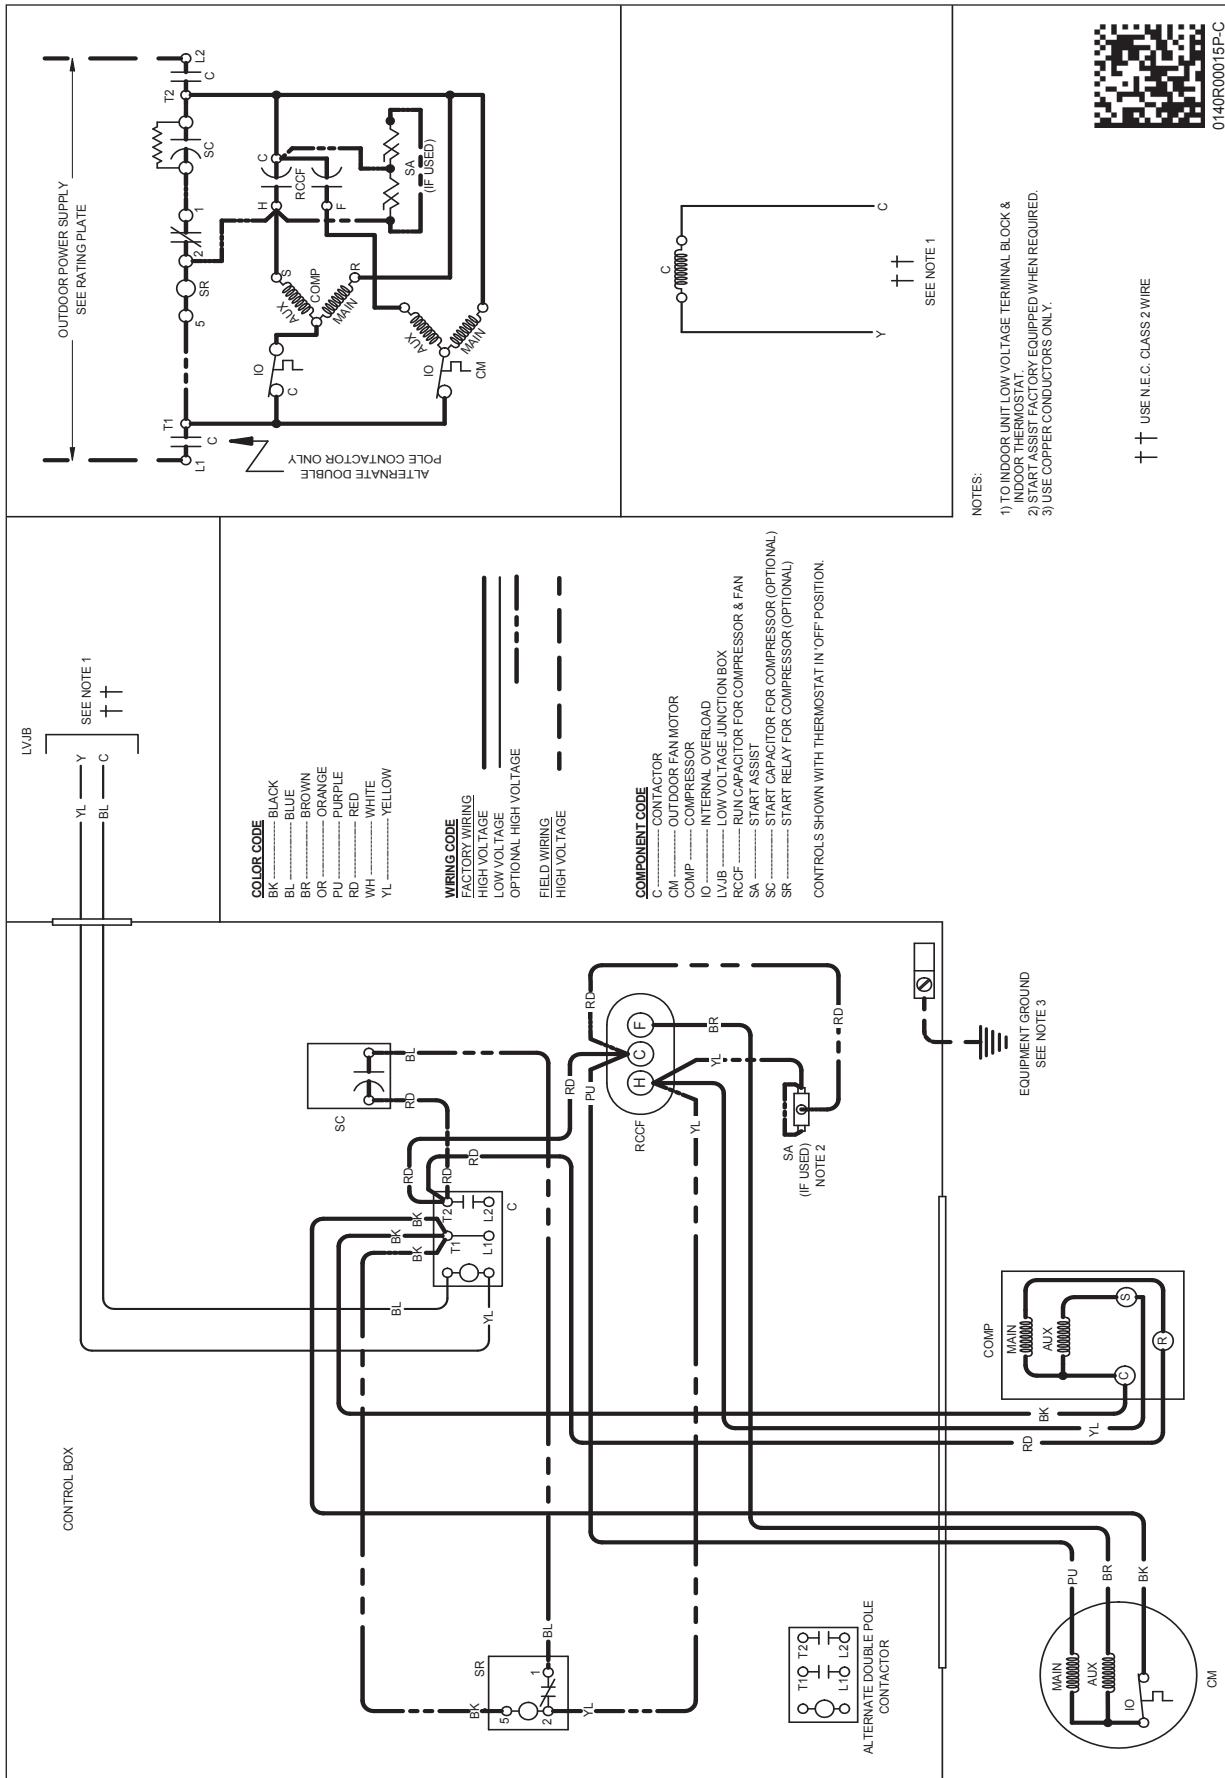

- COLOR CODE**
 BK BLACK
 BL BLUE
 BR BROWN
 OR ORANGE
 PU PURPLE
 RD RED
 WH WHITE
 YL YELLOW
- WIRING CODE**
 FACTORY WIRING
 HIGH VOLTAGE
 LOW VOLTAGE
 OPTIONAL HIGH VOLTAGE
 FIELD WIRING
 HIGH VOLTAGE
- COMPONENT CODE**
 C CONTACTOR
 CM OUTDOOR FAN MOTOR
 COMP COMPRESSOR
 IO INTERNAL OVERLOAD
 LVJB LOW VOLTAGE JUNCTION BOX
 RCCF RUN CAPACITOR FOR COMPRESSOR & FAN
 SA START CAPACITOR FOR COMPRESSOR (OPTIONAL)
 SC START RELAY FOR COMPRESSOR (OPTIONAL)
 SR START RELAY FOR COMPRESSOR (OPTIONAL)
- CONTROLS SHOWN WITH THERMOSTAT IN 'OFF' POSITION

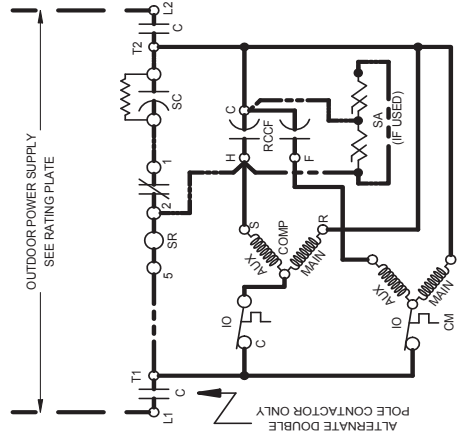

- NOTES:**
 1) TO INDOOR UNIT LOW VOLTAGE TERMINAL BLOCK & INDOOR THERMOSTAT.
 2) START ASSIST FACTORY EQUIPPED WHEN REQUIRED.
 3) USE COPPER CONDUCTIONS ONLY.



†† USE N.E.C. CLASS 2 WIRE

WARNING
 High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

MODEL #	DESCRIPTION	VSX14 018/19	VSX14 024/25	VSX14 030/31	VSX14 036/37	VSX14 042/43	VSX14 048	VSX14 060
ABK-20	Anchor Bracket Kit [□]			X	X	X	X	X
ABK-21	Anchor Bracket Kit [□]	X	X					
ASC-01	Anti-Short Cycle Kit	X	X	X	X	X	X	X
CSR-U-1	Hard-start Kit	X	X	X	X			
CSR-U-2	Hard-start Kit					X	X	X
CSR-U-3	Hard-start Kit						X	X
FSK01A ¹	Freeze Protection Kit	X	X	X	X	X	X	X
LSK02A ²	Liquid Line Solenoid Kit	X	X	X	X	X	X	X
TX2N4 ²	TXV Kit	X						
TX2N4A ²	TXV Kit	X	X					
TX3N4 ²	TXV Kit			X	X			
TX5N4 ²	TXV Kit					X	X	X

[□] Contains 20 brackets; four brackets needed to anchor unit to pad

¹ Installed on indoor coil

² Field-installed, non-bleed, expansion valve kit — Condensing units and heat pumps with reciprocating compressors require the use of start-assist components when used in conjunction with an indoor coil using a non-bleed thermal expansion valve refrigerant metering device or liquid line solenoid kit. The TXV should always be sized based on the tonnage of the outdoor unit.

NOTES
