



Air Conditioning & Heating

# GSH13

## 1½- To 5-TON SPLIT SYSTEM HEAT PUMPS

### 13 SEER / R-22



#### Contents

Nomenclature .....	2
Product Specifications .....	3
AHRI Ratings.....	4
Dimensions .....	5
Wiring Diagrams .....	6
Accessories .....	7

#### Standard Features

- Energy-efficient compressor
- Quiet condenser fan system
- Copper tube/aluminum fin coil
- For use with R-22 refrigerant and charged with inert gas for shipping
- Factory-installed bi-flow liquid line filter drier
- Low-pressure switch
- Time-initiated, temperature-terminated defrost control
- Service valves with sweat connections and easy-access gauge ports
- Contactor with lug connection
- Ground lug connection
- ETL Listed

#### Cabinet Features

- Louver design sound control top
- Steel louver coil guard
- Heavy-gauge, galvanized-steel cabinet with rust-resistant screws
- Attractive Architectural Gray powder-paint finish with 500-hour salt-spray approval
- Single-panel access to controls with space provided for field-installed accessories
- When properly anchored, meets the 2010 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)



\* Complete warranty details available from your local dealer or at [www.goodmanmfg.com](http://www.goodmanmfg.com).

**NOMENCLATURE**

	<b>G</b>	<b>S</b>	<b>H</b>	<b>13</b>	<b>036</b>	<b>1</b>	<b>A</b>	<b>A</b>	
	<b>1</b>	<b>2</b>	<b>3</b>	<b>4,5</b>	<b>6,7,8</b>	<b>9</b>	<b>10</b>	<b>11</b>	
<b>Brand</b>	G Goodman® (Standard Feature Set Models)								<b>Engineering *</b> Minor Revision
<b>Product Category</b>	S Split System								<b>Engineering *</b> Major Revision
<b>Unit Type</b>	C Condenser R-22 H Heat Pump R-22						1	208/230 V, 1 Phase, 60 Hz	<b>Electrical</b>
<b>Efficiency</b>	13 13 SEER								<b>Nominal Capacity</b>
							018	1½ Tons	042 3½ Tons
							024	2 Tons	048 4 Tons
							030	2½ Tons	060 5 Tons
							036	3 Tons	

\* Neither used for order entry or inventory management.



**SPECIFICATIONS**

	GSH13 0181C*	GSH13 0241C*	GSH13 0301C*	GSH13 0361C*	GSH13 0421B*	GSH13 0481B*	GSH13 0601A*
<b>CAPACITIES AND RATINGS</b>							
Tonnage	1½	2	2½	3	3½	4	5
Decibels	73	71	72	71	76	76	77
<b>COMPRESSOR</b>							
RLA	8.3	10.8	13.5	14.1	19.2	19.9	25.0
LRA	40.3	56.0	68.0	75.0	112.0	104.0	148.0
Type	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll
<b>CONDENSER FAN MOTOR</b>							
Horsepower	1/8	1/8	1/8	¼	¼	¼	1/6
FLA	0.7	0.7	0.7	1.5	1.5	1.5	1.1
<b>REFRIGERANT SYSTEM</b>							
Refrigerant Line Size							
Liquid Line Size ("O.D.)	⅜"	⅜"	⅜"	⅜"	⅜"	⅜"	⅜"
Suction Line Size ("O.D.)	¾"	¾"	¾"	⅞"	1⅛"	1⅛"	1⅛"
Refrigerant Connection Size							
Liquid Valve Size ("O.D.)	⅜"	⅜"	⅜"	⅜"	⅜"	⅜"	⅜"
Suction Valve Size ("O.D.)	¾"	¾"	¾"	⅞"	⅞"	⅞"	⅞"
Valve Type	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge	127	122	130	188	246	208	233
<b>ELECTRICAL DATA</b>							
Voltage-Hz	208/230-60	208/230-60	208/230-60	208/230-60	208/230-1-60	208/230-1-60	208/230-60
Minimum Circuit Ampacity <sup>2</sup>	11.1	14.2	17.6	19.1	25.5	26.4	32.3
Max. Overcurrent Protection <sup>3</sup>	15	25	30	30	40	45	50
Min / Max Volts	197/253	197/253	197/253	197/253	197/253	197/253	197/253
Electrical Conduit Size	½" or ¾"	½" or ¾"	½" or ¾"	½" or ¾"	½" or ¾"	½" or ¾"	½" or ¾"
<b>EQUIPMENT WEIGHT (LBS)</b>	134	133	140	170	192	202	276
<b>SHIP WEIGHT (LBS)</b>	151	150	157	188	210	220	298

<sup>1</sup> Tested and rated in accordance with AHRI Standard 210/240

<sup>2</sup> Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

<sup>3</sup> Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

**NOTES**

- Always check the S&R plate for electrical data on the unit being installed.
- Installer will need to supply ⅞" to 1⅛" adapters for suction line connections.
- Charge to be added for 15' of ⅜" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.
- Installation of these units requires the specified TXV Kit to be installed on the indoor coil. THE SPECIFIED TXV IS DETERMINED BY THE OUTDOOR UNIT NOT THE INDOOR COIL.

**AHRI RATINGS**

OUTDOOR UNITS	INDOOR UNITS	COOLING CAPACITY (BTU/H)				TVA RATINGS <sup>3</sup>		HEATING CAPACITY (BTU/H)			CFM	AHRI #
	COILS/AIR HANDLERS	TOTAL	SENS.	SEER <sup>1</sup>	EER <sup>2</sup>	TOTAL	SENS.	HI	HSPF <sup>4</sup>	LOW		
GSH130181(B,C)*	AR*F182416B*	17,600	13,100	13.00	11.00	16,300	11,800	16,800	7.70	8,900	625	4675036
GSH130241(B,C)*	AR*F182416B*+TXV	23,000	17,800	13.00	11.00	21,400	15,800	21,400	7.70	11,800	860	4675037
GSH130301(B,C)*	AR*F363616B*	27,800	20,200	13.00	11.00	25,800	19,300	25,400	7.70	15,300	1,020	4692016
GSH130361(B,C)*	AR*F374316B*	33,600	26,200	13.00	11.00	31,000	23,400	31,400	7.70	18,200	1,260	4692017
GSH130363A*	AR*F374316B*	33,600	26,200	13.00	11.00	31,000	23,400	31,400	7.70	18,200	1,260	5528484
GSH130421B*	AR*F364216B*	40,000	29,800	13.00	11.00	37,200	28,200	39,000	8.00	23,000	1,250	5528479
GSH130481B*	AR*F486016B*	45,000	33,800	13.00	11.00	41,500	31,800	43,000	8.20	27,000	1,600	5528480
GSH130483B*	AR*F486016B*	45,000	33,800	13.00	11.00	41,500	31,800	43,000	8.20	27,000	1,600	5528481
GSH130484A*	AR*F486016B*	45,000	33,800	13.00	11.00	41,500	31,800	43,000	8.20	27,000	1,600	1492572
GSH130601A*	AR*F486016B*	55,500	41,000	13.00	11.00	51,500	37,000	55,500	8.50	35,000	1,800	1492576
GSH130603A*	AR*F486016B*	55,500	41,000	13.00	11.00	51,500	37,000	55,500	8.50	35,000	1,800	1492581
GSH130604A*	AR*F486016B*	55,500	41,000	13.00	11.00	51,500	37,000	55,500	8.50	35,000	1,800	1492585
GSH130604AC	AR*F486016B*	55,500	41,000	13.00	11.00	51,500	37,000	55,500	8.50	35,000	1,800	4982919

<sup>1</sup> BTU/h

<sup>2</sup> Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F

<sup>3</sup> Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F


<sup>4</sup> TVA Rating: BTU/h @ 75°F/ 63°F - 95°F

<sup>5</sup> HSPF = Heating Seasonal Performance Factor

**NOTES**


- Always check the S&R plate for electrical data on the unit being installed.
- When matching outdoor unit to indoor unit, use the piston supplied with outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Goodman Gas Furnace contains the EEP cooling time delay

**DIMENSIONS**

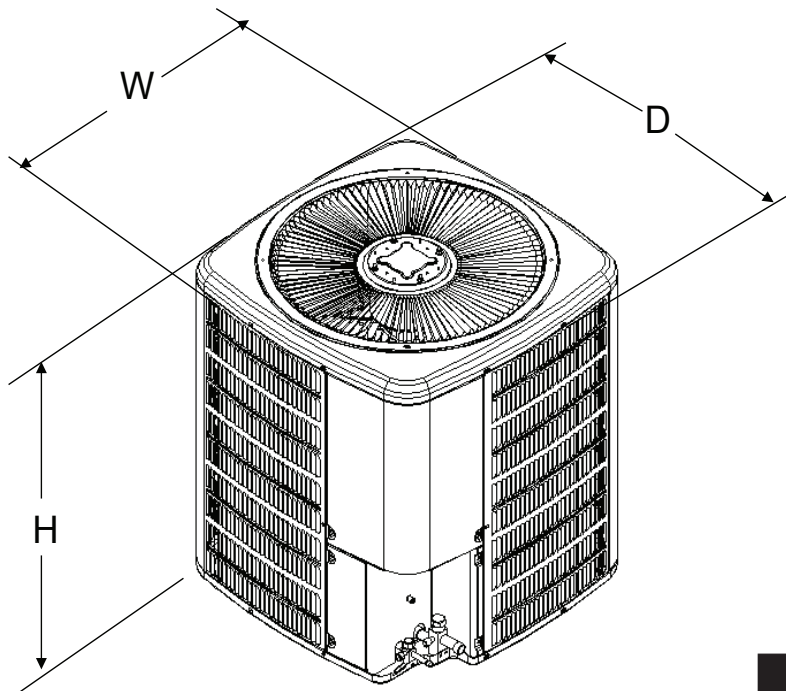

MODEL	DIMENSIONS		
	W"	D"	H"
GSH130181C	26	26	32¼
GSH130241C	26	26	32¼
GSH130301C	26	26	34¼
GSH130361C	29	29	38¼
GSH130421B	29	29	32¼
GSH130481B	29	29	34¼
GSH130601A	35½	35½	34¼

# WIRING DIAGRAM

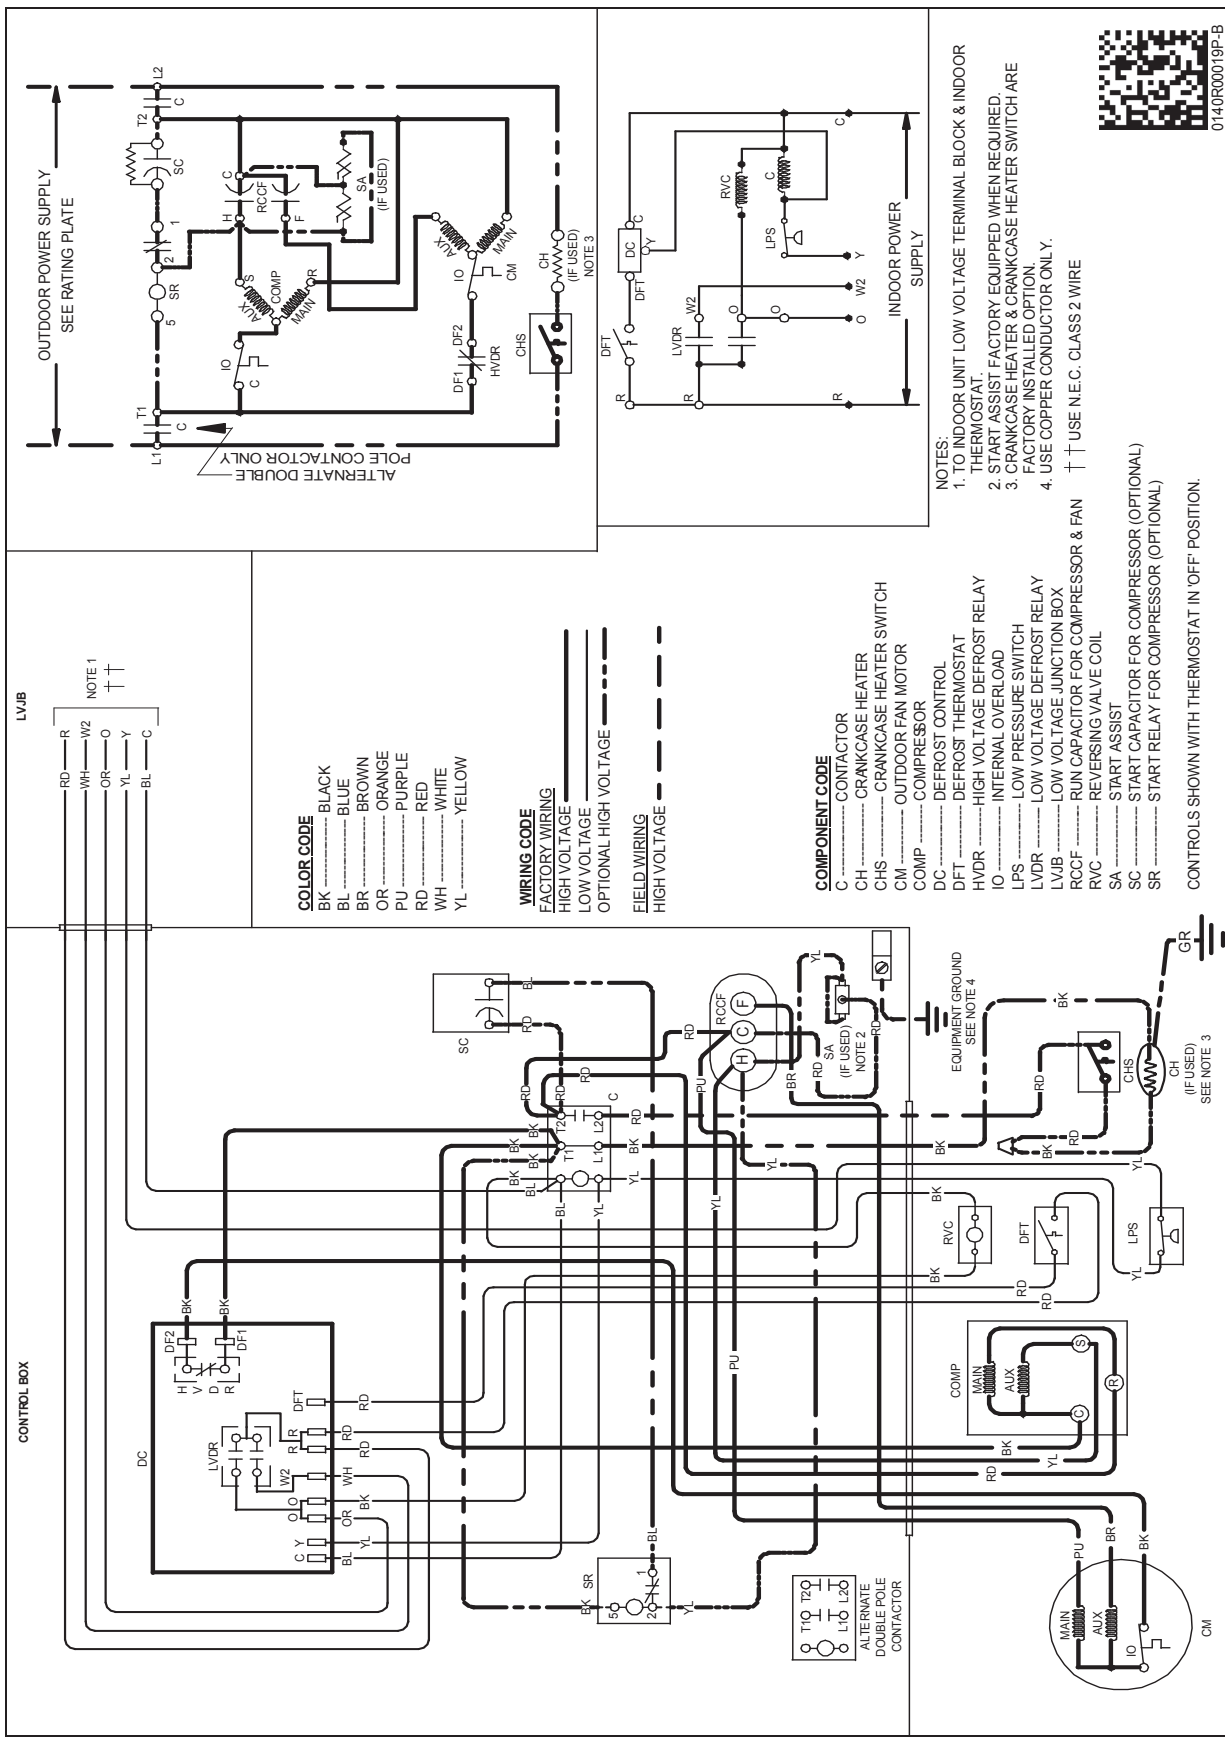

**COLOR CODE**  
 BK ..... BLACK  
 BL ..... BLUE  
 BR ..... BROWN  
 OR ..... ORANGE  
 PU ..... PURPLE  
 RD ..... RED  
 WH ..... WHITE  
 YL ..... YELLOW

**WIRING CODE**  
 FACTORY WIRING  
 HIGH VOLTAGE  
 LOW VOLTAGE  
 OPTIONAL HIGH VOLTAGE  
 FIELD WIRING  
 HIGH VOLTAGE

**COMPONENT CODE**  
 C ..... CONTACTOR  
 CH ..... CRANKCASE HEATER  
 CHS ..... CRANKCASE HEATER SWITCH  
 CM ..... OUTDOOR FAN MOTOR  
 COMP ..... COMPRESSOR  
 DC ..... DEFROST CONTROL  
 DFT ..... DEFROST THERMOSTAT  
 HVDR ..... HIGH VOLTAGE DEFROST RELAY  
 IO ..... INTERNAL OVERLOAD  
 LVDR ..... LOW VOLTAGE DEFROST RELAY  
 LVJB ..... LOW VOLTAGE DEFROST RELAY  
 LVJB ..... LOW VOLTAGE JUNCTION BOX  
 RCF ..... RUN CAPACITOR FOR COMPRESSOR & FAN  
 RVC ..... REVERSING VALVE COIL  
 SA ..... START ASSIST  
 SC ..... START CAPACITOR FOR COMPRESSOR (OPTIONAL)  
 SR ..... START RELAY FOR COMPRESSOR (OPTIONAL)

CONTROLS SHOWN WITH THERMOSTAT IN 'OFF' POSITION.

**NOTES:**  
 1. TO INDOOR UNIT LOW VOLTAGE TERMINAL BLOCK & INDOOR THERMOSTAT.  
 2. START ASSIST FACTORY EQUIPPED WHEN REQUIRED.  
 3. CRANKCASE HEATER & CRANKCASE HEATER SWITCH ARE FACTORY INSTALLED OPTION.  
 4. USE COPPER CONDUCTOR ONLY.  
 †† USE N.E.C. CLASS 2 WIRE



0140R00019P-B

Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

**WARNING**

**High Voltage:** Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

## ACCESSORIES

MODEL	DESCRIPTION	GSH13 018	GSH13 024	GSH13 030	GSH13 036	GSH13 042	GSH13 048	GSH13 060
ABK-20	Anchor Bracket Kit *	X	X	X	X	X	X	X
ASC01	Anti-Short Cycle Kit	X	X	X	X	X	X	X
CSR-U-1	Hard-start Kit	X	X	X	X	X	X	
CSR-U-3	Hard-start Kit							X
FSK01A <sup>1</sup>	Freeze Protection Kit	X	X	X	X	X	X	X
OT/EHR18-60	Emergency Heat Relay kit	X	X	X	X	X	X	X
OT18-60A <sup>2</sup>	Outdoor Thermostat with Lockout Stat	X	X	X	X	X	X	X

\* Contains 20 brackets; four brackets needed to anchor unit to pad

<sup>1</sup> Installed on indoor coil

<sup>2</sup> Required for heat pump applications where ambient temperatures fall below 0 °F with 50% or higher relative humidity.

<sup>3</sup> Condensing units and heat pumps with reciprocating compressors require the use of start-assist components when used in conjunction with an indoor coil using a non-bleed thermal expansion valve refrigerant metering device. The TXV should always be sized based on the tonnage of the outdoor unit.

**NOTES**