


S-TL Submittal Sheet for Flexible Air Duct

Non-Insulated Flexible Air Duct for Pressure Cooling Systems



CODES/STANDARDS	Greenguard Gold Certified for Superior Indoor Air Quality	Listed and labeled by Underwriters' Laboratories, Inc., as a Class I Air Duct, Standard 181 and CUL S110. It complies with the latest NFPA Bulletins 90A and 90B. Meets FHA and other U.S. government agency standards. Flame spread: not over 25. Smoke developed: not over 50.												
FABRIC TYPE	Coated fiberglass woven fabric													
STEEL WIRE	Coated spring steel wire helix													
SIZES, ID	2 3 4 5 6 7 8 9 10 12 14 16 18 20													
LENGTH (feet)	25 ft.												15 ft.	
INSIDE BEND RADIUS (inches)	2 3 4 5 6 7 8 9 10 12 14 16 18 20													
OPERATING TEMPERATURE RANGE	-20°F to 250°F													
RATED VELOCITY	6000 fpm.													
MAX RATED PRESSURE (inches water column)	POSITIVE	16 inches (2-10 in. dia.)						10 inches (12-20 in. dia.)						
	NEGATIVE	1 inch												

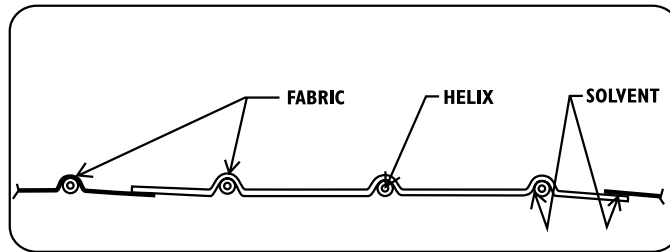

JOB _____	
LOCATION _____	P.O. NO. _____
ENGINEER _____	JOB NO. _____
CONTRACTOR _____	REPRESENTATIVE _____
Certified Correct	Approved for Construction
BY _____	BY _____
TITLE _____	TITLE _____
DATE _____	DATE _____



1-800-459-4822 • www.thermaflex.net

Corporate Headquarters: 381 Carwellyn Road • Abbeville, SC 29620 • Phoenix, AZ • Cairo, GA • Mississauga, ON Canada

© 2017 Flex-Tek Group, Bulletin S-TL 8/17 Printed in USA